




# INSTALLATION MANUAL

## R410A Split Series

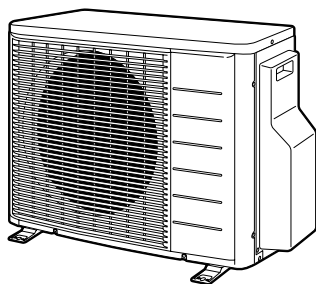

### Models

<b>2MXS40FV1B</b>	<b>2MKS40FV1B</b>
<b>2MXS50FV1B</b>	<b>2MKS50FV1B</b>
<b>2AMX40FV1B</b>	<b>2AMK40FV1B</b>
<b>2AMX50FV1B</b>	<b>2AMK50FV1B</b>
<b>2MXS40GV1B</b>	<b>2MKS40GV1B</b>
<b>2MXS50GV1B</b>	<b>2MKS50GV1B</b>

Installation manual  
R410A Split series

**English**

Installationsanleitung  
Split-Baureihe R410A

**Deutsch**

Manuel d'installation  
Série split R410A

**Français**

Montagehandleiding  
R410A Split-systeem

**Nederlands**

Manual de instalación  
Serie Split R410A

**Español**

Manuale d'installazione  
Serie Multiambienti R410A

**Italiano**

Εγχειρίδιο εγκατάστασης  
διαιρούμενης σειράς R410A

**Ελληνικά**

Manual de Instalação  
Série split R410A

**Portugues**

Руководство по монтажу  
Серия R410A с раздельной установкой

**Русский**

Montaj kılavuzları  
R410A Split serisi

**Türkçe**

CE - KONFORMITÄTSERKLÄRUNG  
CE - DECLARATION-OF-CONFORMITY  
CE - KONFORMITÄTSEKLERING  
CE - DECLARATEIJS-VERKLARING

CE - DECLARACION-DE-CONFORMIDAD  
CE - DICHIARAZIONE-DI-CONFORMITA  
CE - ΔΗΛΩΣΗ ΣΥΜΜΟΡΦΩΣΗΣ

CE - DECLARAÇÃO-DE-CONFORMIDADE  
CE - ЗАЯВЛЕНИЕ-О-СООТВЕТСТВИИ  
CE - ОПВІДІЛСЯ СЕРІЄМ КЛЕРІНГ  
CE - FÖRSÄKRAN-OM ÖVERENSSTÄMMELSE

CE - ERKLÆRING OM-SAMSVAR  
CE - ILMOITUS-YHDENMUKAISUUSDESTA  
CE - PROHLÁŠENÍ-O-SHOĐE

CE - IZJAVA-O-USKLABENOSTI  
CE - MEGFELELŐSÉG-NYILATKOZAT  
CE - DEKLARACIJA-ZGODNOSTI  
CE - DECLARAȚIE-DE-CONFORMITATE

CE - IZJAVA O SKLADNOSTI  
CE - VASTAVUŠDEKLARACIJA  
CE - ATITIKTIES-DEKLARACIJA  
CE - ATBILSTĪBAS-DEKLARACIJA  
CE - VYHLÁŠENIE-ZHODY  
CE - UYUMLULUK-BİLDİRİSİ

DAIKIN INDUSTRIES, LTD.

- 01 00 declares under its sole responsibility that the air conditioning models to which this declaration relates:
- 01 00 erklærer under eneansvar, at klimaanlegsmødelierne, som denne deklaration vedrører:
- 02 01 erklärt auf seine alleinige Verantwortung daß die Modelle der Klimaanlage für die diese Erklärung bestimmt ist:
- 02 01 déclare sous sa seule responsabilité que les appareils d'air conditionné visés par la présente déclaration:
- 03 00 verklaart hierbij op eigen exclusieve verantwoordelijkheid dat de aconditioning units waarop deze verklaring betrekking heeft:
- 03 00 verklaart hierbij op eigen exclusieve verantwoordelijkheid dat de aconditioning units waarop deze verklaring betrekking heeft:
- 04 01 dichiara sotto sua responsabilità che i condizionatori modello a cui è riferita questa dichiarazione:
- 04 01 dichiara sotto sua responsabilità che i condizionatori modello a cui è riferita questa dichiarazione:
- 05 00 δηλώνει με αποκλειστική της ευθύνης ότι τα μοντέλα των κλιματιστικών συσκευών στα οποία αναφέρεται η παρούσα δήλωση:
- 05 00 δηλώνει με αποκλειστική της ευθύνης ότι τα μοντέλα των κλιματιστικών συσκευών στα οποία αναφέρεται η παρούσα δήλωση:
- 06 00 заявляет исключительно под своей ответственностью, что модели кондиционеров воздуха, к которым относится настоящая заявлени:
- 06 00 заявляет исключительно под своей ответственностью, что модели кондиционеров воздуха, к которым относится настоящая заявлени:

2MXS40FV1B, 2MXS40FV1B, 2MXS50FV1B, 2MXS50FV1B, 2AMX40FV1B, 2AMX40FV1B,  
2AMX50FV1B, 2AMKS50FV1B, 2AMKS40GV1B, 2MKS40GV1B, 2MKS50GV1B, 2MKS50GV1B

- 01 are in conformity with the following standard(s) or other normative document(s), provided that these are used in accordance with our instructions:
- 02 deriden følgende Norm(en) eller einen anderen Normdokument oder -dokumenten entspricht/entsprechen, unter der Voraussetzung, daß sie gemäß unseren Anweisungen eingesetzt werden:
- 03 sont conformes à l(au)x norme(s) ou autre(s) document(s) normatif(s), pour autant qu'ils soient utilisés conformément à nos instructions:
- 04 conform de volgende norm(en) of één of meer andere bindende documenten zijn, op voorwaarde dat ze worden gebruikt overeenkomstig onze instructies:
- 05 están en conformidad con la(s) siguiente(s) norma(s) u otro(s) documento(s) normativo(s), siempre que sean utilizados de acuerdo con nuestras instrucciones:
- 06 sono conformi all(elle) standard(s) o altro(i) documento(i) a carattere normativo, a patto che vengano usati in conformità alle nostre istruzioni:
- 07 εναντι οµοµορφία με το(α) ακόλουθο(α) πρότυπο(α) ή άλλο(α) έγγραφο(α) κανονιστικό, υπό την προϋπόθεση ότι χρησιµοποιούµετα σύμφωνα με τις οδηγίες µας:

EN60335-2-40,

- 01 following the provisions of:
- 02 gemäß den Vorschriften der:
- 03 conformément aux stipulations des:
- 04 overeenkomstig de bepalingen van:
- 05 siguiendo las disposiciones de:
- 06 secondo le prescrizioni per:
- 07 με την προϋπόθεση των διατάξεων των:
- 08 de acordo com o previsto em:
- 09 в соответствии с положениями:
- 10 under lagtagelse af bestemmelserne i:
- 11 enligt villkoren i:
- 12 gitt i/henhold til bestemmelserne i:
- 13 noudatteen määräyksii:
- 14 za dodržení ustanovení předpisu:
- 15 prema odredbama:
- 16 követi azt:
- 17 zgodnie z postanowieniami Dyrekty:
- 18 in urma prevederilor:
- 19 ob upoštevjanju določb:
- 20 vestavak nariadení:
- 21 cneizpavak krajevne na:
- 22 laikantis nuostatų, patiekiamų:
- 23 isevėrogi prastabas, kas pateiktas:
- 24 održavajući ustanovienja:
- 25 sunun koşullama uygun olarak:

- 01 Note \* as set out in the Technical Construction File **Daikin.TCF.015** and judged positively by **KEIMA** according to the Certificate **74736-KRO-EMC37-4957**.
- 02 Hinweis \* wie in der Technischen Konstruktionsakte **Daikin.TCF.015** aufgeführt und von **KEIMA** positiv ausgemacht gemäß Zertifikat **74736-KRO-EMC37-4957**.
- 03 Remarque \* tel que stipulé dans le Fichier de Construction Technique **Daikin.TCF.015** et jugé positivement par **KEIMA** conformément au Certificat **74736-KRO-EMC37-4957**.
- 04 Bemerk \* zoals vermeld in het Technisch Constructiebesluit **Daikin.TCF.015** en in orde bevonden door **KEIMA** overeenkomstig Certificaat **74736-KRO-EMC37-4957**.
- 05 Nota \* tal como se expone en el Archivo de Construcción Técnica **Daikin.TCF.015** y juzgado positivamente por **KEIMA** según el Certificado **74736-KRO-EMC37-4957**.
- 06 Nota \* delimitato nel File Tecnico di Costruzione **Daikin.TCF.015** e giudicato positivamente da **KEIMA** secondo il Certificato **74736-KRO-EMC37-4957**.
- 07 Zbiranje \* ovisno predočeno u arhivu Tehničkog Konstruktivnog **Daikin.TCF.015** kao potvrda pozitivnog mišljenja prema to **KEIMA** odobrenom u skladu s certifikatom **74736-KRO-EMC37-4957**.
- 08 Nota \* tal como estabelecido no Ficheiro Técnico de Construção **Daikin.TCF.015** e com o parecer positivo de **KEIMA** de acordo com o Certificado **74736-KRO-EMC37-4957**.
- 09 Примечание \* как изложено в Досье технического толкования **Daikin.TCF.015** и в соответствии с положительным решением **KEIMA** согласно Сертификату **74736-KRO-EMC37-4957**.

- 10 000 erklærer under eneansvar, at klimaanlegsmødelierne, som denne deklaration vedrører:
- 11 000 erklærer i egenkapitál av hrvudansvarig, at luftkonditioneringsmodellerna som berörs av denna deklaration innebär att:
- 12 000 erklærer et fuldstændigt ansvar for at de luftkonditioneringsmodeller som berøres af denne deklaration indebærer at:
- 13 000 ilmoittaa yksinomaan omalla vastuullaan, että laittain ilmoituksen tarkoituksella ilmoitettuihin laitteisiin liittyy mallit:
- 14 000 prohlásuje ve své plné odpovědnosti, že modely klimatizace, k nimž se tato prohlášení vztahuje:
- 15 000 izjavljue pod izključivo vsilomno odgovornostjo da su modeli klima uređaja na koje se ova izjava odnosi:
- 16 000 teljes felelősséggel kijelenti, hogy a klímaberendezés modellek, melyekre a nyilatkozat vonatkozik:
- 17 000 deklarije na vlastnu i výlučnou odpovědnost, že modely klimatizátorov, ktorých dotyczy minijša deklarácia:
- 18 000 deklará pe proprie răspundere că aparatele de aer condiționat la care se referă această declarație:

- 08 estão em conformidade com a(s) seguinte(s) norma(s) ou outro(s) documento(s) normativo(s), desde que estes sejam utilizados de acordo com as nossas instruções:
- 09 соответствуют следующим стандартам или другим нормативным документам, при условии их использования согласно нашим инструкциям:
- 10 overholder følgende standard(er) eller anden/andre retningsgivende dokument(er), forudsat at disse anvendes i henhold til vore instrukser:
- 11 respektive utrustning är utförd i överensstämmelse med och följer följande standard(er) eller andra normgivande dokument, under förutsättning att användandet sker i överensstämmelse med våra instruktioner:
- 12 respektive utstyr är i överensstämmelse med följande standard(er) eller andre normgivende dokument(er), under forutsætning av at disse brukes i henhold til våre instruksjoner:
- 13 razstavat searavien standarden ja muiden ohjeistettien dokumenttien vaatimuksia edellyttäen, että niitä käytetään ohjeidemme mukaisesti:
- 14 za predpokrdu, že jsou využívány v souladu s našimi pokyny, odpovídá následujícím normám nebo normativním dokumentům:
- 15 u skladu sa slijedećim standardom(na) ili drugim normativnim dokumentom(na), uz uvjet da se oni koriste u skladu s našim uputama:

- 01 Directives, as amended.
- 02 Direktiven, genad Änderung.
- 03 Directives, telles que modifiées.
- 04 Richtlijnen, zoals geamendard.
- 05 Directivas, según lo emendado.
- 06 Directive, come da modifica.
- 07 Önyvű, amek érvényes módosítások.
- 08 Directivas, conforme alterações em.
- 09 Директиве, со всеми поправками.
- 10 Direktive, med senere ændringer.
- 11 Direktiv, med foretagne ændringer.
- 12 Direktiv, med foretagne endringar.
- 13 Direktiiv, sellasine kuulin te ovat muudetuna.
- 14 V päidetud zneti.
- 15 Snemica, kako je izmijenjeno.
- 16 Irányelvek, és módosítások rendelkezései.
- 17 Pozbljšepzyj popravkami.
- 18 Direktivelor, cu amendamentele respective.

Low Voltage 2006/95/EC  
Machinery Safety 98/37/EEC  
Electromagnetic Compatibility 2004/108/EC \*

- 10 Bemerk \* som anført i den Tekniske Konstruktionsfil **Daikin.TCF.015** og positivt vurderet af **KEIMA** i henhold til Certifikat **74736-KRO-EMC37-4957**.
- 11 Information \* utrustningen är utförd enligt den tekniska konstruktionsfilen **Daikin.TCF.015** som positivt ingåes av **KEIMA** i vilket också framgår att Certifikat **74736-KRO-EMC37-4957**.
- 12 Merk \* som det fremkommer den tekniske konstruktionsfilen **Daikin.TCF.015** og gennem positiv bedømmelse af **KEIMA** ifølge Serifikat **74736-KRO-EMC37-4957**.
- 13 Huom \* pikin on esitetty teknisessä Asakirjassa **Daikin.TCF.015** ja jotta **KEIMA** on hyväksynyt Serifikatin **74736-KRO-EMC37-4957** mukaisesti.
- 14 Poznámka \* jak bylo uvedeno v souboru technické konstrukce **Daikin.TCF.015** a pozitivně zjištěno **KEIMA** v souladu s ověřením **74736-KRO-EMC37-4957**.
- 15 Napomena \* kako je izloženo u Databazi o tehničkoj konstrukciji **Daikin.TCF.015** pozitivno odjeleno od strane **KEIMA** prema Certifikatu **74736-KRO-EMC37-4957**.
- 16 Megjegyzés \* a(z) **Daikin.TCF.015** műszaki konstrukciós dokumentációjában, a(z) **KEIMA** igazolta a megfigyelést.
- 17 Uwaga \* zgodnie z archiwizną dokumentacją konstrukcyjną **Daikin.TCF.015** pozytywną opinią **KEIMA**.
- 18 Notá \* conform celor stabilite în Dosarul tehnic de construcție **Daikin.TCF.015** și apreciate pozitiv de **KEIMA** în conformitate cu Certificatul **74736-KRO-EMC37-4957**.

- 19 000 z svo odgovornosti izjavlja, da so modeli klimatskih naprav, na katere se izjava nanaša:
- 20 000 kinnab oma täieliku vastutuse, et väheselise deklaratsioon alla kuuluvad kliimaseadmiste mudelid:
- 21 000 deklariirja na oson ottoospor, et moodulite klimaatina installaia, za korig se otnoa zai deklaracia:
- 22 000 visika savo atsakomybe skelbia, kad oro kondicionavimo prietaisų modeliai, kuriems yra laikoma ši deklaracija:
- 23 000 airu atbildību apliecina, ka tālāk uzskaitito modeļu gaisa kondicionēāji, uz kuriem attiecas šī deklarācija:
- 24 000 vyhlásuje na vlastnu zodpovednost, že tieto klimatizačné modely, na ktoré sa vzťahuje táto vyhlásenie:
- 25 000 ananmen kendi sorumluluğunda onarak izare bu bilgilirini ilgili iklimi modelilerin asğıdaki gibi olduğunu beyan eder:

- 16 megfelelnek az alábbi szabvány(ok)nak vagy egyéb irányadó dokumentum(ok)nak, ha azokat elhárás szerint használják:
- 17 spełniają wymogi następujących norm i innych dokumentów normalizacyjnych, pod warunkiem że używane są zgodnie z naszymi instrukcjami:
- 18 sunt în conformitate cu următorul (următoare) standard(e) sau al(e) document(e) normativ(e), cu condiția ca acestea să fie utilizate în conformitate cu instrucțiunile noastre:
- 19 skladni z naslednjih standardi in drugimi normativi, pod pogojem, da se uporabljajo v skladu z našimi navodili:
- 20 on vastutusse jargmis/je standard(ie)ga või teiste normatiivsete dokumentidega, kui need kasutatakse vastavalt meie juhendile:
- 21 osotvetstvuet na srednie standarty ili drugi normativni dokumenty, pri usloviye, che se ispolzovuet sootvashno našimie instruktsii:
- 22 atliinka žemiau nurodijus standartus ir (arba) kitus norminius dokumentus su sąlyga, kad yra naudojami pagal mūsų nurodymus:
- 23 tai, je liechi atbilstisio rādāda norādījumiem, atbilsti sekojošiem standartiem un citiem normatīviem dokumentiem:
- 24 su u v zhođe s nasledovnujimi) normuđami) alebo inými) normativnými) dokumentmi(ami), za predpokladu, že sa používajú v súlade s našimi návodmi:
- 25 urunin, lalimatlamza gulanlimas koşulluyla asğıdaki standartlar ve norm belirlen belgelerine uyumludur:

- 10 Direktive, med senere ændringer.
- 11 Direktiv, med foretagne ændringer.
- 12 Direktiv, med foretagne endringar.
- 13 Direktiiv, sellasine kuulin te ovat muudetuna.
- 14 V päidetud zneti.
- 15 Snemica, kako je izmijenjeno.
- 16 Irányelvek, és módosítások rendelkezései.
- 17 Pozbljšepzyj popravkami.
- 18 Direktivelor, cu amendamentele respective.
- 19 Opomba \* kaj je dođeno v tehnični mapi **Daikin.TCF.015** in odobreno s strani **KEIMA** v skladu s certifikatom **74736-KRO-EMC37-4957**.
- 20 Märkus \* naga on näidatud tehnilises dokumentatsioonis **Daikin.TCF.015** ja heaks kiidavad **KEIMA** järgi vastavalt sertifikaadile **74736-KRO-EMC37-4957**.
- 21 Zabeleška \* kako je zabeleženo v Akta za tehnička konstrukcija **Daikin.TCF.015** in odueno potvrdjeno ot **KEIMA** samacho Serifikatom **74736-KRO-EMC37-4957**.
- 22 Pastaba \* kaip nurolyta techninėje konstrukcijos bylose **Daikin.TCF.015** ir patvirtina **KEIMA** pagal pažymėjimą **74736-KRO-EMC37-4957**.
- 23 Piezīmes \* ka noteikts šīmā gaisa dokumentācijā **Daikin.TCF.015**, atbilstoši **KEIMA** pozitīvajam lēmumam ko apliecina sertifikats **74736-KRO-EMC37-4957**.
- 24 Poznámka \* ako je stanovene v Súbore technické konstrukcie **Daikin.TCF.015** a kladne posúdené **KEIMA** podľa Certifikátu **74736-KRO-EMC37-4957**.
- 25 Not \* **Daikin.TCF.015** Technik Yap Dosydasına belirtilmiş gibi ve **74736-KRO-EMC37-4957** sertifikasına göre **KEIMA** tarafından dumluy olarak deđerlendirilmiştir.




*Noboru Murata*

Noboru Murata  
Manager Quality Control Department  
Shiga, 1st of Nov. 2007

**DAIKIN INDUSTRIES, LTD.**  
Umeda Center Bldg., 2-4-12, Nakazaki-Nishi,  
Kita-ku, Osaka, 530-8323 Japan




# Safety Precautions

- Read these Safety Precautions carefully to ensure correct installation.
- This manual classifies the precautions into WARNING and CAUTION.  
Be sure to follow all the precautions below: they are all important for ensuring safety.

 **WARNING**.....Failure to follow any of WARNING is likely to result in such grave consequences as death or serious injury.




 **CAUTION**.....Failure to follow any of CAUTION may result in grave consequences in some cases.

- The following safety symbols are used throughout this manual:


 Be sure to observe this instruction.	 Be sure to establish an earth connection.	 Never attempt.
--	---	--

- After completing installation, test the unit to check for installation errors. Give the user adequate instructions concerning the use and cleaning of the unit according to the Operation Manual.

## WARNING






• Installation should be left to the dealer or another professional. Improper installation may cause water leakage, electrical shock, or fire.
• Install the air conditioner according to the instructions given in this manual. Incomplete installation may cause water leakage, electrical shock, or fire.
• Be sure to use the supplied or specified installation parts. Use of other parts may cause the unit to come to lose, water leakage, electrical shock, or fire.
• Install the air conditioner on a solid base that can support the weight of the unit. An inadequate base or incomplete installation may cause injury in the event the unit falls off the base.
• Electrical work should be carried out in accordance with the installation manual and the national electrical wiring rules or code of practice. Insufficient capacity or incomplete electrical work may cause electrical shock or fire.
• Be sure to use a dedicated power circuit. Never use a power supply shared by another appliance.
• For wiring, use a cable length enough to cover the entire distance with no connection. Do not use an extension cord. Do not put other loads on the power supply, use a dedicated power circuit. (Failure to do so may cause abnormal heat, electric shock or fire.)
• Use the specified types of wires for electrical connections between the indoor and outdoor units. Firmly clamp the interconnecting wires so their terminals receive no external stresses. Incomplete connections or clamping may cause terminal overheating or fire.
• After connecting interconnecting and supply wiring be sure to shape the cables so that they do not put undue force on the electrical covers or panels. Install covers over the wires. Incomplete cover installation may cause terminal overheating, electrical shock, or fire.
• If any refrigerant has leaked out during the installation work, ventilate the room. (The refrigerant produces a toxic gas if exposed to flames.) 
• After all installation is complete, check to make sure that no refrigerant is leaking out. (The refrigerant produces a toxic gas if exposed to flames.) 
• When installing or relocating the system, be sure to keep the refrigerant circuit free from substances other than the specified refrigerant (R410A), such as air. (Any presence of air or other foreign substance in the refrigerant circuit causes an abnormal pressure rise or rupture, resulting in injury.)
• During pump-down, stop the compressor before removing the refrigerant piping. If the compressor is still running and the stop valve is open during pump-down, air will be sucked in when the refrigerant piping is removed, causing abnormal pressure in the freezer cycle which will lead to breakage and even injury.
• During installation, attach the refrigerant piping securely before running the compressor. If the compressor is not attached and the stop valve is open during pump-down, air will be sucked in when the compressor is run, causing abnormal pressure in the freezer cycle which will lead to breakage and even injury.
• Be sure to establish an earth. Do not earth the unit to a utility pipe, arrester, or telephone earth. Incomplete earth may cause electrical shock, or fire. A high surge current from lightning or other sources may cause damage to the air conditioner. 
• Be sure to install an earth leakage breaker. Failure to install an earth leakage breaker may result in electric shocks, or fire.

## CAUTION

• Do not install the air conditioner in a place where there is danger of exposure to inflammable gas leakage. If the gas leaks and builds up around the unit, it may catch fire. 
• Establish drain piping according to the instructions of this manual. Inadequate piping may cause flooding.
• Tighten the flare nut according to the specified method such as with a torque wrench. If the flare nut is tightened too hard, the flare nut may crack after a long time and cause refrigerant leakage.
• Make sure to provide for adequate measures in order to prevent that the outdoor unit be used as a shelter by small animals. Small animals making contact with electrical parts can cause malfunctions, smoke or fire. Please instruct the customer to keep the area around the unit clean.

# Accessories

Accessories supplied with the outdoor unit:

<p>Installation Manual</p>  <p>There is on the bottom packing case.</p>	1	<p>Refrigerant charge label</p>  <p>There is on the bottom packing case.</p>	1
<p>Drain plug (Heat pump-Models)</p>  <p>There is on the bottom packing case.</p>	1	<p>Reducer assy (Only 50 class)</p>  <p>The reducer assy is attached to the stop valve mounting plate inside the stop valve cover.</p>	1
<p>Screw bag (For fixing the wire retainer)</p>  <p>There is on the bottom packing case.</p>	1	<p><b>CAUTION</b></p> <p>Remove the reducer assy from the stop valve mounting plate before installing the outdoor unit regardless of whether the assy has been used.</p>	

## Precautions for Selecting the Location

- 1) Choose a place solid enough to bear the weight and vibration of the unit, where the operation noise will not be amplified.
- 2) Choose a location where the hot air discharged from the unit or the operation noise, will not cause a nuisance to the neighbors of the user.
- 3) Avoid places near a bedroom and the like, so that the operation noise will cause no trouble.
- 4) There must be sufficient spaces for carrying the unit into and out of the site.
- 5) There must be sufficient space for air passage and no obstructions around the air inlet and the air outlet.
- 6) The site must be free from the possibility of flammable gas leakage in a nearby place.  
Locate the unit so that the noise and the discharged hot air will not annoy the neighbors.
- 7) Install units, power cords and inter-unit cables at least 3 meter away from television and radio sets. This is to prevent interference to images and sounds. (Noises may be heard even if they are more than 3 meter away depending on radio wave conditions.)
- 8) In coastal areas or other places with salty atmosphere of sulfate gas, corrosion may shorten the life of the air conditioner.
- 9) Since drain flows out of the outdoor unit, do not place under the unit anything which must be kept away from moisture.


### NOTE:

Cannot be installed hanging from ceiling or stacked.

### CAUTION

When operating the air conditioner in a low outdoor ambient temperature, be sure to follow the instructions described below.

- 1) To prevent exposure to wind, install the outdoor unit with its suction side facing the wall.
- 2) Never install the outdoor unit at a site where the suction side may be exposed directly to wind.
- 3) To prevent exposure to wind, it is recommended to install a baffle plate on the air discharge side of the outdoor unit.
- 4) In heavy snowfall areas, select an installation site where the snow will not affect the unit.

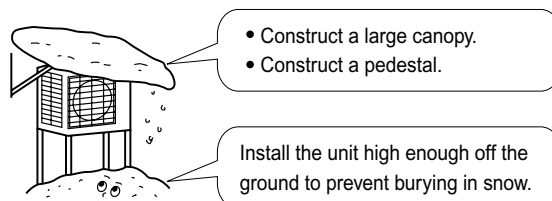


# Indoor/Outdoor Unit Installation Drawings

For installation of the indoor units, refer to the installation manual which was provided with the units.  
(The diagram shows a wall-mounted indoor unit.)

## ⚠ CAUTION

Do not connect the embedded branch piping and the outdoor unit when only carrying out piping work without connecting the indoor unit in order to add another indoor unit later.  
Make sure no dirt or moisture gets into either side of the embedded branch piping.  
See "Precautions for Laying Refrigerant Piping" on page 9 for details.

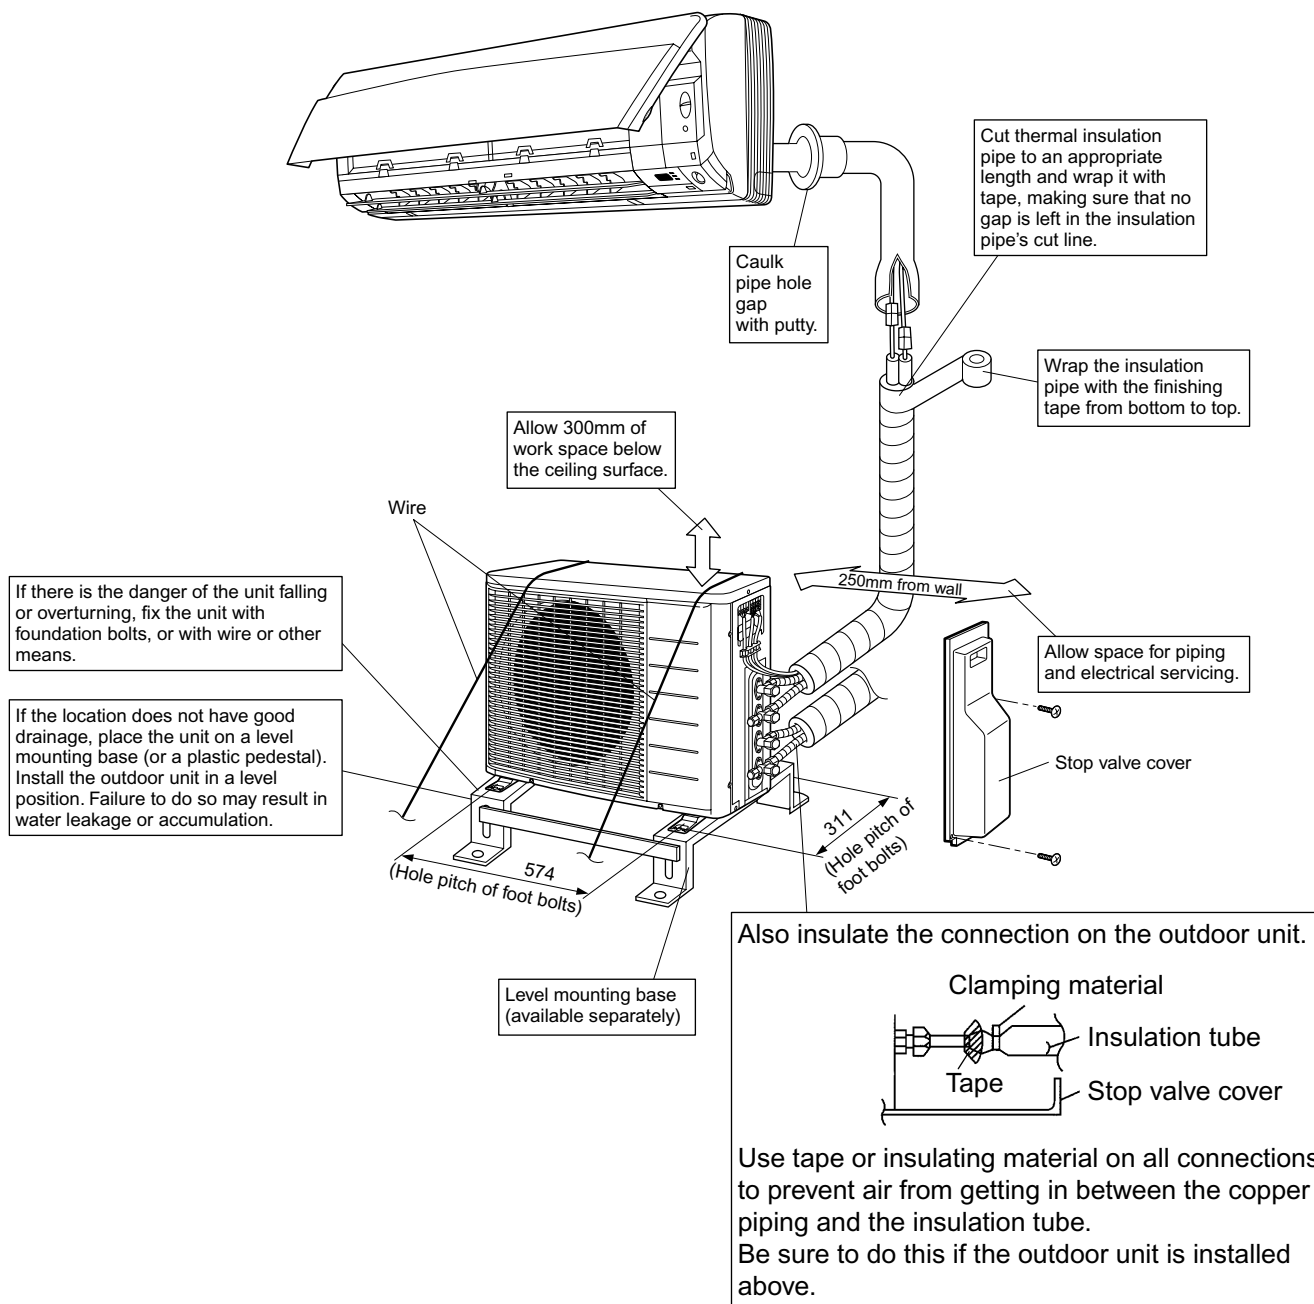

# Installation

- Install the unit horizontally.
- The unit may be installed directly on a concrete verandah or a solid place if drainage is good.
- If the vibration may possibly be transmitted to the building, use a vibration-proof rubber (field supply).

## 1. Connections (connection port)

Install the indoor unit according to the table below, which shows the relationship between the class of indoor unit and the corresponding port.

The total indoor unit class that can be connected to this unit:

### F Model

2MXS40F\* }  
2AMX40F\* } Up to 6.0kW  
2MKS40F\* }  
2AMK40F\* }

2MXS50F\* }  
2AMX50F\* } Up to 8.5kW  
2MKS50F\* }

2AMK50F\* — Up to 7.0kW

### G Model

2MXS40G\* } Up to 6.0kW  
2MKS40G\* }


2MXS50G\* } Up to 8.5kW  
2MKS50G\* }

Port	2MXS40F* 2MKS40F*	2AMX40F* 2AMK40F*	2MXS50F* 2MKS50F*	2AMX50F*	2AMK50F*	2MXS40G* 2MKS40G*	2MXS50G* 2MKS50G*
A	20, 25, 35		20, 25, 35		20, 25, 35	20, 25, 35	20, 25, 35, 42
B	20, 25, 35		(20), (25), (35), 50		(20), (25), (35)	20, 25, 35	(20), (25), (35), (42), 50

○ : Use a reducer to connect pipes.


Refer to "How to Use Reducers" for information on reducer numbers and their shapes.

## How to Use Reducers

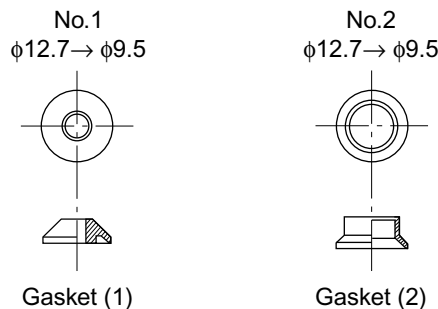

Use the reducers supplied with the unit as described below.

- Connecting a pipe of φ9.5 to a gas pipe connection port for φ12.7:

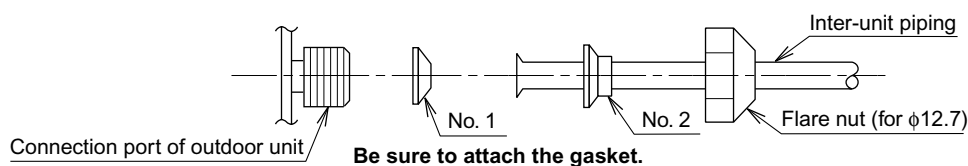


- When using the reducer packing shown above, be careful not to overtighten the nut, or the smaller pipe may be damaged. (about 2/3 - 1 the normal torque)
- Apply a coat of refrigeration oil to the threaded connection port of the outdoor unit where the flare nut comes in.
- Use an appropriate wrench to avoid damaging the connection thread by over-tightening the flare nut.

Flare nut tightening torque	
Flare nut for φ12.7	49.5–60.3N·m (505–615kgf·cm)

## Precautions on Installation


- Check the strength and level of the installation ground so that the unit will not cause any operating vibration or noise after installed.
- In accordance with the foundation drawing in fix the unit securely by means of the foundation bolts. (Prepare four sets of M8 or M10 foundation bolts, nuts and washers each which are available on the market.)
- It is best to screw in the foundation bolts until their length are 20mm from the foundation surface.




# Outdoor Unit Installation Guideline

- Where a wall or other obstacle is in the path of outdoor unit's intake or exhaust airflow, follow the installation guidelines below.
- For any of the below installation patterns, the wall height on the exhaust side should be 1200mm or less.


Wall facing one side

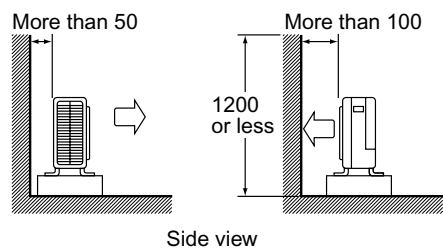

Walls facing two sides

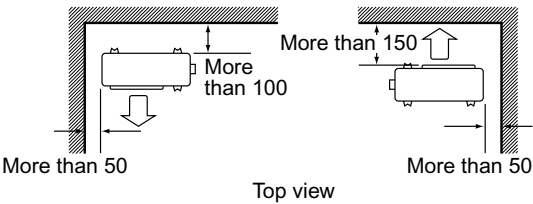

Walls facing three sides

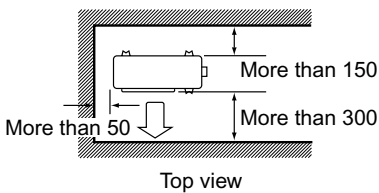


Unit: mm


## Selecting a Location for Installation of the Indoor Units

- The maximum allowable length of refrigerant piping, and the maximum allowable height difference between the outdoor and indoor units, are listed below.  
(The shorter the refrigerant piping, the better the performance. Connect so that the piping is as short as possible. **Shortest allowable length per room is 3m.**)

Piping to each indoor unit	20m max.
Total length of piping between all units	30m max.

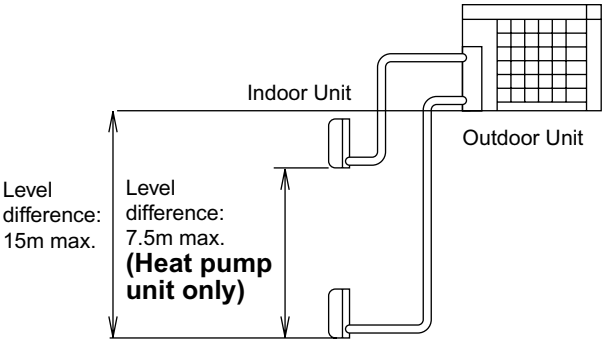

If the outdoor unit is positioned higher than the indoor units.

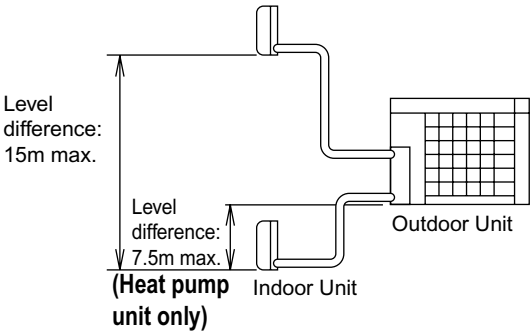

If the outdoor unit is positioned otherwise.  
(If lower than one or more indoor units.)


# Refrigerant Piping Work

## 1. Installing outdoor unit

- 1) When installing the outdoor unit, refer to "Precautions for Selecting the Location" on page 2 and the "Indoor/Outdoor Unit Installation Drawings" on page 3.
- 2) If drain work is necessary, follow the procedures below.

## 2. Drain work (Heat pump only)

- 1) Use drain plug for drainage.
- 2) If the drain port is covered by a mounting base or floor surface, place additional foot bases of at least 30mm in height under the outdoor unit's feet.
- 3) In cold areas, do not use a drain hose with the outdoor unit.  
(Otherwise, drain water may freeze, impairing heating performance.)




## 3. Refrigerant piping

### ⚠ CAUTION

- 1) Use the flare nut fixed to the main unit. (To prevent cracking of the flare nut by aged deterioration.)
- 2) To prevent gas leakage, apply refrigeration oil only to the inner surface of the flare. (Use refrigeration oil for R410A.)
- 3) Use torque wrenches when tightening the flare nuts to prevent damage to the flare nuts and gas leakage.

Align the centres of both flares and tighten the flare nuts 3 or 4 turns by hand. Then tighten them fully with the torque wrenches.

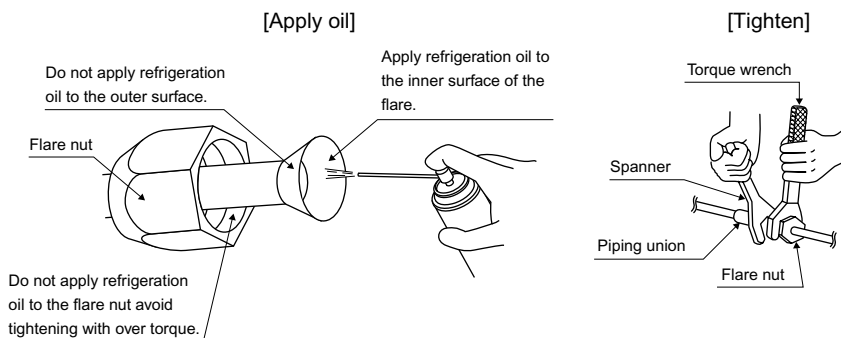

Flare nut tightening torque	
Flare nut for $\phi 6.4$	14.2-17.2N • m (144-175kgf • cm)
Flare nut for $\phi 9.5$	32.7-39.9N • m (333-407kgf • cm)
Flare nut for $\phi 12.7$	49.5-60.3N • m (505-615kgf • cm)

Valve cap tightening torque		
Gas side		Liquid side
3/8 inch	1/2 inch	1/4 inch
21.6-27.4N • m (220-280kgf • cm)	48.1-59.7N • m (490-610kgf • cm)	21.6-27.4N • m (220-280kgf • cm)
Service port cap tightening torque		10.8-14.7N • m (110-150kgf • cm)



# Refrigerant Piping Work

## 4. Purging air and checking gas leakage

### ⚠ WARNING

- 1) Do not mix any substance other than the specified refrigerant (R410A) into the refrigeration cycle.
- 2) When refrigerant gas leaks occur, ventilate the room as soon and as much as possible.
- 3) R410A, as well as other refrigerants, should always be recovered and never be released directly into the environment.
- 4) Be sure to check for gas leaks.

- Be sure to perform vacuum pumping for all the rooms at the same time.
- Be sure to use the special tools for the R410A (gauge manifold, charge hose, vacuum pump, vacuum pump adapter, etc.).
- Use a hexagonal wrench (4mm) to operate the stop valve rod.
- All refrigerant pipe joints should be tightened with a torque wrench at the specified tightening torque.

- 1) Connect the charge hose protrusions (the side for pushing the pin) for low pressure and high pressure on the gauge manifold to the gas stop valve service port for rooms **A and B**.



- 2) Fully open gauge manifold's low-pressure valve (Lo) and high-pressure valve (Hi).



- 3) Apply vacuum pumping for 20 minutes or longer. Check that the compound pressure gauge reads  $-0.1\text{MPa}$  ( $-76\text{cmHg}$ ).



- 4) After checking the vacuum, close the low pressure and high pressure valves on the gauge manifold and stop the vacuum pump. (Leave as is for 4-5 minutes and make sure the coupling meter needle does not go back. ) If it does go back, this may indicate the presence of moisture or leaking from connecting parts.  
After inspecting all the connection and loosening then retightening the nuts, repeat steps 2) → 3) → 4).



- 5) Remove the valve caps on the liquid and gas stop valves at the pipes for rooms A and B.




- 6) Open the valve rods on the liquid stop valves for rooms A and B by turning them  $90^\circ$  counterclockwise using a hex wrench. Close them 5 seconds later and check for gas leaks.  
After checking for gas leaks, check the areas around flares on the indoor unit, and the areas around flares and valve rods on the outdoor unit by applying soapy water.  
Wipe down thoroughly after the check is complete.



- 7) Remove the charge hose from the gas stop valve service ports at the pipes for rooms A and B and completely open the liquid and gas stop valves at the pipes for rooms A and B.  
(Stop the valve rods as far as they go and do not attempt to turn them any further.)



- 8) Use a torque wrench to tighten the valve caps and service port caps on the liquid and gas stop valves at the pipes for rooms A and B to the designated torque.

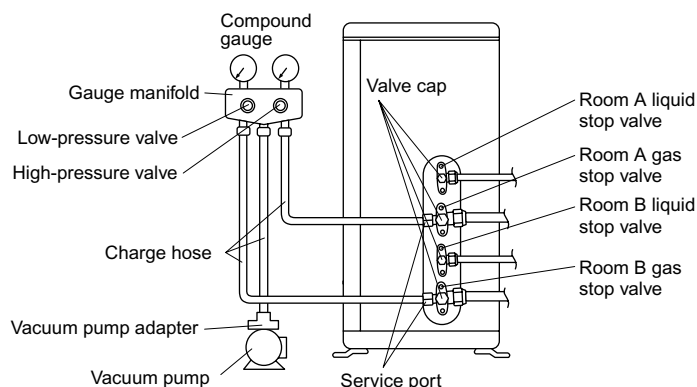

## 5. Refilling the refrigerant

Check the type of refrigerant to be used on the machine nameplate.


### Precautions when adding R410A

#### Fill from the liquid pipe in liquid form.

It is a mixed refrigerant, so adding it in gas form may cause the refrigerant composition to change, preventing normal operation.

- 1) Before filling, check whether the cylinder has a siphon attached or not. (It should have something like "liquid filling siphon attached" displayed on it.)

Filling a cylinder with an attached siphon



Stand the cylinder upright when filling.

(There is a siphon pipe inside, so the cylinder need not be upside-down to fill with liquid.)

Filling other cylinders



Turn the cylinder upside-down when filling.

- 2) Be sure to use the R410A tools to ensure pressure and to prevent foreign objects entering.

## 6. Charging with refrigerant

- If the total length of piping for all rooms exceeds 20m, additionally charge with **(R410A) 20g** of refrigerant for each additional meter of piping.

### Important information regarding the refrigerant used

This product contains fluorinated greenhouse gases covered by the Kyoto Protocol.

Do not vent gases into the atmosphere.

Refrigerant type: **R410A**

GWP<sup>(1)</sup> value: **1975**

<sup>(1)</sup> GWP = global warming potential

Please fill in with indelible ink,

- ① the factory refrigerant charge of the product,
- ② the additional refrigerant amount charged in the field and
- ①+② the total refrigerant charge

on the refrigerant charge label supplied with the product.

The filled out label must be adhered in the proximity of the product charging port (e.g. onto the inside of the stop valve cover).

Contains fluorinated greenhouse gases covered by the Kyoto Protocol

**R410A**

① =  kg

② =  kg

①+② =  kg

6 5

1 factory refrigerant charge of the product: see unit name plate

2 additional refrigerant amount charged in the field

3 total refrigerant charge

4 Contains fluorinated greenhouse gases covered by the Kyoto Protocol

5 outdoor unit

6 refrigerant cylinder and manifold for charging

### ⚠ CAUTION

- 1) Even though the stop valve is fully closed, the refrigerant may slowly leak out; do not leave the flare nut removed for a long period of time.
- 2) Do not overfill with refrigerant. This will break the compressor.

# Refrigerant Piping Work

## Precautions for Laying Refrigerant Piping

### • Cautions on pipe handling

- 1) Protect the open end of the pipe against dust and moisture.
- 2) All pipe bends should be as gentle as possible. Use a pipe bender for bending. (Bending radius should be 30 to 40mm or larger.)

### • Selection of copper and heat insulation materials

When using commercial copper pipes and fittings, observe the following:

- 1) Insulation material: Polyethylene foam

Heat transfer rate: 0.041 to 0.052W/mK (0.035 to 0.045kcal/mh°C)

Refrigerant gas pipe's surface temperature reaches 110°C max.

Choose heat insulation materials that will withstand this temperature.




- 2) Be sure to insulate both the gas and liquid piping and to provide insulation dimensions as below.

Gas pipe	Gas pipe insulation
O.D.: 9.5mm, 12.7mm / Thickness:0.8mm	I.D.: 12 – 15mm / Thickness:13mm min.
Liquid pipe	Liquid pipe insulation
O.D.: 6.4mm / Thickness:0.8mm	I.D.: 8 – 10mm / Thickness:10mm min.


- 3) Use separate thermal insulation pipes for gas and liquid refrigerant pipes.

### • Flaring the pipe end

- 1) Cut the pipe end with a pipe cutter.
- 2) Remove burrs with the cut surface facing downward so that the chips do not enter the pipe.
- 3) Put the flare nut on the pipe.
- 4) Flare the pipe.
- 5) Check that the flaring is properly made.

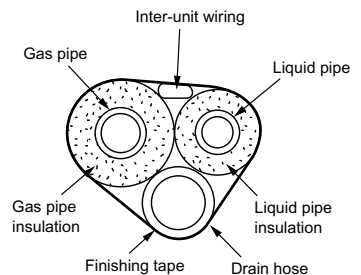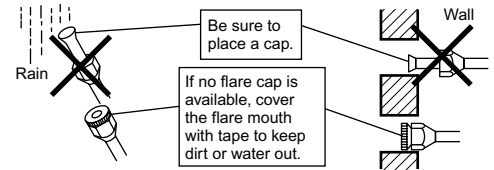

Flaring			
Set exactly at the position shown below.			
	Flare tool for R410A	Conventional flare tool	
	Clutch-type	Clutch-type (Rigid-type)	Wing-nut type (Imperial-type)
A	0-0.5mm	1.0-1.5mm	1.5-2.0mm

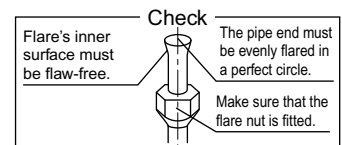


## ⚠ WARNING

- 1) Do not use mineral oil on flared part.
- 2) Prevent mineral oil from getting into the system as this would reduce the lifetime of the units.
- 3) Never use piping which has been used for previous installations. Only use parts which are delivered with the unit.
- 4) Do never install a drier to this R410A unit in order to guarantee its lifetime.
- 5) The drying material may dissolve and damage the system.
- 6) Incomplete flaring may cause refrigerant gas leakage.

# Pump Down Operation

In order to protect the environment, be sure to pump down when relocating or disposing of the unit.

- 1) Remove the valve caps on the liquid and the gas stop valves at the pipes for rooms A and B.
- 2) Run the unit on forced cooling. (Refer to the below.)
- 3) After 5 to 10 minutes, close the liquid stop valves at the pipes for rooms A and B using a hex wrench.
- 4) After 2 to 3 minutes, stop the forced cooling operation as quickly as possible after the gas stop valves at the pipes for rooms A and B have been shut off.
- 5) Turn the power breaker off.

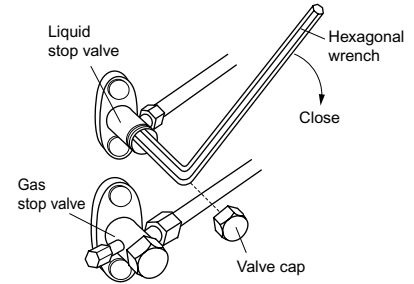

## ⚠ CAUTION

Run the air conditioner to cool both rooms A and B when performing a pump down.

## 1. Forced cooling operation

### 1-1. Using the indoor unit start/stop button.

- 1) Press the start/stop button on the indoor unit in either room A or B for 5 seconds continuously. The units in both rooms will start.
- 2) Forced cooling operation will end after around 15 minutes and the unit will stop automatically. Press the start/stop button on the indoor unit to force the operation to stop.
- 3) **Use this method to force cooling operation when the outside temperature is 10°C or lower.**

### 1-2. Using the wireless remote controller.

- 1) Select cooling operation and press the start/stop button. (The unit will start.)
- 2) Press the temperature ▲ button, ▼ button, and the "mode" button at the same time.
- 3) Press the "mode" button twice. (7° will be displayed and the unit will go into test-run mode.)
- 4) Test-run mode will end after around 30 minutes and the unit will stop automatically. Press the start/stop button to force the test-run to stop.

## ⚠ CAUTION

If the outside temperature is 10°C or lower, the safety device might start, preventing operation. In this situation, warm the outside temperature thermistor on the outdoor unit to 10°C or warmer. Operation will start.


# Wiring

## ⚠ WARNING

- 1) Do not use tapped wires, stranded wires (**CAUTION 1**)), extensioncords, or starburst connections, as they may cause overheating, electrical shock, or fire.
- 2) Do not use locally purchased electrical parts inside the product. (Do not branch the power for the drain pump, etc., from the terminal block.) Doing so may cause electric shock or fire.
- 3) Be sure to install an earth leakage breaker. (One that can handle higher harmonics.)  
(This unit uses an inverter, which means that it must be used an earth leakage breaker capable handling harmonics in order to prevent malfunctioning of the earth leakage breaker itself.)
- 4) Use an all-pole disconnection type breaker with at least 3mm between the contact point gaps.


- Do not turn ON the safety breaker until all work is completed.

- 1) Strip the insulation from the wire (20mm).
- 2) Connect the connection wires between the indoor and outdoor units **so that the terminal numbers match**. Tighten the terminal screws securely. We recommend a flathead screwdriver be used to tighten the screws. The screws are packed with the terminal board.

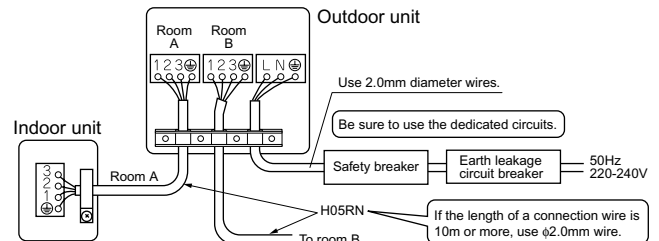


## ⚠ CAUTION


- 1) In case using stranded wires is unavoidable for some reason, make sure to install the round crimp-style terminals on the tip. Place the round crimp-style terminals on the wires up to the covered part and secure in place.



- 2) When connecting the connection wires to the terminal board using a single core wire, be sure to perform curling. Problems with the work may cause heat and fires.

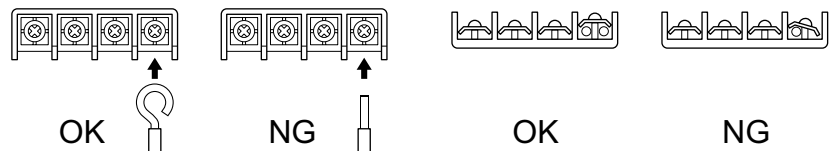


- 3) Pull the wire and make sure that it does not disconnect. Then fix the wire in place with a wire retainer.

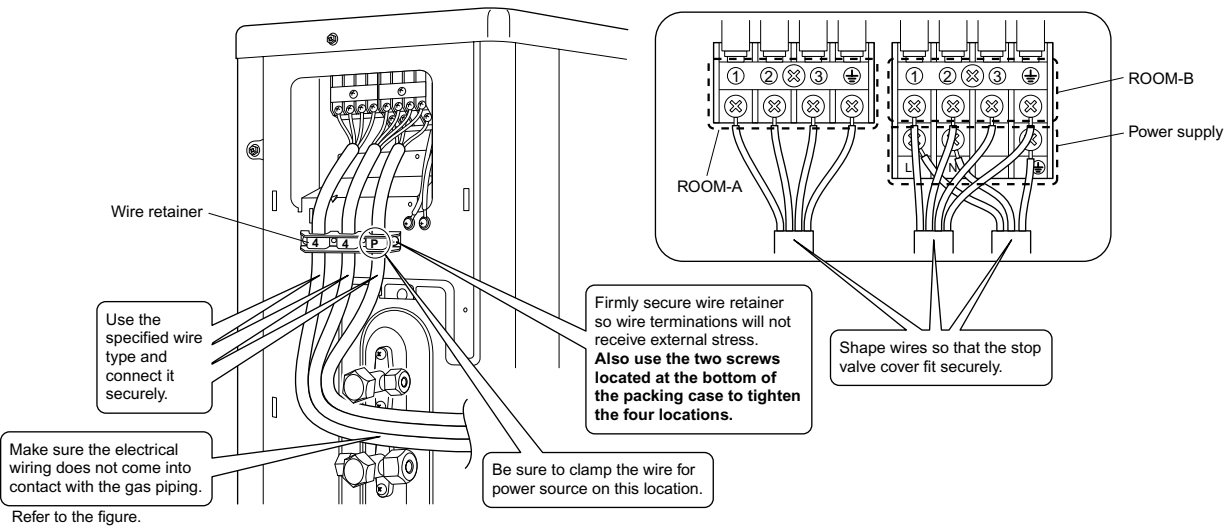


Make sure connecting the piping and connecting wiring fit into .

(Incorrect handling will make it hard to attach the stop valve cover, causing deformation.)



### Make absolutely sure all wiring is correct.

Make sure the wiring and piping from the indoor unit to the outdoor unit match.

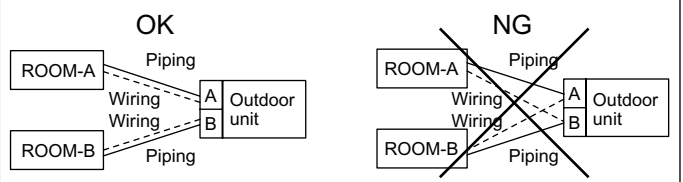

# Maximum Power Input Limitation Setting

## **⚠ WARNING**


Always shut off the power supply breaker before starting.

- The Maximum Power Input Limitation needs to be set when the unit is installed.
- This function limits the power input of the unit to 1700W.
- It is recommended for locations with low-capacity circuit breakers.

## **⚠ CAUTION**

This function is only for the 2MKS40, 2AMK40, 2MKS50 and 2AMK50.

- Set as follows.
  - 1) Remove the two screws on the side and remove the top plate of the outdoor unit.
  - 2) Remove one screw from the upper electric box cover.
  - 3) Remove the upper electric box cover by sliding it, being careful not to bend the electric box hook.
  - 4) Remove the lower electric box cover.
  - 5) Cut the jumper (J4) of the PCB inside.
  - 6) Go back through step 4) → 3) → 2) → 1). Make sure all components are well secured when doing this.

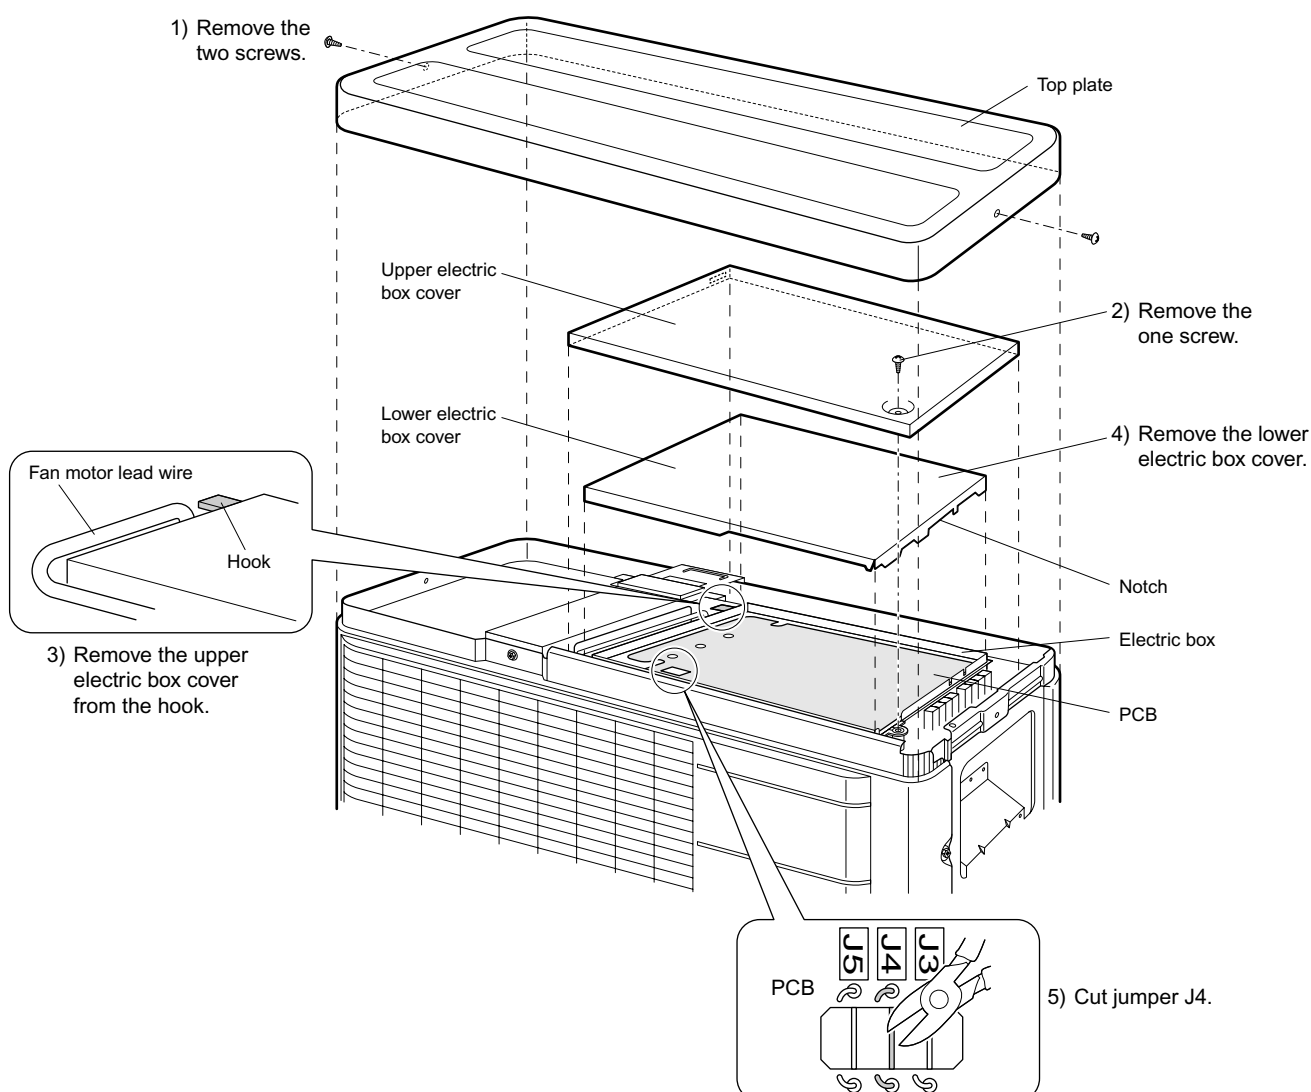

## **⚠ CAUTION**

- When removing the upper electric box cover, be careful not to bend the hook.
- When returning the lower electric box cover, return the notch to the stop valve side.
- When returning the upper electric box cover, be careful not to pinch the fan motor lead wire.


# ECONO Mode Prohibition Setting

## WARNING

Always shut off the power supply breaker before starting.

- This setting disables the input control signal from the remote controller.
- Use this setting when you wish to block reception of input controls (cooling/heating) from indoor unit remote controllers.
- Set as follows.

- 1) Remove the two screws on the side and remove the top plate of the outdoor unit.
- 2) Remove one screw from the upper electric box cover.
- 3) Remove the upper electric box cover by sliding it, being careful not to bend the electric box hook.
- 4) Remove the lower electric box cover.
- 5) Cut the jumper (J3) of the PCB inside.
- 6) Go back through step 4) → 3) → 2) → 1). Make sure all components are well secured when doing this.

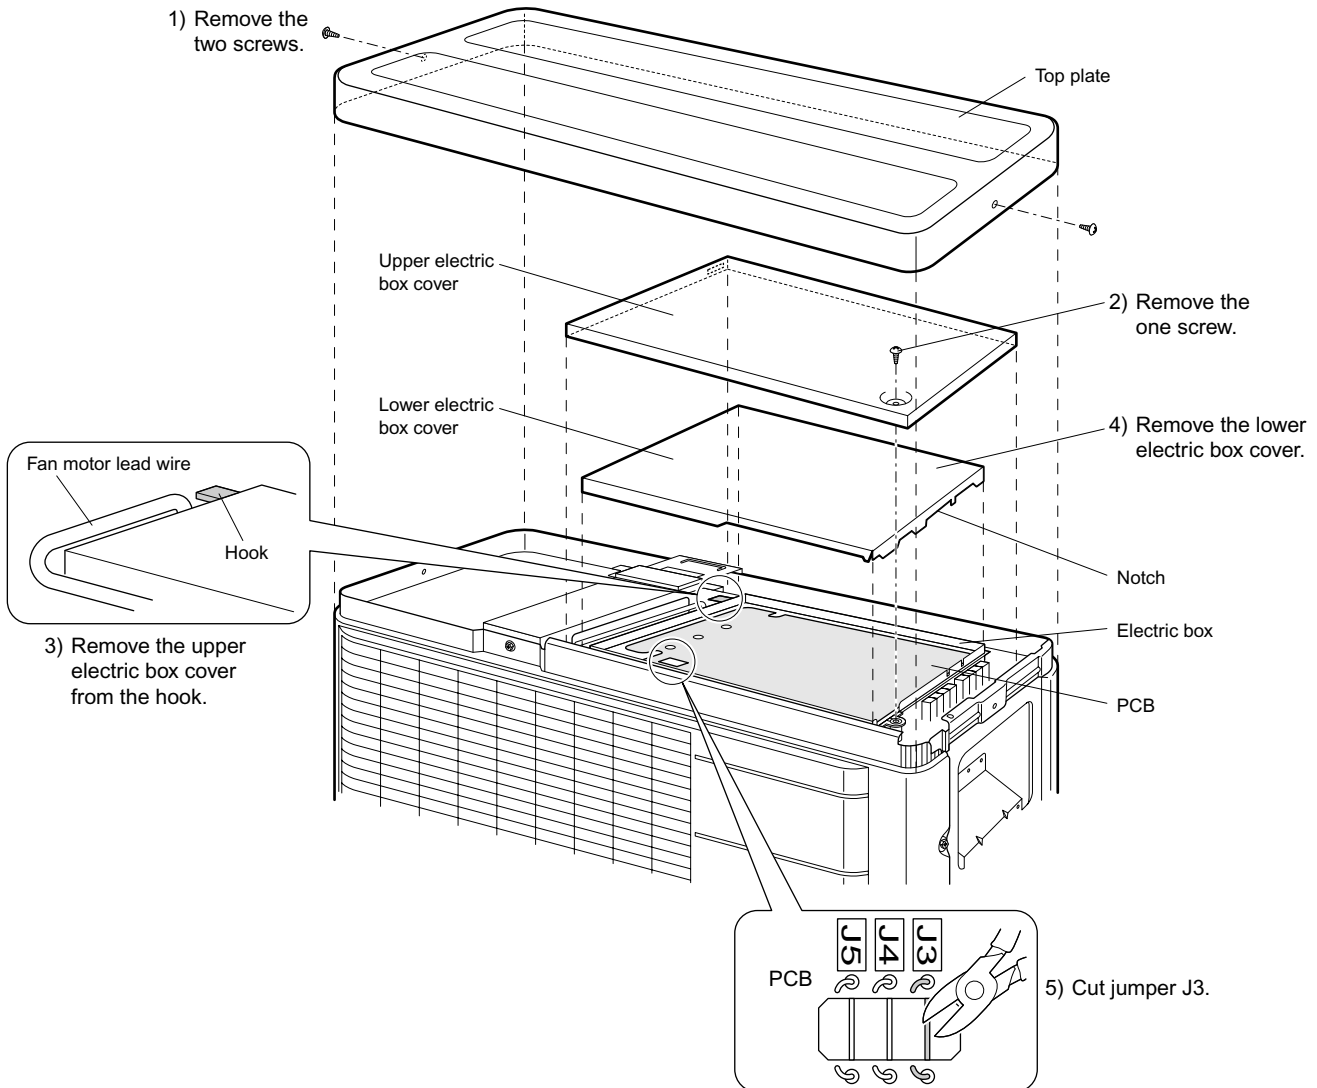

## CAUTION

- When removing the upper electric box cover, be careful not to bend the hook.
- When returning the lower electric box cover, return the notch to the stop valve side.
- When returning the upper electric box cover, be careful not to pinch the fan motor lead wire.

# Test Run and Final Check

- Before starting the test run, measure the voltage at the primary side of the safety breaker.
- Check that all liquid and gas stop valves are fully open.
- Check that piping and wiring all match.

## 1. Test run and final check

- 1) To test cooling, set for the lowest temperature. To test heating, set for the highest temperature. (Depending on the room temperature, only heating or cooling (but not both) may be possible.)
- 2) After the unit is stopped, it will not start again (heating or cooling) for approximately 3 minutes.
- 3) During the test run, first check the operation of each unit individually. Then also check the simultaneous operation of all indoor units.  
Check both heating and cooling operation.
- 4) After running the unit for approximately 20 minutes, measure the temperatures at the indoor unit inlet and outlet. If the measurements are above the values shown in the table below, then they are normal.

	Cooling	Heating
Temperature difference between inlet and outlet	Approx. 8°C	Approx. 15°C

(When running in one room)

- 5) During cooling operation, frost may form on the gas stop valve or other parts. This is normal.
- 6) Operate the indoor units in accordance with the included operation manual. Check that they operate normally.

## 2. Items to check

Check item	Consequences of trouble	Check
Are the indoor units installed securely?	Falling, vibration, noise	
Has an inspection been made to check for gas leakage?	No cooling, no heating	
Has complete thermal insulation been done (gas pipes, liquid pipes, indoor portions of the drain hose extension)?	Water leakage	
Is the drainage secure?	Water leakage	
Are the ground wire connections secure?	Danger in the event of a ground fault	
Are the electric wires connected correctly?	No cooling, no heating	
Is the wiring in accordance with the specifications?	Operation failure, burning	
Are the inlets/outlets of the indoor and outdoor units free of any obstructions? Are the stop valves open?	No cooling, no heating	
Do the marks match (room A, room B) on the wiring and piping for each indoor unit?	No cooling, no heating	

### ■ ATTENTION

- 1) Have the customer actually operate the unit while looking at the manual included with the indoor unit. Instruct the customer how to operate the unit correctly (particularly cleaning of the air filters, operation procedures, and temperature adjustment).
- 2) Even when the air conditioner is not operating, it consumes some electric power. If the customer is not going to use the unit soon after it is installed, turn OFF the breaker to avoid wasting electricity.
- 3) If additional refrigerant has been charged because of long piping, list the amount added on the nameplate on the reverse side of the stop valve cover.



**DAIKIN INDUSTRIES, LTD.**

Head office:

Umeda Center Bldg., 2-4-12, Nakazaki-Nishi,  
Kita-ku, Osaka, 530-8323 Japan

Tokyo office:

JR Shinagawa East Bldg., 2-18-1, Konan,  
Minato-ku, Tokyo, 108-0075 Japan  
[http://www.daikin.com/global\\_ac/](http://www.daikin.com/global_ac/)

**DAIKIN EUROPE NV**

Zandvoordestraat 300, B-8400 Oostende, Belgium



Two-dimensional bar code is a code  
for manufacturing.

3P190021-2D M06B255B (0711) HT