



# Air Conditioning Technical Data

Wall mounted unit



EEEN15-100

FAQ-C



# TABLE OF CONTENTS

## FAQ-C

1	Features .....	2
2	Specifications .....	3
	Technical Specifications .....	3
	Electrical Specifications .....	3
3	Safety device settings .....	5
4	Options .....	6
5	Dimensional drawings .....	7
6	Piping diagrams .....	8
7	Wiring diagrams .....	9
	Wiring Diagrams - Single Phase .....	9
8	External connection diagrams .....	10
9	Sound data .....	11
	Sound Pressure Spectrum .....	11

# 1 Features

## For rooms with no false ceilings nor free floor space

- Flat, stylish front panel blends easily within any interior décor and is more easy to clean
- Can easily be installed in both new and refurbishment projects
- Reduced energy consumption thanks to specially developed DC fan motor
- The air is comfortably spread up and downwards thanks to 5 different discharge angles that can be programmed via the remote control
- Maintenance operations can be performed easily from the front of the unit
- No optional adapter needed for DIII-connection, link your unit into the wider building management system.



Home leave operation



Fan only



Auto cooling-heating changeover



Vertical auto swing



Fan speed steps



Dry programme



Air filter



Weekly timer



Infrared remote control



Wired remote control



Centralised control



Auto-restart



Self diagnosis



Drain pump kit



Twin/triple/double twin application

## 2 Specifications

2-1 Technical Specifications					FAQ71C		FAQ100C		*FAQ125C	
Power input	Cooling	Nom.	kW		0.051		0.061		-	
	Heating	Nom.	kW		0.068		0.061		-	
Casing	Colour				Fresh White				-	
	Material				Resin				-	
Dimensions	Unit	Height/Width/Depth	mm		290/1,050/238		340/1,200/240		340/1,200/240	
	Packed unit	Height/Width/Depth	mm		366/1,147/337		429/1,310/325		-/-/-	
Weight	Unit		kg		13		17		17	
	Packed unit		kg		19		24		-	
Heat exchanger	Length		mm		863		963		-	
	Rows	Quantity			2				-	
	Fin pitch		mm		1.2				-	
	Passes	Quantity			4		6		-	
	Face area		m²		0.279		0.347		-	
	Stages	Quantity			18		20		-	
	Empty tubeplate hole	Quantity			0				-	
	Fin	Type			Cross fin coil (Multi slit fins and Hi-XB tubes)				-	
Fan	Type				Cross flow fan				-	
	Quantity				1				-	
	Air flow rate	Cooling	High	m³/min	18		26		-	
			Nom.	m³/min	16		23		-	
			Low	m³/min	14		19		-	
		Heating	High	m³/min	18		26		-	
			Nom.	m³/min	16		23		-	
			Low	m³/min	14		19		-	
Fan motor	Model				QCL9663MA		QCL1096M		-	
	Speed	Steps			3				-	
	Output	High		W	48		64		-	
	Phase x Voltage			V	DC310		DC325		-	
	Full load amps (FLA)	Cooling	A		0.3		0.4		-	
		Heating	A		0.4				-	
Sound power level	Cooling		dBA		61		65		-	
	Heating		dBA		61		65		-	
Sound pressure level	Cooling	High/Nom./Low		dBA	45/42/40		49/45/41		-/-/-	
	Heating	High/Nom./Low		dBA	45/42/40		49/45/41		-/-/-	
Control systems	Infrared remote control				BRC7EB518				-	
	Wired remote control				BRC1D52 / BRC1E52A/B				-	
Refrigerant	Type				R-410A				-	
Piping connections	Liquid	Type/OD	mm		Flare connection/9.52				/-	
	Gas	Type/OD	mm		Flare connection/15.9				/-	
	Drain				VP13 (I.D. 13/O.D. 18)				-	
	Heat insulation				Foamed polystyrene / Foamed polyethylene				-	

Standard Accessories : Installation and operation manual; Quantity : 1;

Standard Accessories : Installation panel;

Standard Accessories : Insulation tape;

Standard Accessories : Screws;

Standard Accessories : Clamps;

Standard Accessories : Screw cover;

2-2 Electrical Specifications				FAQ71C	FAQ100C	*FAQ125C
Power supply	Phase	1~				1~
	Frequency		Hz	50/60		50/60
	Voltage		V	220-240/220		220-240/220

# 3 Safety device settings

## 3 - 1 Safety Device Settings

### FAQ71-100C

Safety devices		71	100
FAQ~CVEB	Fuse	—	—
	Fan motor thermal fuse (°C)	—	—
	Fan motor thermal protector (°C)	—	—

DU423-9101P

## 4 Options

### 4 - 1 Options

#### FAQ71-100C

Item			Type	FAQ71CVEB	FAQ100CVEB
Remote controller	Infrared	H/P		BRC7EB518	
		C/O		BRC7EB519	
	Wired		BRC1E52A7, BRC1E51A7,BRC1D528		
Wiring adapter for electrical appendices (2)				*KRP4AA51	
Installation box for adapter PCB.				Note 1 KRP4AA93	
Central remote controller				DCS302CA51	
Electrical box with earth terminal (3 blocks)				KJB311AA	
Unified ON/OFF controller				DCS301BA51	
Electrical box with earth terminal (2 blocks)				KJB212AA	
Noise filter (for electromagnetic interface use only)				KEK26-1A	
Schedule timer				DST301BA51	
Remote sensor				KRCS01-4B	
Drain up kit				K-KDU572EVE	
I-touch controller				DCS601C51	

#### Notes:

1. Installation box (No. 6) is necessary for each adapter marked.\*

3D044482F






## 6 Piping diagrams

### 6 - 1 Piping Diagrams

#### FAQ71-100C

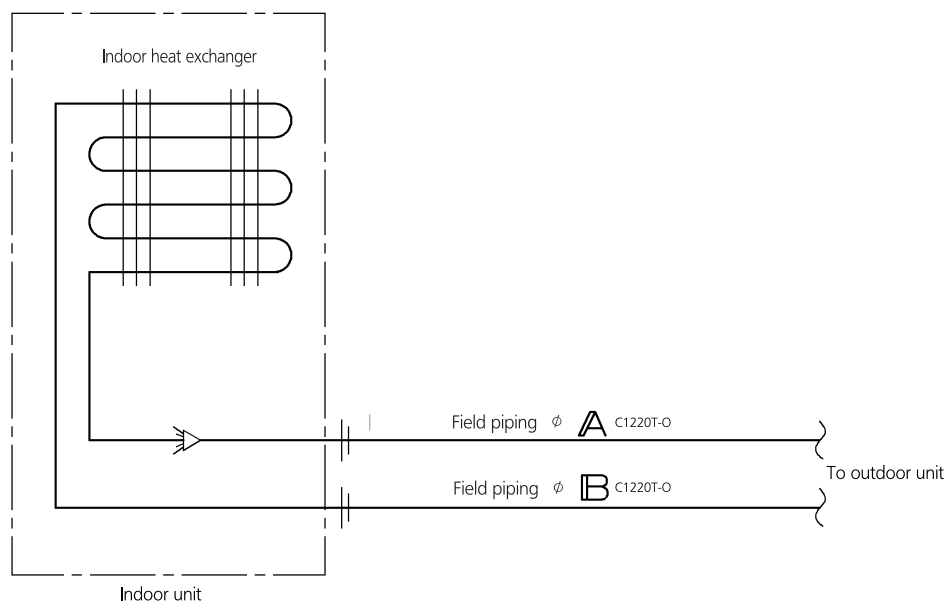

Model	A	B
FAQ71, 100C	9.5	15.9


4D037995V

## 7 Wiring diagrams

### 7 - 1 Wiring Diagrams - Single Phase


#### FAQ71-100C

Indoor unit	
A1P	Printed circuit board
C105	Capacitor
HAP	Flashing lamp (service monitor-green)
M1F	Motor (indoor fan)
M1S	Motor (swing flap)
M2S	Motor (swing flap)
R1T	Thermistor (air)
R2T-R3T	Thermistor (coil)
SS1	Selector switch (emergency)
V1R	Diode bridge
X1M	Terminal block (Remote controller)
X2M	Terminal block (Transmission wiring)
Z1C	Ferrite core (Noise filter)
Z1P	Noise filter
PS	Switching power supply
RC	Signal receiver circuit
TC	Signal transmission circuit
Infrared remote controller (Receiver/display unit)	
A2P	Printed circuit board
A3P	Printed circuit board
BS1	Push button switch (On/Off)
H1P	Pilot lamp (ON-Red)
H2P	Pilot lamp (Timer-Green)
H3P	Pilot lamp (Filter sign-Red)
H4P	Pilot lamp (Defrost-Orange)
SS1	Selector switch (main/sub)
SS2	Selector switch (wireless address set)
Wired remote controller	
R1T	Thermistor (air)
Connector for optional parts	
X15A	Connector (float switch)
X24A	Connector (Infrared remote controller)
X35A	Connector (Power supply for adapter)

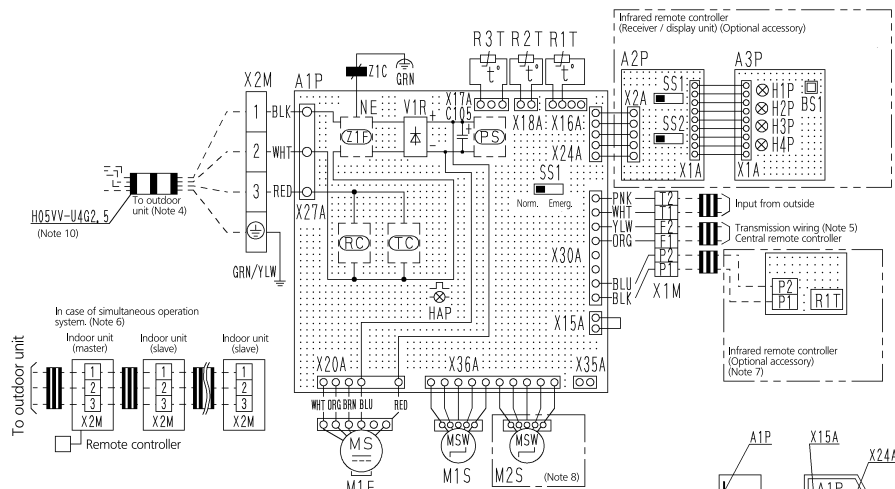

#### Notes

1. : Terminal block : Connector : Short circuit connector
2. : Field wiring
3. In case of simultaneous operation indoor unit system, See the indoor unit wiring only.
4. For the detail, see wiring diagram attached to outdoor unit.
5. In case using central remote controller, connect it to the unit in accordance with the attached installation manual.
6. In case of connection units varies according to the combination system, confirm engineering guide and catalogs, etc, before connecting.
7. In case of main/sub changeover, see the installation manual attached to remote controller.
8. M2S is 100 only.
9. Symbols shows as follows: BLK:Black RED:Red BLU:Blue WHT:White PNK:Pink YLW:Yellow GRN:Green GRN:Green ORG:Orange BRN:Brown
10. Shows only in case of protected pipes, use HO7RN-F in case of no protection.




Control box

3D073235B



## 8 External connection diagrams

### 8 - 1 External Connection Diagrams
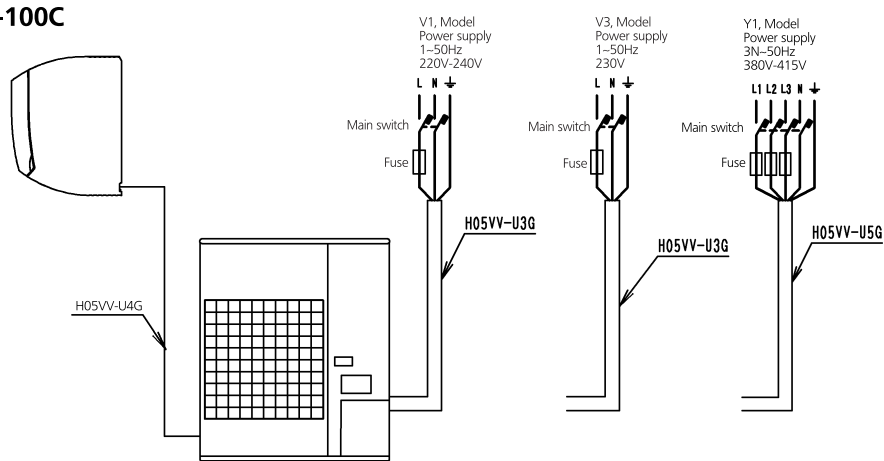
#### FAQ71-100C



#### NOTES


- 1  Line voltage wiring
- 2  Control circuit wiring
- 3 All wiring, components and materials to be produced on the site must comply with the applicable local and national codes.
- 4 Use copper conductor only.
- 5 As for details, see wiring diagrams.
- 6 Install fuse and mainswitch for safety.
- 7 All field wiring and components must be provided by a licensed electrician.
- 8 Unit shall be grounded in compliance with the applicable local and national codes.
- 9 Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
- 9 Never share a common power source with other equipment.

4D044475D

# 9 Sound data

## 9 - 1 Sound Pressure Spectrum

FAQ71C

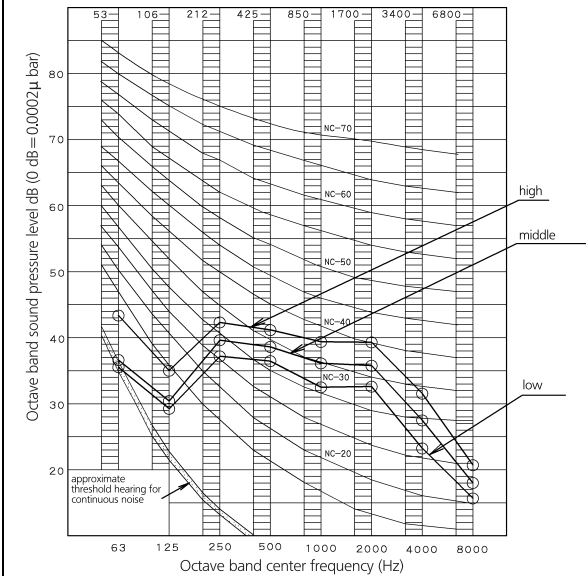

### NOTES


Overall (dB)	230V			Power level (dB)	230V		
	high	middle	low		high	middle	low
A	45	42	40	B (G/N is already rectified)	61	58	56
C	48	45	43				

- Measuring place: Anechoic chamber
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source: 230V 50Hz
- Cooling: Return air temperature: 27°C DB, 19°C WB  
Outdoor temperature: 35°C DB, 24°C WB
- Heating: Return air temperature: 20°C DB, 15°C WB  
Outdoor temperature: 7°C DB, 6°C WB
- Location of microphone



4D073843

FAQ100C

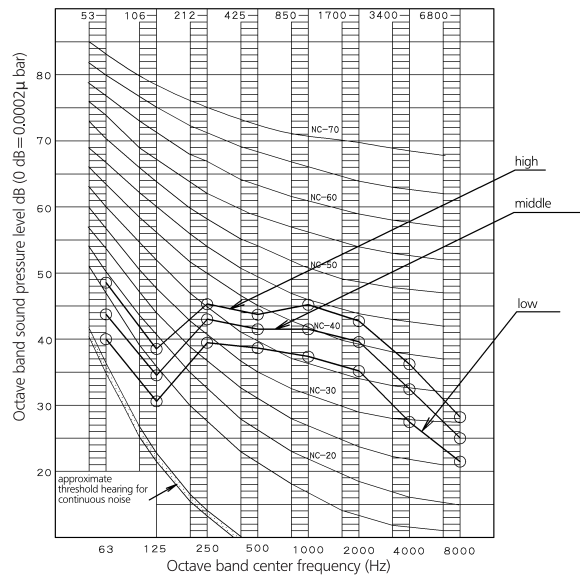

### NOTES

Overall (dB)	230V			Power level (dB)	230V		
	high	middle	low		high	middle	low
A	49	45	41	B (G/N is already rectified)	65	62	58
C	52.5	48	44.5				

- Measuring place: Anechoic chamber
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source: 230V 50Hz
- Cooling: Return air temperature: 27°C DB, 19°C WB  
Outdoor temperature: 35°C DB, 24°C WB
- Heating: Return air temperature: 20°C DB, 15°C WB  
Outdoor temperature: 7°C DB, 6°C WB
- Location of microphone



4D073844





Daikin Europe N.V. participates in the Eurovent Certification programme for Liquid Chilling Packages (LCP), Air handling units (AHU), Fan coil units (FCU) and variable refrigerant flow systems (VRF) Check ongoing validity of certificate online: [www.eurovent-certification.com](http://www.eurovent-certification.com) or using: [www.certiflash.com](http://www.certiflash.com)

The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.

BARCODE

Daikin products are distributed by: