




INSTALLATION MANUAL

R410A Split Series

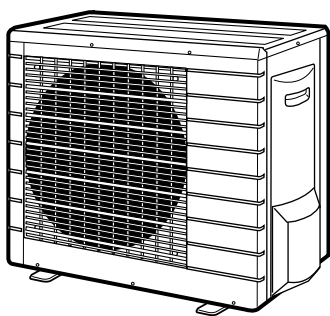

Models

RXS50E2V1B	RKS50E2V1B
RXS60E2V1B	RKS60E2V1B
RXS71E2V1B	RKS71E2V1B
RYN50E2V1B	RYN60E2V1B
RN50E2V1B	RN60E2V1B
ARXS50E2V1B	

Installation manual
R410A Split series

English

Installationsanleitung
Split-Baureihe R410A

Deutsch

Manuel d'installation
Série split R410A

Français

Montagehandleiding
R410A Split-systeem

Nederlands

Manual de instalación
Serie Split R410A

Español

Manuale d'installazione
Serie Multiambienti R410A

Italiano

Εγχειρίδιο εγκατάστασης
διαιρούμενης σειράς R410A

Ελληνικά

Manual de Instalação
Série split R410A

Portugues

Руководство по монтажу
Серия R410A с раздельной установкой

Русский

Montaj kılavuzları
R410A Split serisi

Türkçe

CE - DECLARATION-OF-COMFORMITY
CE - KONFORMITÄTSERKLÄRUNG
CE - DECLARATION-DE-CONFORMITE
CE - CONFORMITEITS/VERKLARING

CE - DECLARACION-DE-CONFORMIDAD
CE - DICHIARAZIONE-DI-CONFORMITA
CE - ΔΗΛΩΣΗ ΣΥΜΜΟΡΦΩΣΗΣ

CE - DECLARAÇÃO-DE-CONFORMIDADE
CE - ЗАРЯВЛЕНИЕ-О-СООТВЕТСТВИИ
CE - ÖPFEJDELSESRÖKLERING
CE - FÖRSÄKRAN-OM-ÖVERENSSTÄMMELSE

CE - IZJAVA-O-USKLADNOSTI
CE - ILMOITUS-YHDENMUKAISUDESTA
CE - PROHLÁŠENÍ-O-SHOĐE

CE - IZJAVA-O-USKLADNOSTI
CE - MEGFELELŐSÉGI-NYILATKOZAT
CE - DEKLARACIJA-ZGODNOSTI
CE - DECLARAȚIE-DE-CONFORMITATE

CE - АТІКІТІЄС-ДЕКЛАРАЦІЯ
CE - АТІБІЛІТІБАС-ДЕКЛАРАЦІЯ
CE - УҮҮЛМІЛҮЛҮК-БІЛДІРІСІ

DAIKIN INDUSTRIES, LTD.

01 declares under its sole responsibility that the air conditioning models to which this declaration relates:
02 erklärt auf seine alleinige Verantwortung daß die Modelle der Klimaanlage für die diese Erklärung bestimmt ist:
03 déclare sous sa seule responsabilité que les appareils d'air conditionné visés par la présente déclaration:

04 verklaart hierbij op eigen exclusieve verantwoordelijkheid dat de airconditioning units waarop deze verklaring betrekking heeft:
05 declara bajo su única responsabilidad que los modelos de aire acondicionado a los cuales hace referencia la declaración:
06 dichiara sotto sua responsabilità che i condizionatori modello a cui è riferita questa dichiarazione:
07 δηλώνει με αποκλειστική της ευθύνη ότι τα προεβλάν τα κλιματιστικών ομακεών στο οποίο αναφέρεται η παρούσα δήλωση;
08 заявляє про свою виключну відповідальність, що моделі кондиціонерів повітря, до яких відноситься це заявлення;
09 заявляет, исключительнo под свою ответственность, что модели кондиционеров воздуха, к которым относятся настоящее заявление;

RXS50E2V1B, RXS60E2V1B, RXS71E2V1B, RKS50E2V1B, RKS60E2V1B, RKS71E2V1B, RKS71E2V1B, ARXS50E2V1B, RYN50E2V1B, RYN60E2V1B, RNS0E2V1B, RN60E2V1B

01 are in conformity with the following standard(s) or other normative document(s), provided that these are used in accordance with our instructions:
02 der/den folgenden Norm(en) oder einem anderen Normdokument oder -dokumenten entspricht/entsprechen, unter der Voraussetzung, daß sie gemäß unseren Anweisungen eingesetzt werden:

03 sont conformes à l(au)x norm(e)s ou autre(s) document(s) normatif(s), pour autant qu'ils soient utilisés conformément à nos instructions:
04 conform de volgende norm(en) of één of meer andere oriënde documenten zijn, op voorwaarde dat ze worden gebruikt overeenkomstig onze instructies:
05 están en conformidad con la(s) siguiente(s) norma(s) u otro(s) documento(s) normativo(s), siempre que sean utilizados de acuerdo con nuestras instrucciones:
06 sono conformi all(i) seguente(i) standard(i) o altro(i) documento(i) a carattere normativo, a patto che vengano usati in conformità alle nostre istruzioni:

07 είναι σύμφωνα με το(α) ακόλουθ(α) πρότυπο(α) ή άλλο(ν) έγγραφο(α) κανονιστών, υπό την προϋπόθεση ότι χρησιμοποιούνται σύμφωνα με τις οδηγίες μας:

EN60335-2-40,

01 following the provisions of:
02 gemäß den Vorschriften der:
03 conformément aux stipulations des:
04 overeenkomstig de bepalingen van:
05 siguiendo las disposiciones de:
06 secondo le prescrizioni per:
07 je tipično priporočam tuje:
08 de acordo com o previsto em:
09 в соответствии с положениями:

10 onder ingaafgeleide af bestemmelse(n) i:
11 enligt villkoren i:
12 gilt i henhold til bestemmelserne i:
13oudaitaan määräykksiä:
14za dodržení ustanovení předpisu:
15 prema odredbama:
16 követi az(i):
17 zgodnie z postanowieniami Dyrektyw:
18 in urma prevederilor:

01 Note * as set out in the Technical Construction File Dalkin.TCF.020 and judged positively by KEIMA according to the Certificate 95951-KRQECMC9-4476.

02 Hinweis * wie in der Technischen Konstruktionsakte Dalkin.TCF.020 aufgeführt und von KEIMA positiv ausgemacht gemäß Zertifikat 95951-KRQECMC9-4476.

03 Remarque * tel que stipulé dans le Fichier de Construction Technique Dalkin.TCF.020 et jugé positivement par KEIMA conformément au Certificat 95951-KRQECMC9-4476.

04 Bemerk * zoals vermeld in het Technisch Constructiedossier Dalkin.TCF.020 en in orde bevonden door KEIMA overeenkomstig Certificaat 95951-KRQECMC9-4476.

05 Nota * tal como se expone en el Archivo de Construcción Técnica Dalkin.TCF.020 y juzgado positivamente por KEIMA según el Certificado 95951-KRQECMC9-4476.

06 Nota * delineato nel File Tecnico di Costruzione Dalkin.TCF.020 a giudizio positivamente da KEIMA secondo il Certificato 95951-KRQECMC9-4476.

07 Σημείωση * όπως προορίζεται στο Αρχείο Τεχνικών Κατασκευών Dalkin.TCF.020 και κρίνεται θετικά από το KEIMA σύμφωνα με το πιστοποιητικό 95951-KRQECMC9-4476.

08 Nota * tal como estabelecido no Ficheiro Técnico de Construção Dalkin.TCF.020 e com o parecer positivo de KEIMA de acordo com o Certificado 95951-KRQECMC9-4476.

09 Примечание * как указано в Досье технического конструирования Dalkin.TCF.020 и в соответствии с положительным решением KEIMA согласно Сертификату 95951-KRQECMC9-4476.

10 000 erklærer under enansvar, at klimaanlægmodelerne, som denne deklaration vedrører:

11 01 deklarerar i egeenskap av huvudsakligen, att luftkonditioneringsmodellerna som berörs av denna deklaration innebär att:
12 02 erklærer et tilstedeværende ansvar for at de luftkonditioneringsmodeller som berøres av denne deklarasjon innebærer at:

13 03 ilmoittaa yksinomaan omalla vastuullaan, että tänään ilmoitukseen tarkoitettui ilmastointilaitteiden mallit:
14 04 prohlásuje ve své plné odpovědnosti, že modely klimatizace, k nimž se tato prohlášení vztahuje:

15 05 izjavljuje pod isključivo vlastitom odgovornošću da su modeli klima uređaja na koje se ova izjava odnosi:
16 06 teljes felelősséggel tudatában kijelentem, hogy a klímaberendezés modellek, melyekre a nyilatkozat vonatkozik:

17 07 deklaruje na własną wyłączną odpowiedzialność, że modele klimatyzatorów, których dotyczy niniejsza deklaracja:
18 08 declara pe proprie răspundere că aparatele de aer condiționat la care se referă această declarație:

09 estão em conformidade com a(s) seguinte(s) norma(s) ou outro(s) documento(s) normativo(s), desde que estes sejam utilizados de acordo com as nossas instruções:

09 соответствует следующим стандартам или другим нормативным документам, при условии их использования согласно нашим инструкциям:

10 overholder følgende standard(er) eller anden/danne retningsgivende dokument(er), forudsat at disse anvendes i henhold til vore instrukser:

11 respektive utrustning är utförd i överensstämmelse med och följer följande standard(er) eller andra normgivande dokument, under förutsättning att användning sker i överensstämmelse med våra instruktioner:

12 respektive utstyr er i overensstemmelse med følgende standard(er) eller andre normgivende dokument(er), under forudsætning at disse bruges i henhold til våre instruksr:

13 seuraavien standardien ja muiden ohjeellisten dokumenttien vastaisuuksa edellyttäen, että niitä käytetään ohjeidenne mukaisesti:

14 za predpokrdu, že jsou využívány v souladu s našimi pokyny, odpovídající následujícím normám nebo normativním dokumentům:
15 u skladu sa slijedećim standardom(njima) ili drugim normativnim dokumentom(njima), uz uvjet da se oni koriste u skladu s našim uputama:

Low Voltage 73/23/EEC
Machinery Safety 98/37/EEC
Electromagnetic Compatibility 89/336/EEC *

01 Directies, als amended.
02 Direktiven, gemäß Änderung.
03 Directives, telles que modifiées.
04 Richtlijnen, zoals geamendeerd.
05 Directives, según lo emendado.
06 Direktive, come da modifica.
07 Öbnyvni, omuc z yovov upravení.
08 Directivas, conforme alteração em.
09 Директивне, со изменењем и поправкама.

10 Bemærk * som angår den Tekniske Konstruktionsfil Dalkin.TCF.020 og positivt vurderet af KEIMA i henhold til Certificat 95951-KRQECMC9-4476.

11 Information * utrustningen är utförd enligt det med den Tekniska Konstruktionsfilen Dalkin.TCF.020 som positivt ingåes av KEIMA vilket också framgår av Certificat 95951-KRQECMC9-4476.

12 Merk * som det fremkommer den Tekniske Konstruktionsfilen Dalkin.TCF.020 og gennem positiv bedømmelse af KEIMA ifølge Serifikat 95951-KRQECMC9-4476.

13 Huom * jotka on esitetty Teknisessä Asakirassa Dalkin.TCF.020 ja jotka KEIMA on hyväksynyt
14 Poznámka * Serifikátem 95951-KRQECMC9-4476 mučeseti:
15 Napomena * jak bylo uvedeno v souboru technické konstrukce Dalkin.TCF.020 a pozitivně zjištěno KEIMA v souladu s osvědčením 95951-KRQECMC9-4476.

16 Megjegyzés * íak író jelölésben a technikai konstrukciós dokumentáció alapján, az(az) KEIMA igazolta a megfigyelést az(az) 95951-KRQECMC9-4476 tanúsítvány szerint.

17 Uwaga * zgodnie z archiwalną dokumentacją konstrukcyjną Dalkin.TCF.020 pozytywną opinią KEIMA

18 Nota * conform celor stabilite în Dosarul tehnic de construcție Dalkin.TCF.020 și apreciate pozitiv de KEIMA în conformitate cu Certificatul 95951-KRQECMC9-4476.

16 megfelelnek az alábbi szabvány(ok)nak vagy egyéb irányadó dokumentum(ok)nak, ha azokat előírás szerint használják:
17 spełniał wymogi następujących norm i innych dokumentów normalizacyjnych, pod warunkiem że używane są zgodnie z naszymi instrukcjami:

18 sunt în conformitate cu următorul (următoarele) standard(e) (sau al(e) document(e) normativ(e)), cu condiția ca acestea să fie utilizate în conformitate cu instrucțiunile noastre

19 skladni z naslednjih standardi in drugimi normativi, pod pogojem, da se uporabljajo v skladu z našimi navodili:
20 on vastavuselt järgmistele standard(ite)le või teiste normatiivsete dokumentidega, kui need kasutatakse vastavalt meie juhendile:

21 соотвествует на следующие стандарты или другие нормативные документы, при условии, что они используются согласно нашим инструкциям:

22 atitinka žemiau nurodytus standartus ir (arba) kitus norminius dokumentus su sąlyga, kad yra naudojami pagal mūsų nurodymus:
23 kad, je liesti atbilstuosi rašytinai nurodytiems, atbisi sekąjosiems standartams ir kitam normatiivm dokumentum:

24 su s žinod s naseidovim(ym) normom(ami) arba įnyim(ym) normatyvini(ym) dokumentom(ami), za predpokrdu, že sa používajú v súlade s našimi návodmi:

25 urrun, balmatatimaz gure kulanlimasi kosuluyva aşgatiak standartar ve norm balifiren belgelerle uyumludur:

10 Direktive, med senere ændringer.
11 Direktiv, gemäß Änderung.
12 Direktive, med foretatte ændringer.
13 Direktive, selles que modifiées.
14 Richtlijnen, zoals geamendeerd.
15 Directives, según lo emendado.
16 Direktive, come da modifica.
17 irányvni, omuc z yovov upravení.
18 Directivelor, cu amendamentele respective.

19 Opomba * kot je dobljeno v tehnični mapi Dalkin.TCF.020 in odobreno s strani KEIMA v skladu s certifikatom 95951-KRQECMC9-4476.

20 Märkus * nagu on näidatud tehnilises dokumentatsioonis Dalkin.TCF.020 ja heaks kiidetud KEIMA järgi vastavalt sertifikaadile 95951-KRQECMC9-4476.

21 Забелюка * картю е зарючено в Акта за техническа конструкция Dalkin.TCF.020 и оценоно поточноно от KEIMA съгласно Сертификат 95951-KRQECMC9-4476.

22 Pastaba * kaip nurodyta Techninėje konstrukcijos byloje Dalkin.TCF.020 ir patvirtinta KEIMA pagal pažymėjimą 95951-KRQECMC9-4476.

23 Pzėjimas * ka notekas tehniską dokumentaciją Dalkin.TCF.020 atbilstu KEIMA pozityviai įtenumam to apiečia ake io to sanoveno v Sūbore techninė konstrukci Dalkin.TCF.020 a klaine posūdene KEIMA podľa

24 Poznámk * ako je to stanoveno v Súbore technickej konstrukcie Dalkin.TCF.020 a klaine posúdené KEIMA podľa Certifikátu 95951-KRQECMC9-4476.

25 Not * Dalkin.TCF.020 Technik Yapı Dosyasında belirtilmiş gibi ve 95951-KRQECMC9-4476 sertifikasına göre KEIMA tarafından onulmuş olarak deęerlendirilmiştir.



Ch. Murata

Noboru Murata
Manager Quality Control Department
Shiga, 1st of Jan. 2006

DAIKIN INDUSTRIES, LTD.
Umeda Center Bldg., 4-12, Nakazaki-Nishi 2-chome,
Kita-ku, Osaka, 530-8323 Japan




Safety Precautions

- Read these Safety Precautions carefully to ensure correct installation.
- This manual classifies the precautions into WARNING and CAUTION.
- Be sure to follow all the precautions below: they are all important for ensuring safety.

 **WARNING**.....Failure to follow any of WARNING is likely to result in such grave consequences as death or serious injury.




 **CAUTION**.....Failure to follow any of CAUTION may in some cases result in grave consequences.

- The following safety symbols are used throughout this manual:


 Be sure to observe this instruction.	 Be sure to establish an earth connection.	 Never attempt.
--	---	--

- After completing installation, test the unit to check for installation errors. Give the user adequate instructions concerning the use and cleaning of the unit according to the Operation Manual.

WARNING


- Installation should be left to the dealer or another professional.
Improper installation may cause water leakage, electrical shock, or fire.
- Install the air conditioner according to the instructions given in this manual.
Incomplete installation may cause water leakage, electrical shock, or fire.
- Be sure to use the supplied or specified installation parts.
Use of other parts may cause the unit to come to lose, water leakage, electrical shock, or fire.
- Install the air conditioner on a solid base that can support the unit's weight.
An inadequate base or incomplete installation may cause injury in the event the unit falls off the base.
- Electrical work should be carried out in accordance with the installation manual and the national electrical wiring rules or code of practice. Insufficient capacity or incomplete electrical work may cause electrical shock or fire.
- Be sure to use a dedicated power circuit. Never use a power supply shared by another appliance.
- For wiring, use a cable long enough to cover the entire distance with no connection.
Do not use an extension cord. Do not put other loads on the power supply, use a dedicated power circuit.
(Failure to do so may cause abnormal heat, electric shock or fire.)
- Use the specified types of wires for electrical connections between the indoor and outdoor units.
Firmly clamp the interconnecting wires so their terminals receive no external stresses. Incomplete connections or clamping may cause terminal overheating or fire.
- After connecting interconnecting and supply wiring be sure to shape the cables so that they do not put undue force on the electrical covers or panels.
Install covers over the wires. Incomplete cover installation may cause terminal overheating, electrical shock, or fire.
- If any refrigerant has leaked out during the installation work, ventilate the room.
(The refrigerant produces a toxic gas if exposed to flames.) 
- After all installation is complete, check to make sure that no refrigerant is leaking out.
(The refrigerant produces a toxic gas if exposed to flames.) 
- When installing or relocating the system, be sure to keep the refrigerant circuit free from substances other than the specified refrigerant (R410A), such as air.
(Any presence of air or other foreign substance in the refrigerant circuit causes an abnormal pressure rise or rupture, resulting in injury.)
- During pump-down, stop the compressor before removing the refrigerant piping.
If the compressor is still running and the shut-off valve is open during pump-down, air will be sucked in when the refrigerant piping is removed, causing abnormal pressure in the freezer cycle which will lead to breakage and even injury.
- During installation, attach the refrigerant piping securely before running the compressor.
If the compressor is not attached and the shut-off valve is open during pump-down, air will be sucked in when the compressor is run, causing abnormal pressure in the freezer cycle which will lead to breakage and even injury.
- Be sure to establish an earth. Do not earth the unit to a utility pipe, arrester, or telephone earth.
Incomplete earth may cause electrical shock, or fire. A high surge current from lightning or other sources may cause damage to the air conditioner. 
- Be sure to install an earth leakage breaker.
Failure to install an earth leakage breaker may result in electric shocks, or fire.

CAUTION

- Do not install the air conditioner in a place where there is danger of exposure to inflammable gas leakage.
If the gas leaks and builds up around the unit, it may catch fire. 
- Establish drain piping according to the instructions of this manual.
Inadequate piping may cause flooding.
- Note for installing the outdoor unit. (For heat pump model only.)
In cold area where the outside air temperature keep below or around freezing-point for a few days, the outdoor unit's drain may freeze.
If so, it is recommended to install an electric heater in order to protect drain from freezing.
- Tighten the flare nut according to the specified method such as with a torque wrench.
If the flare nut is tightened too hard, the flare nut may crack after a long time and cause refrigerant leakage.
- Make sure to provide for adequate measures in order to prevent that the outdoor unit be used as a shelter by small animals.
Small animals making contact with electrical parts can cause malfunctions, smoke or fire. Please instruct the customer to keep the area around the unit clean.

Accessories

Accessories supplied with the outdoor unit:


(A) Installation Manual	1	(B) Drain plug (Heat pump-Models)  There is on the bottom packing case.	1
-------------------------	---	---	---

Precautions for Selecting the Location

- 1) Choose a place solid enough to bear the weight and vibration of the unit, where the operation noise will not be amplified.
- 2) Choose a location where the hot air discharged from the unit or the operation noise will not cause a nuisance to the neighbors of the user.
- 3) Avoid places near a bedroom and the like, so that the operation noise will cause no trouble.
- 4) There must be sufficient spaces for carrying the unit into and out of the site.
- 5) There must be sufficient space for air passage and no obstructions around the air inlet and the air outlet.
- 6) The site must be free from the possibility of flammable gas leakage in a nearby place.
- 7) Install units, power cords and inter-unit cables at least 3 meter away from television and radio sets. This is to prevent interference to images and sounds. (Noises may be heard even if they are more than 3 meter away depending on radio wave conditions.)
- 8) In coastal areas or other places with salty atmosphere of sulfate gas, corrosion may shorten the life of the air conditioner.
- 9) Since drain flows out of the outdoor unit, do not place under the unit anything which must be kept away from moisture.


NOTE

Cannot be installed hanging from ceiling or stacked.

**CAUTION**


When operating the air conditioner in a low outdoor ambient temperature, be sure to follow the instructions described below.

- 1) To prevent exposure to wind, install the outdoor unit with its suction side facing the wall.
- 2) Never install the outdoor unit at a site where the suction side may be exposed directly to wind.
- 3) To prevent exposure to wind, it is recommended to install a baffle plate on the air discharge side of the outdoor unit.
- 4) In heavy snowfall areas, select an installation site where the snow will not affect the unit.

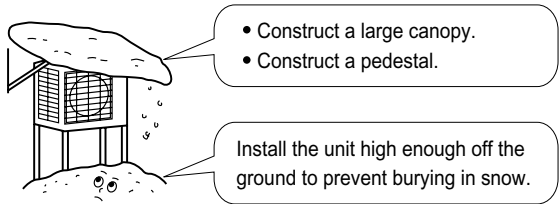

Outdoor Unit Installation Drawings


Model	50 class	60 class	71 class
Max. allowable length	30m		
Min. allowable length	1.5m		
Max. allowable height	20m		
Additional refrigerant required for refrigerant pipe exceeding 10m in length.	20g/m		
Gas pipe	O.D. 12.7mm		O.D. 15.9mm
Liquid pipe	O.D. 6.4mm		

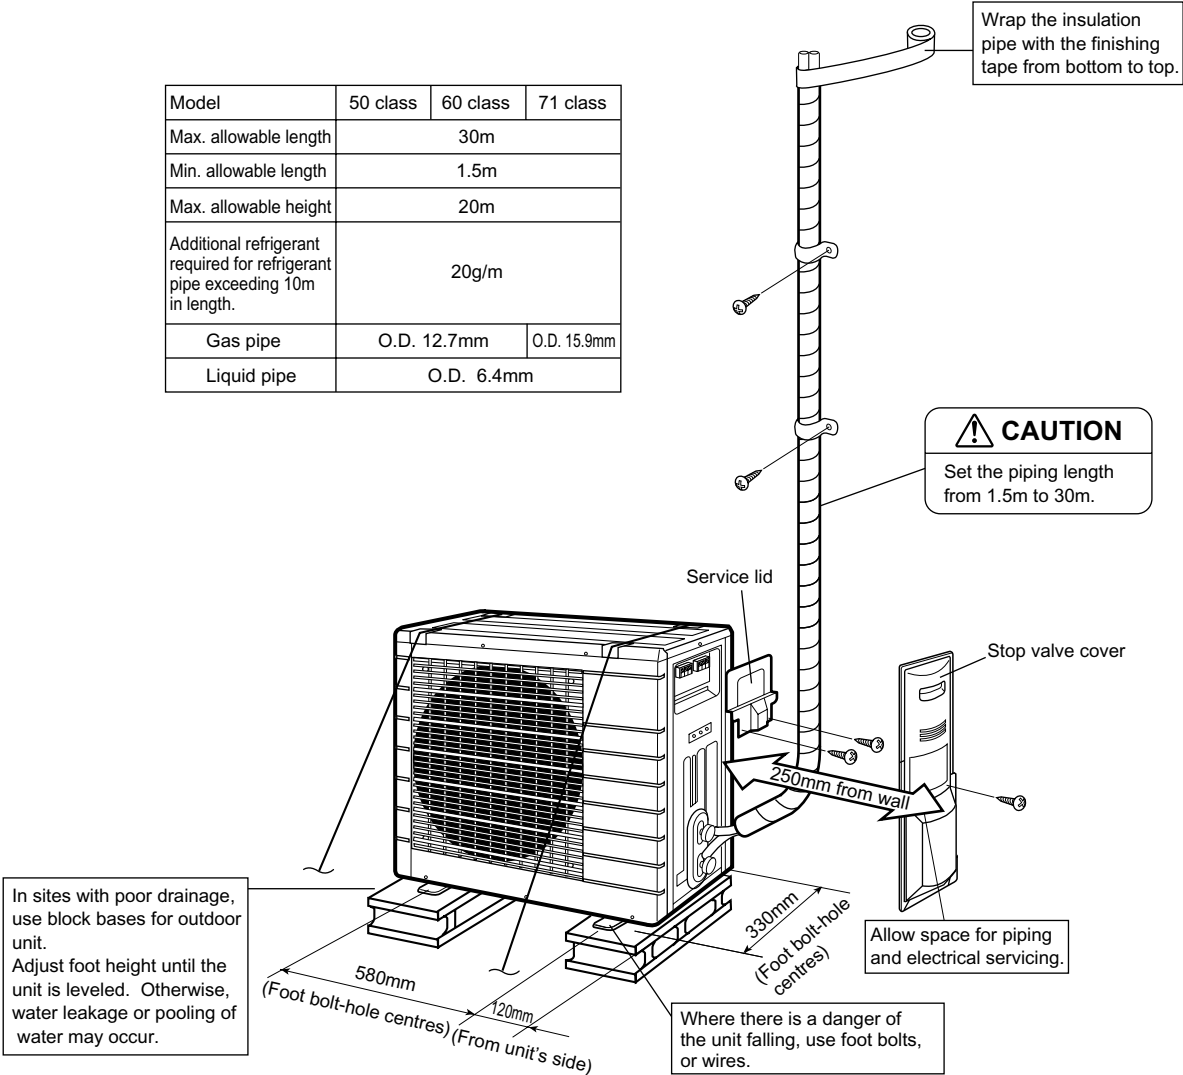

Installation Guidelines


- Where a wall or other obstacle is in the path of outdoor unit's intake or exhaust airflow, follow the installation guidelines below.
- For any of the below installation patterns, the wall height on the exhaust side should be 1200mm or less.

Wall facing one side

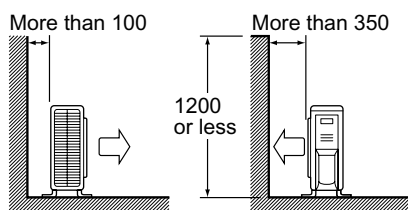


Side view

Walls facing two sides

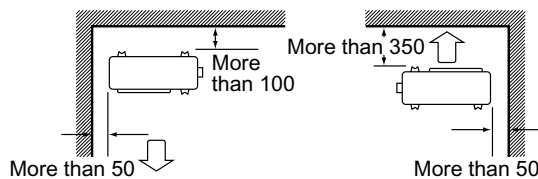

Top view

Walls facing three sides

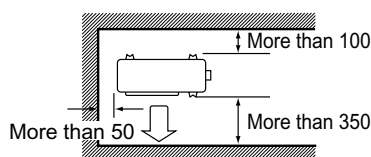


Top view

Unit: mm

Precautions on Installation

- Check the strength and level of the installation ground so that the unit will not cause any operating vibration or noise after installed.
- In accordance with the foundation drawing, fix the unit securely by means of the foundation bolts. (Prepare four sets of M8 or M10 foundation bolts, nuts and washers each which are available on the market.)
- It is best to screw in the foundation bolts until their length are 20mm from the foundation surface.




Outdoor Unit Installation

1. Installing Outdoor Unit

- 1) When installing the outdoor unit, refer to "Precautions for Selecting the Location" and the "Outdoor Unit Installation Drawings."
- 2) If drain work is necessary, follow the procedures below.

2. Drain Work


- 1) Use drain plug for drainage.
- 2) If the drain port is covered by a mounting base or floor surface, place additional foot bases of at least 30mm in height under the outdoor unit's feet.
- 3) In cold areas, do not use a drain hose with the outdoor unit.
(Otherwise, drain water may freeze, impairing heating performance.)



Outdoor Unit Installation

3. Flaring the Pipe End

- 1) Cut the pipe end with a pipe cutter.
- 2) Remove burrs with the cut surface facing downward so that the chips do not enter the pipe.
- 3) Put the flare nut on the pipe.
- 4) Flare the pipe.
- 5) Check that the flaring is properly made.

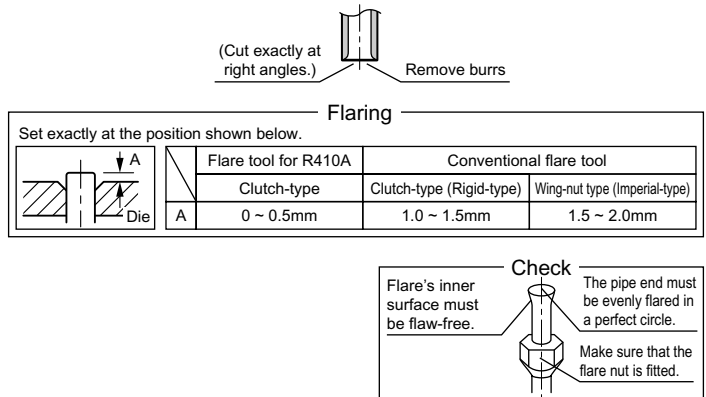


⚠ WARNING

- 1) Do not use mineral oil on flared part.
- 2) Prevent mineral oil from getting into the system as this would reduce the lifetime of the units.
- 3) Never use piping which has been used for previous installations. Only use parts which are delivered with the unit.
- 4) Do never install a drier to this R410A unit in order to guarantee its lifetime.
- 5) The drying material may dissolve and damage the system.
- 6) Incomplete flaring may cause refrigerant gas leakage.

4. Refrigerant Piping

- 1) Align the centres of both flares and tighten the flare nuts 3 or 4 turns by hand. Then tighten them fully with the torque wrenches.
 - Use torque wrenches when tightening the flare nuts to prevent damage to the flare nuts and escaping gas.
- 2) To prevent gas leakage, apply refrigeration machine oil on both inner and outer surfaces of the flare. (Use refrigeration oil for R410A)

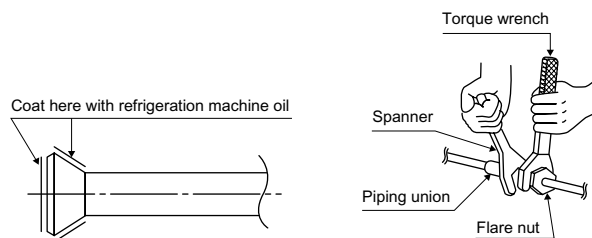

Flare nut tightening torque		
Gas side		Liquid side
1/2 inch	5/8 inch	1/4 inch
49.5~60.3N • m (505~615kgf • cm)	61.8~75.4N • m (630~770kgf • cm)	14.2~17.2N • m (144~175kgf • cm)

Valve cap tightening torque		
Gas side		Liquid side
1/2 inch	5/8 inch	1/4 inch
48.1~59.7N • m (490~610kgf • cm)	44.1~53.9N • m (450~550kgf • cm)	21.6~27.4N • m (220~280kgf • cm)

Service port cap tightening torque	10.8~14.7N • m (110~150kgf • cm)
------------------------------------	-------------------------------------


5. Purging Air and Checking Gas Leakage

- When piping work is completed, it is necessary to purge the air and check for gas leakage.

⚠ WARNING

- Do not mix any substance other than the specified refrigerant (R410A) into the refrigeration cycle.
- When refrigerant gas leaks occur, ventilate the room as soon and as much as possible.
- R410A, as well as other refrigerants, should always be recovered and never be released directly into the environment.
- Use a vacuum pump for R410A exclusively. Using the same vacuum pump for different refrigerants may damage the vacuum pump or the unit.

- If using additional refrigerant, perform air purging from the refrigerant pipes and indoor unit using a vacuum pump, then charge additional refrigerant.
- Use a hexagonal wrench (4mm) to operate the shut-off valve rod.
- All refrigerant pipe joints should be tightened with a torque wrench at the specified tightening torque.

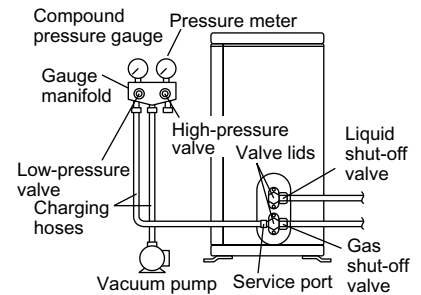

1) Connect projection side (on which worm pin is pressed) of charging hose (which comes from gauge manifold) to gas shut-off valve's service port.



2) Fully open gauge manifold's low-pressure valve (Lo) and completely close its high-pressure valve (Hi). (High-pressure valve subsequently requires no operation.)



3) Do vacuum pumping and make sure that the compound pressure gauge reads -0.1MPa (-76cmHg)*1.



4) Close gauge manifold's low-pressure valve (Lo) and stop vacuum pump. (Keep this state for a few minutes to make sure that the compound pressure gauge pointer does not swing back.)*2.



5) Remove covers from liquid shut-off valve and gas shut-off valve.



6) Turn the liquid shut-off valve's rod 90 degrees counterclockwise with a hexagonal wrench to open valve. Close it after 5 seconds, and check for gas leakage. Using soapy water, check for gas leakage from indoor unit's flare and outdoor unit's flare and valve rods. After the check is complete, wipe all soapy water off.



7) Disconnect charging hose from gas shut-off valve's service port, then fully open liquid and gas shut-off valves. (Do not attempt to turn valve rod beyond its stop.)



8) Tighten valve lids and service port caps for the liquid and gas shut-off valves with a torque wrench at the specified torques.

*1. Pipe length vs. vacuum pump run time

Pipe length	Up to 15 metres	More than 15 metres
Run time	Not less than 10 min.	Not less than 15 min.

*2. If the compound pressure gauge pointer swings back, refrigerant may have water content or a loose pipe joint may exist. Check all pipe joints and retighten nuts as needed, then repeat steps 2) through 4).

Outdoor Unit Installation

6. Refilling The Refrigerant

Check the type of refrigerant to be used on the machine nameplate.


Precautions when adding R410A

Fill from the liquid pipe in liquid form.

It is a mixed refrigerant, so adding it in gas form may cause the refrigerant composition to change, preventing normal operation.

- 1) Before filling, check whether the cylinder has a siphon attached or not. (It should have something like "liquid filling siphon attached" displayed on it.)

Filling a cylinder with an attached siphon



Stand the cylinder upright when filling.

(There is a siphon pipe inside, so the cylinder need not be upside-down to fill with liquid.)

Filling other cylinders




Turn the cylinder upside-down when filling.

- Be sure to use the R410A tools to ensure pressure and to prevent foreign objects entering.

7. Refrigerant Piping Work

7-1 Cautions on Pipe Handling

- 1) Protect the open end of the pipe against dust and moisture.
- 2) All pipe bends should be as gentle as possible. Use a pipe bender for bending.
(Bending radius should be 30 to 40mm or larger.)

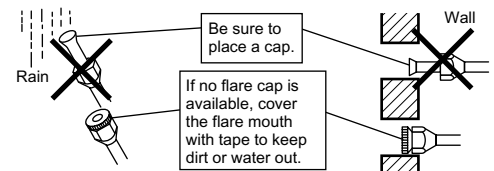


7-2 Selection of Copper and Heat Insulation materials

When using commercial copper pipes and fittings, observe the following:

- 1) Insulation material: Polyethylene foam
Heat transfer rate: 0.041 to 0.052W/mK (0.035 to 0.045kcal/mh°C)
Refrigerant gas pipe's surface temperature reaches 110°C max.
Choose heat insulation materials that will withstand this temperature.
- 2) Be sure to insulate both the gas and liquid piping and to provide insulation dimensions as below.

Gas side		Liquid side	Gas pipe thermal insulation		Liquid pipe thermal insulation
50/60 class	71 class	50/60/71 class	50/60 class	71 class	50/60/71 class
O.D. 12.7mm	O.D. 15.9mm	O.D. 6.4mm	I.D. 14-16mm	I.D. 16-20mm	I.D. 8-10mm
Thickness 0.8mm	Thickness 1.0mm	Thickness 0.8mm	Thickness 10mm Min.		


- Use separate thermal insulation pipes for gas and liquid refrigerant pipes.

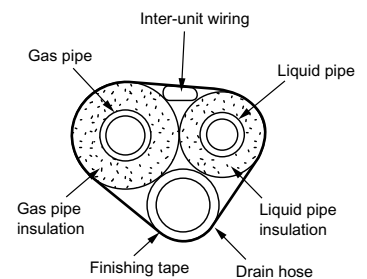

Pump Down Operation


In order to protect the environment, be sure to pump down when relocating or disposing of the unit.

- 1) Remove the valve lid from liquid shut-off valve and gas shut-off valve.
- 2) Carry out forced cooling operation.
- 3) After five to ten minutes, close the liquid shut-off valve with a hexagonal wrench.
- 4) After two to three minutes, close the gas shut-off valve and stop forced cooling operation.

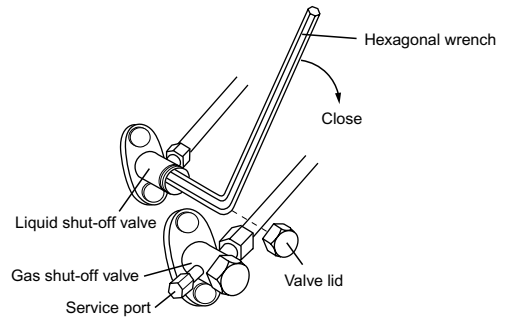

Forced cooling operation


- 1) Press the Forced Operation switch (SW1) to begin forced cooling. Press the Forced Operation switch (SW1) again to stop forced cooling.

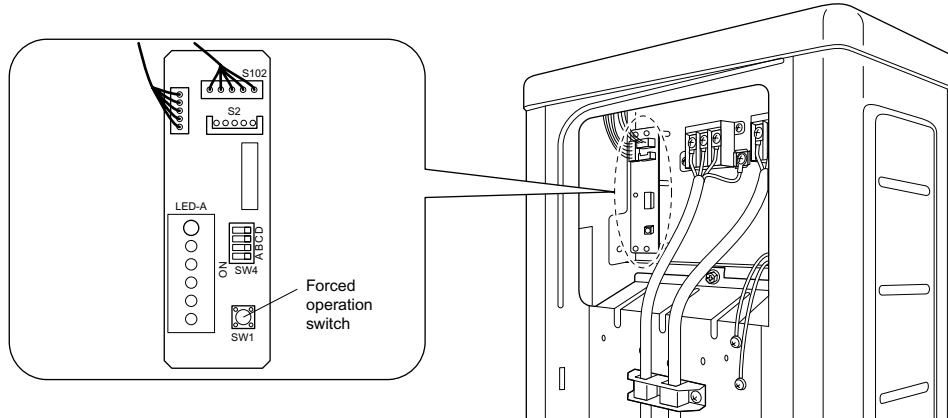

Facility Setting Switch (RKS50/60/71E2V1B only) (cooling at low outdoor temperature)

This function is limited only for facilities (the target of air conditioning is equipment (such as computer)). Never use it in a residence or office (the space where there is a human).

- 1) You can expand the operation range to -15°C by turning on switch B (SW4) on the PCB. If the outdoor temperature falls to -20°C or lower, the operation will stop. If the outdoor temperature rises, the operation will start again.

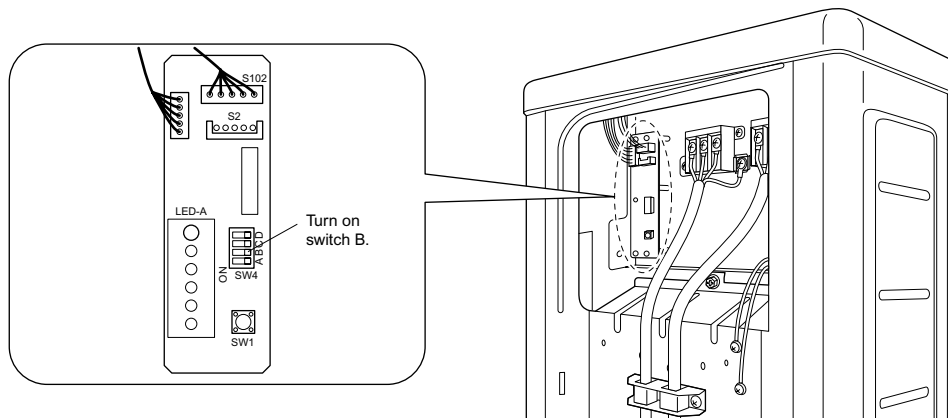

⚠ CAUTION

- 1) If the outdoor unit is installed where the heat exchanger of the unit is exposed to direct wind, provide a windbreak wall.
- 2) Intermittent noises may be produced by the indoor unit due to the outdoor fan turning on and off when using facility settings.
- 3) Do not place humidifiers or other items which might raise the humidity in rooms where facility settings are being used.
A humidifier might cause dew jumping from the indoor unit outlet vent.
- 4) Use the indoor unit at the highest level of air flow rate.



Wiring

⚠ WARNING

- 1) Do not use tapped wires, stand wires, extension cords, or starburst connections, as they may cause overheating, electrical shock, or fire.
- 2) Do not use locally purchased electrical parts inside the product. (Do not branch the power for the drain pump, etc., from the terminal block.) Doing so may cause electric shock or fire.
- 3) Be sure to install an earth leak detector. (One that can handle higher harmonics.)
(This unit uses an inverter, which means that it must be used an earth leak detector capable handling harmonics in order to prevent malfunctioning of the earth leak detector itself.)
- 4) Use an all-pole disconnection type breaker with at least 3 mm between the contact point gaps.

- Do not turn ON the safety breaker until all work is completed.

- 1) Strip the insulation from the wire (20mm).
- 2) Connect the connection wires between the indoor and outdoor units **so that the terminal numbers match**. Tighten the terminal screws securely. We recommend a flathead screwdriver be used to tighten the screws.

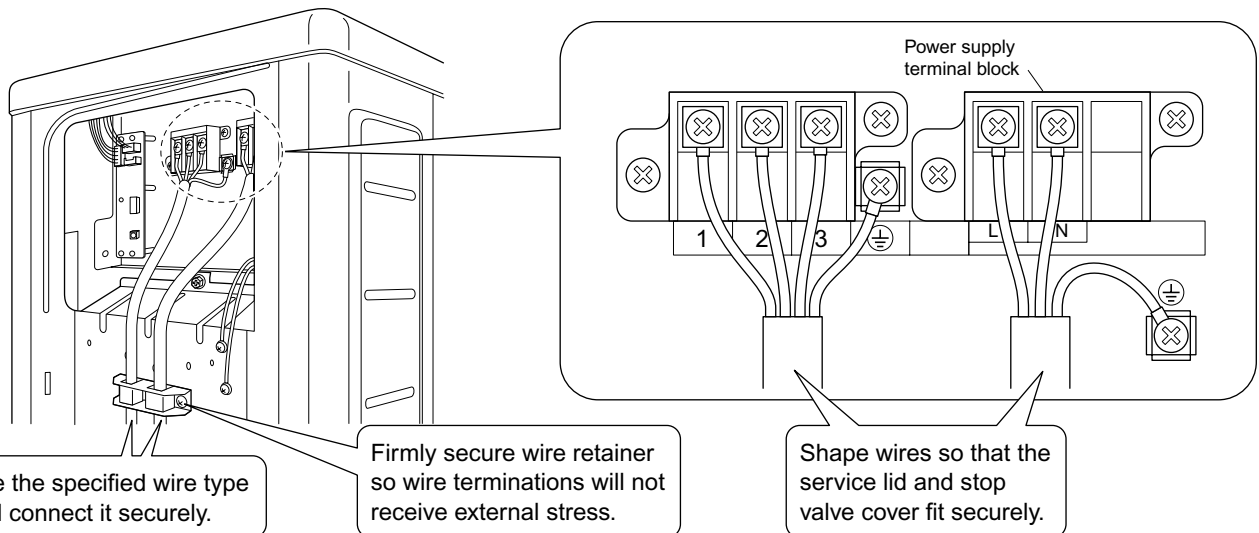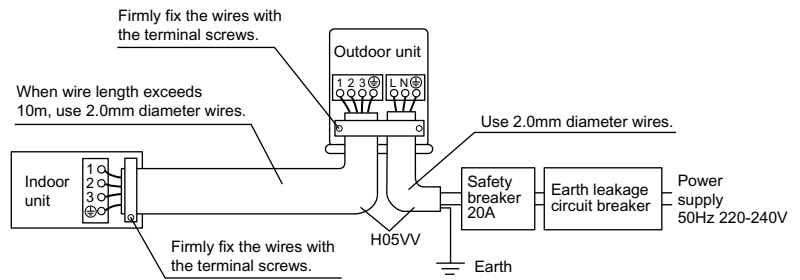


Observe the notes mentioned following when wiring to the power supply terminal board.



Precautions to be taken for power supply wiring.

Use a round crimp-style terminal for connection to the power supply terminal board. In case it cannot be used due to unavoidable reasons, be sure to observe the following instruction.

Place the round crimp-style terminals on the wires up to the covered part and secure in place.




- Ground terminal installation
Use the following method when installing the round crimp-style terminal.

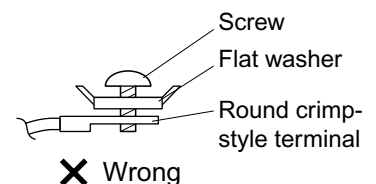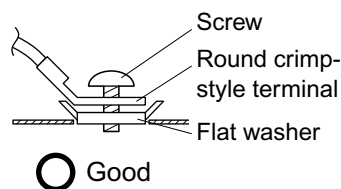

⚠ CAUTION

When connecting the connection wires to the terminal board using a single core wire, be sure to perform curling.
Problems with the work may cause heat and fires.

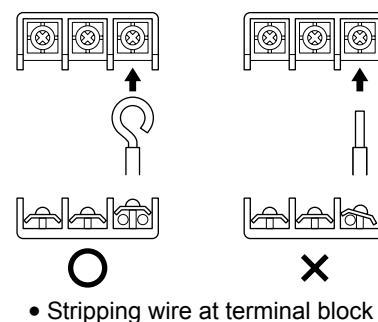

3) Pull the wire and make sure that it does not disconnect. Then fix the wire in place with a wire stop.

Test Run and Final Check

1. Trial Operation and Testing.

1-1 Measure the supply voltage and make sure that it falls in the specified range.

1-2 Trial operation should be carried out in either cooling or heating mode.

■ For Heat pump

- In cooling mode, select the lowest programmable temperature; in heating mode, select the highest programmable temperature.
 - 1) Trial operation may be disabled in either mode depending on the room temperature.
 - 2) After trial operation is complete, set the temperature to a normal level (26°C to 28°C in cooling mode, 20°C to 24°C in heating mode).
 - 3) For protection, the system disables restart operation for 3 minutes after it is turned off.

■ For Cooling only

- Select the lowest programmable temperature.
 - 1) Trial operation in cooling mode may be disabled depending on the room temperature.
 - 2) After trial operation is complete, set the temperature to a normal level (26°C to 28°C).
 - 3) For protection, the unit disables restart operation for 3 minutes after it is turned off.

1-3 Carry out the test operation in accordance with the Operation Manual to ensure that all functions and parts, such as louver movement, are working properly.

- The air conditioner requires a small amount of power in its standby mode. If the system is not to be used for some time after installation, shut off the circuit breaker to eliminate unnecessary power consumption.
- If the circuit breaker trips to shut off the power to the air conditioner, the system will restore the original operation mode when the circuit breaker is opened again.

2. Test Items.

Test Items	Symptom	Check
Indoor and outdoor units are installed properly on solid bases.	Fall, vibration, noise	
No refrigerant gas leaks.	Incomplete cooling/heating function	
Refrigerant gas and liquid pipes and indoor drain hose extension are thermally insulated.	Water leakage	
Draining line is properly installed.	Water leakage	
System is properly earthed.	Electrical leakage	
The specified wires are used for interconnecting wire connections.	Inoperative or burn damage	
Indoor or outdoor unit's air intake or exhaust has clear path of air. Shut-off valves are opened.	Incomplete cooling/heating function	
Indoor unit properly receives remote control commands.	Inoperative	

DAIKIN INDUSTRIES, LTD.

Head office:

Umeda Center Bldg., 2-4-12, Nakazaki-Nishi,
Kita-ku, Osaka, 530-8323 Japan

Tokyo office:

JR Shinagawa East Bldg., 2-18-1, Konan,
Minato-ku, Tokyo, 108-0075 Japan
<http://www.daikin.com/global/>

DAIKIN EUROPE NV

Zandvoordestraat 300, B-8400 Oostende, Belgium