

**DAIKIN**



# TECHNICAL DATA

## Split-Sky Air



**R-GZ7/RP-B7**  
**Pair Application**



# Split Sky Air



ISO14001 assures an effective environmental management system in order to help protect human health and the environment from the potential impact of our activities, products and services and to assist in maintaining and improving the quality of the environment



Daikin units comply with the European regulations that guarantee the safety of the product.



Daikin Europe NV is approved by LRQA for its Quality Management System in accordance with the ISO9001 standard. ISO9001 pertains to quality assurance regarding design, development, manufacturing as well as to services related to the product.



Daikin Europe NV is participating in the EUROVENT Certification Programme. Products are as listed in the EUROVENT Directory of Certified Products.

Specifications are subject to change without prior notice

**DAIKIN PRODUCTS ARE DISTRIBUTED BY :**



**DAIKIN EUROPE NV** Zandvoordestraat 300, B-8400 Oostende

Internet <http://www.daikin.be>

# TABLE OF CONTENTS

## R-GZ7/RP-B7



1	Features .....	2
2	Specifications .....	3
	Technical specifications	
	Electrical specifications	
3	Capacity tables .....	10
4	Dimensional drawings .....	24
5	Operation range .....	27
6	Piping diagrams .....	29
7	Wiring diagrams .....	32
8	Sound level .....	38
	Sound level data	
	Sound pressure spectrum	
9	Accessories .....	40
	Standard accessories	
	Optional accessories	
10	Safety device settings .....	42
11	Installation .....	43



# 1 Features



## 1 Outdoor units for pair application

Daikin outdoor units are neat and sturdy and can be mounted easily on a roof or terrace or simply placed against an outside wall. They are fitted with either rotary or scroll compressor, renowned for low noise and high energy efficiency.

A special acryl precoated fin for anti-corrosion treatment on the heat exchanger ensures greater resistance against severe weather conditions.



# 2 Specifications



2

TECHNICAL SPECIFICATIONS									
OUTDOOR UNITS				R25GZ7V11	R35GZ7V11	R45GZ7V11/W11	R60GZ7W1	RP71B7V1/W1/T1	
DIMENSIONS	Unit	H	mm	540	540	540	660	860	
		W	mm	750	750	750	880	880	
		D	mm	270	270	270	350	320	
WEIGHT	Unit		kg	32	39	46	62	88/85/85	
MATERIAL	Unit	Painted metal						Painted galvanised steel plate	
COLOUR	Unit	Ivory white							
SOUND LEVEL	Sound pressure (1)	high	dB(A)	44	48	51	54	50	
		low	dB(A)	-	-	-	-	-	
	Sound power (2)	high	dB(A)	58	61	64	67	63	
		low	dB(A)	-	-	-	-	-	
FAN	Air flow rate	high	m <sup>3</sup> /min	25	27	30	43	51	
	Speed	steps		2 steps	2 steps	2 steps	2 steps	3 steps	
		high	rpm	710	815	890	785	-	
		low	rpm	325	490	470	455	-	
	Type	-							
	Qty x model				1 x F62P15S22	1 x UE6S-315A4P	1 x F62P45J22	1 x AF-220-49-6-1	1 x P47L11S
Qty x motor output			W	1 x 25	1 x 30	1 x 45	1 x 49	1 x 80	
HEAT EXCHANGER	Type	Hi-XA U-cooling tube, WL fin						Hi-XA U-cooling tube, non symm. waffle louvre	
	Rows x stages x fin pitch			mm	1 x 20 x 2.0	2 x 20 x 2.0	2 x 20 x 2.0	2 x 24 x 2.0	2 x 38 x 2.0
	Face area			m <sup>2</sup>	0.381	0.372	0.372	0.481	0.719
REFRIGERANT CIRCUIT	Refrigerant type	R407C							
	Refrigerant charge			kg	0.75	1.3	1.5	1.85	3.1
	Number of circuits				1	1	1	1	-
	Refrigerant control				-	-	-	-	Expansion valve (electronic type)
COMPRESSOR	Type	Hermetically sealed rotary compressor							
	Qty x model			1 x 802 252 45	1 x 802 352 45	1 x 808 052 45 1 x 808 060 88	1 x 808 445 88	1 x JT90FA-V1N 1 x JT90FA-YE 1 x JT90FA-T1	
	Motor output x no			W	750 x 1	1,075 x 1	1,500 x 1 1,600 x 1	2,100 x 1	2,200 x 1
	Number of cylinders				1	1	1	1	-
	Speed			rpm	2,875	2,880	2,875/2,790	2,800	-
	Oil type				FV68S	FV68S	FV68S	FV68S	Dapne FVC68D
	Oil charge volume			ℓ	0.47	0.52	0.75	1.35	1.2
	Crankcase heater			W	-	-	-	-	-
PIPING CONNECTIONS		liquid	mm	φ6.4	φ6.4	φ6.4	φ6.4	φ9.5	
		gas	mm	φ9.5	φ12.7	φ15.9	φ15.9	φ15.9	
		drain	mm	φ18	φ18	φ18	φ18	φ26	
INSULATION MATERIAL	Heat insulation	Both liquid and gas pipes							
	Safety devices							High and low pressure switch, thermal protection for indoor and outdoor fan motor, overcurrent relay, (compressor), fuse	

## 2 Specifications



2

TECHNICAL SPECIFICATIONS							
OUTDOOR UNITS				RP100B7V1/W1/T1	RP125B7W1/T1	RP200B7W1	RP250B7W1
DIMENSIONS	Unit	H	mm	1,215	1,215	1,220	1,440
		W	mm	880	880	1,290	1,290
		D	mm	320	320	700	700
WEIGHT	Unit		kg	103/98/98	100	194	206
MATERIAL	Unit	Painted galvanised steel plate					
COLOUR	Unit	Ivory white					
SOUND LEVEL	Sound pressure (1)	high	dBA	53	53	56	56
		low	dBA	-	-	-	-
	Sound power (2)	high	dBA	66	67	77	77
FAN	Air flow rate	high	m <sup>3</sup> /min	94	94	170	175
	Speed	steps		3 steps	3 steps	1 Step	1 Step
		high	rpm	-	-	-	-
		low	rpm	-	-	-	-
	Type	-					
	Qty x model			2 x P47L11S	2 x P47L11S	1 x P55J11F	1 x P55J11F
Qty x motor output	W		1 x (80+85)	1 x (80+85)	1 x (230+190)	1 x (230+140)	
HEAT EXCHANGER	Type	Hi-XA cooling tube, non symm. waffle louvre					
	Rows x stages x fin pitch	mm		2 x 54 x 2.0	2 x 54 x 2.0	2 x 40 x 2	2 x 50 x 2
	Face area	m <sup>2</sup>		1,022	1,022	1.57	1.97
REFRIGERANT CIRCUIT	Refrigerant type	R407C					
	Refrigerant charge	kg		3.6	3.9	7.5	9.2
	Number of circuits	-					
	Refrigerant control	Expansion valve (electronic type)			Expansion valve		
COMPRESSOR	Type	Hermetically sealed scroll type					
	Qty x model			1 x JT125FA-V1N 1 x T125FA-YE 1 x JT125FA-T1	1 x JT160FA-YE 1 x JT160FA-T1	1 x JT236DA-YE@2	1 x JT300DA-YE@2
	Motor output x no	W		3,000 x 1	3,750 x 1	5,500 x 1	7,500 x 1
	Number of cylinders	-					
	Speed	rpm		-	-	2,900	2,900
	Oil type			Daphne FVC68D	Daphne FVC68D	Daphne*FVC68D	Daphne*FVC68D
	Oil charge volume	ℓ		1.5	1.5	4	4
	Crankcase heater	W		-	-	50	72
PIPING CONNECTIONS		liquid	mm	φ9.5	φ9.5	φ12.7 x 0.90	φ15.9 x 0.95
		gas	mm	φ19.1	φ19.1	φ28.60 x 1.15	φ28.60 x 1.15
		drain	mm	φ26 x 3	φ26 x 3	φ26 x 6	φ26 x 6
INSULATION MATERIAL	Heat insulation	Both liquid and gas pipes					
	Safety devices	High and low pressure switch, thermal protector for indoor and outdoor fan motor, overcurrent relay (compressor), reverse phase protection (W1/T1) fuse.			High and low pressure switches, thermal protector for indoor and outdoor fan motor, fuse, over current relay (compressor), reverse phase protector, compressor thermal protector		

## 2 Specifications




2

ELECTRICAL SPECIFICATIONS								
OUTDOOR UNITS				R25GZ7V11	R35GZ7V11	R45GZ7V11/W11	R60GZ7W1	RP71B7V1/W1/T1
CURRENT	Nominal running current	cooling	A	3.8	6.4	10.8/3.98	5.6/6.35	-
	Maximum running current	cooling	A	-	-	-	26	-
	Starting current	cooling	A	20	33.5	48/19	26	-
OUTDOOR UNITS				R25GZ7V11	R35GZ7V11	R45GZ7V11/W11	R60GZ7W1	RP71B7V1/W1/T1
POWER SUPPLY				V11	V11	V11/W11	W1	V1/W1/T1
NOMINAL DISTRIBUTION SYSTEM VOLTAGE	Phase			1~	1~	1~/3N~	3N~	1~/3N~/3~
	Frequency		Hz	50	50	50	50	50
	Voltage			V	230	230	230/400	400

ELECTRICAL SPECIFICATIONS								
OUTDOOR UNITS				RP100B7V1/W1/T1	RP125B7W1/T1	RP200B7W1	RP250B7W1	
CURRENT	Nominal running current	cooling	A	-	-	14.4	17.2	
	Maximum running current	cooling	A	-	-	17.9	27.5	
	Starting current	cooling	A	-	-	-	-	
OUTDOOR UNITS				RP100B7V1/W1/T1	RP125B7W1/T1	RP200B7W1	RP250B7W1	
POWER SUPPLY				V1/W1/T1	W1/T1	W1	W1	
NOMINAL DISTRIBUTION SYSTEM VOLTAGE	Phase			1~/3N~/3~	3N~/3~	3N~	3N~	
	Frequency		Hz	50	50	50	50	
	Voltage			V	230/400/230	400/230	400	400

### NOTES

- The sound pressure level is measured via a microphone at a certain distance from the unit. It is a relative value, depending on the distance and acoustic environment. For measuring conditions: please refer to item 8 of this chapter.
- The sound power level is an absolute value indicating the "power" which a sound source generates.
- Maximum allowable distance between indoor and outdoor unit: 25 m (for R25-35-45-60 GZ7), 70 m (for RP71-100-125B7), 50 m (for RP200-250B7; 70 m equivalent).  
Maximum allowable level difference: 15 m (for R25-35-45-60GZ7), 30 m (for RP71-100-125-200-250B7)
-  Additional refrigerant: 20g/m for total piping length > 25 m (for R25-35-45-60GZ7), 60g/m for total piping length > 30 m (for RP200B7), 90g/m for total piping length > 30 m (for RP250B7). No additional refrigerant charge for RP71-100-125B7.

## 2 Specifications



### 2

#### ELECTRICAL DATA

##### R25GZ7V11

Connection ratio (%)	Indoor unit	Power supply					Compressor		OFM		IFM		EH	
		Hz - Volts	Voltage range	MCA	TOCA	MFA	LRA	RLA	W	FLA	W	FLA	W	FLA
-	FT25JZV1NB	50-230	Max. 253V Min. 207V	4.6	-	15.0	20	3.4	15	0.2	19	0.2	-	-
-	FHEB25GZ7V1	50-230	Max. 253V Min. 207V	4.6	-	15.0	20	3.4	15	0.2	10	0.2	-	-

3TW01901-3

##### R35GZ7V11

Connection ratio (%)	Indoor unit	Power supply					Compressor		OFM		IFM		EH	
		Hz - Volts	Voltage range	MCA	TOCA	MFA	LRA	RLA	W	FLA	W	FLA	W	FLA
-	FT35JZV1NB	50-230	Max. 253V Min. 207V	7.9	-	15.0	33.5	6.0	27	0.3	19	0.2	-	-
-	FH35BZV1	50-230	Max. 253V Min. 207V	8.1	-	15.0	33.5	6.0	27	0.3	57	0.3	-	-
-	FHC35BZ7V1	50-230	Max. 253V Min. 207V	8.0	-	15.0	33.5	6.0	27	0.3	45	0.3	-	-
-	FHB35GZ7V1	50-230	Max. 253V Min. 207V	8.2	-	15.0	33.5	6.0	27	0.3	65	0.4	-	-

3TW01911-3

##### R45GZ7V11

Connection ratio (%)	Indoor unit	Power supply					Compressor		OFM		IFM		EH	
		Hz - Volts	Voltage range	MCA	TOCA	MFA	LRA	RLA	W	FLA	W	FLA	W	FLA
-	FT45GAZV1NB	50-230	Max. 253V Min. 207V	13.4	-	25.0	48.0	10.3	45	0.3	40	0.2	-	-
-	FT45GAZ7V1	50-230	Max. 253V Min. 207V	13.5	-	25.0	48.0	10.3	45	0.3	57	0.3	-	-
-	FHC45BZ7V1	50-230	Max. 253V Min. 207V	13.5	-	25.0	48.0	10.3	45	0.3	45	0.3	-	-
-	FHB45GZ7V1	50-230	Max. 253V Min. 207V	13.7	-	25.0	48.0	10.3	45	0.3	85	0.5	-	-

3TW01921-3

#### SYMBOLS

MCA	: Min. Circuit Amps
TOCA	: Total Over Current Amps
MFA	: Max. Fuse Amps
LRA	: Locked Rotor Amps
RLA	: Rated Load Amps (A)
OFM	: Outdoor Fan Motor
IFM	: Indoor Fan Motor
FLA	: Full Load Amps
W	: Fan Motor Rated Output (W)
EH	: Electric Heater

#### NOTES

1. RLA is based on the following conditions:  
Indoor temp.: 27°CDB/19.0°CWB
2. TOCA means the total value of each OC set
3. Voltage range  
Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed operation range limits
4. Maximum allowable voltage unbalance between phases is 2%
5. MCA/MFA  
 $MCA = 1,25 \times RLA + ea. FLA + 1,25 \times EH FLA$   
 $MFA \leq 2,25 \times RLA + ea. FLA + 2,25 \times EH FLA$   
 (next lower standard fuse rating, min.15A)



# 2 Specifications



## ELECTRICAL DATA

2

### R45GZ7W11

Connection ratio (%)	Indoor unit	Power supply					Compressor		OFM		IFM		EH	
		Hz - Volts	Voltage range	MCA	TOCA	MFA	LRA	RLA	W	FLA	W	FLA	W	FLA
-	FT45JZV1NB	50-400	Max. 440V Min. 360V	4.9	-	15.0	19.0	3.5	45	0.3	40	0.2	-	-
-	FH45BZ7V1	50-400	Max. 440V Min. 360V	5.0	-	15.0	19.0	3.5	45	0.3	57	0.3	-	-
-	FHC45BZ7V1	50-400	Max. 440V Min. 360V	5.0	-	15.0	19.0	3.5	45	0.3	45	0.3	-	-
-	FHB45GZ7V1	50-400	Max. 440V Min. 360V	5.2	-	15.0	19.0	3.5	45	0.3	85	0.5	-	-

3TW01931-3

### R60GZ7W1

Connection ratio (%)	Indoor unit	Power supply					Compressor		OFM		IFM		EH	
		Hz - Volts	Voltage range	MCA	TOCA	MFA	LRA	RLA	W	FLA	W	FLA	W	FLA
-	FT60GZV1NB	50-400	Max. 440V Min. 360V	6.8	-	15	26	4.6	49	0.5	40	0.2	-	-
-	FHC60BZ7V1	50-400	Max. 440V Min. 360V	7.7	-	15	26	5.3	49	0.5	45	0.2	-	-

3TW02101-2

### RP71B7V1/W1/T1

Unit combination		Power supply					Compressor		OFM		IFM	
Indoor unit	Outdoor unit	Hz - Volts	Voltage range	MCA	TOCA	MFA	LRA	RLA	kW	FLA	kW	FLA
FHYCP71/FUYYP71	RP71B7V1	50-230	Max. 50Hz-253V Min. 50Hz-197V	16.4	23.4	32	71.3	12.1	0.075	0.7	0.045	0.6
FHP71	RP71B7V1	50-230		16.1	23.1	32	71.3	12.07	0.075	0.7	0.057	0.3
FHYP71	RP71B7V1	50-230		16.4	23.4	32	71.3	12.07	0.075	0.7	0.062	0.6
FAYP71	RP71B7V1	50-230		16.1	23.1	32	71.3	12.07	0.075	0.7	0.046	0.3
FHYKP71	RP71B7V1	50-230		16.3	23.3	32	71.3	12.07	0.075	0.7	0.045	0.5
FHYBP71	RP71B7V1	50-230		16.7	23.7	32	71.3	12.07	0.075	0.7	0.125	0.9

Unit combination		Power supply					Compressor		OFM		IFM	
Indoor unit	Outdoor unit	Hz - Volts	Voltage range	MCA	TOCA	MFA	LRA	RLA	kW	FLA	kW	FLA
FHYCP71/FUYYP71	RP71B7W1	50-400/230	Max. 50Hz-440V/253V Min. 50Hz-360/197V	7.1	11.3	16	34.8	4.6	0.075	0.7	0.045	0.6
FHYP71	RP71B7W1	50-400/230		7.1	11.3	16	34.8	4.6	0.075	0.7	0.062	0.6
FAYP71	RP71B7W1	50-400/230		6.8	11.0	16	34.8	4.6	0.075	0.7	0.046	0.3
FHYKP71	RP71B7W1	50-400/230		7.0	11.2	16	34.8	4.6	0.075	0.7	0.045	0.5
FHYBP71	RP71B7W1	50-400/230		7.4	11.6	16	34.8	4.6	0.075	0.7	0.125	0.9

Unit combination		Power supply					Compressor		OFM		IFM	
Indoor unit	Outdoor unit	Hz - Volts	Voltage range	MCA	TOCA	MFA	LRA	RLA	kW	FLA	kW	FLA
FHYCP71/FUYYP71	RP71B7T1	50-230	Max. 50Hz-364V Min. 50Hz-198V	11.2	16.3	20	58.3	7.9	0.075	0.7	0.045	0.6
FHYP71	RP71B7T1	50-230		11.2	16.3	20	58.3	7.9	0.075	0.7	0.062	0.6
FAYP71	RP71B7T1	50-230		10.9	16.0	20	58.3	7.9	0.075	0.7	0.046	0.3
FHYKP71	RP71B7T1	50-230		11.1	16.2	20	58.3	7.9	0.075	0.7	0.045	0.5
FHYBP71	RP71B7T1	50-230		11.5	16.6	20	58.3	7.9	0.075	0.7	0.125	0.9

3TW23189-2A

### SYMBOLS

- MCA : Min. Circuit Amps
- TOCA : Total Over Current Amps
- MFA : Max. Fuse Amps (see note 7)
- LRA : Locked Rotor Amps
- RLA : Rated Load Amps (A)
- OFM : Outdoor Fan Motor
- IFM : Indoor Fan Motor
- FLA : Full Load Amps
- kW : Rated motor output
- EH : Electric Heater

### NOTES

1. RLA is based on the following conditions:  
Indoor temp.: 27°CDB/19.0°CWB  
Outdoor temp.: 35°CDB
2. TOCA means the total value of each OC set
3. Voltage range  
Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed operation range limits
4. Maximum allowable voltage unbalance between phases is 2%
5. MCA/MFA  
MCA = 1,25 x RLA + ea. FLA + 1,25 x EH FLA  
MFA ≤ 2,25 x RLA + ea. FLA + 2,25 x EH FLA  
(next lower standard fuse rating, min. 15A)
6. Select wire size based on the larger value of MCA or TOCA
7. Instead of fuse, use circuit breaker

# 2 Specifications



## 2

### ELECTRICAL DATA

#### RP100B7V1/W1/T1

Unit combination		Power supply					Compressor		OFM		IFM			
Indoor unit	Outdoor unit	Hz - Volts	Voltage range			MCA	TOCA	MFA	LRA	RLA	kW	FLA	kW	FLA
FHYCP100/FUYYP100	RP100B7V1	50-230	Max. 50Hz-253C Min. 50Hz-197V	24.8	35.7	40	96.9	17.8	0.08 + 0.085	0.84 + 0.7	0.09	1.0		
FHP100	RP100B7V1	50-230		24.7	35.4	40	96.9	17.8	0.08 + 0.085	0.84 + 0.7	0.13	0.9		
FHYP100	RP100B7V1	50-230		24.5	35.6	40	96.9	17.6	0.08 + 0.085	0.84 + 0.7	0.13	0.7		
FHYBP100	RP100B7V1	50-230		24.8	35.7	40	96.9	17.8	0.08 + 0.085	0.84 + 0.7	0.135	1.0		
FAYP100	RP100B7V1	50-230		24.2	35.3	40	96.9	17.8	0.08 + 0.085	0.84 + 0.7	0.049	0.4		

Unit combination		Power supply					Compressor		OFM		IFM			
Indoor unit	Outdoor unit	Hz - Volts	Voltage range			MCA	TOCA	MFA	LRA	RLA	kW	FLA	kW	FLA
FHYCP100/FUYYP100	RP100B7W1	50-400/230	Max. 50Hz-440/253V Min. 50Hz-360/197V	10.7	13.2	16	45.5	6.5	0.08 + 0.085	0.84 + 0.7	0.09	1.0		
FHYP100	RP100B7W1	50-400/230		10.4	13.1	16	45.5	6.5	0.08 + 0.085	0.84 + 0.7	0.13	0.7		
FHYBP100	RP100B7W1	50-400/230		10.7	13.2	16	45.5	6.5	0.08 + 0.085	0.84 + 0.7	0.135	1.0		
FAYP100	RP100B7W1	50-400/230		10.1	12.6	16	45.5	6.5	0.08 + 0.085	0.84 + 0.7	0.049	0.4		

Unit combination		Power supply					Compressor		OFM		IFM			
Indoor unit	Outdoor unit	Hz - Volts	Voltage range			MCA	TOCA	MFA	LRA	RLA	kW	FLA	kW	FLA
FHYCP100/FUYYP100	RP100B7T1	50-230	Max. 50Hz-264V Min. 50Hz-198V	16.2	24.5	32	75.4	10.9	0.08 + 0.085	0.84 + 0.7	0.09	1.0		
FHYP100	RP100B7T1	50-230		15.9	24.4	32	75.4	10.9	0.08 + 0.085	0.84 + 0.7	0.13	0.7		
FHYBP100	RP100B7T1	50-230		16.2	24.5	32	75.4	10.9	0.08 + 0.085	0.84 + 0.7	0.135	1.0		
FAYP100	RP100B7T1	50-230		15.6	23.9	32	75.4	10.9	0.08 + 0.085	0.84 + 0.7	0.049	0.4		

3TW23229-2A

#### SYMBOLS

MCA : Min. Circuit Amps  
 TOCA : Total Over Current Amps  
 MFA : Max. Fuse Amps (see note 7)  
 LRA : Locked Rotor Amps  
 RLA : Rated Load Amps (A)  
 OFM : Outdoor Fan Motor  
 IFM : Indoor Fan Motor  
 FLA : Full Load Amps  
 kW : Rated motor output

#### NOTES

1. RLA is based on the following conditions:  
Indoor temp.: 27°CDB/19.0°CWB  
Outdoor temp.: 35°CDB
2. TOCA means the total value of each OC set
3. Voltage range  
Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed operation range limits
4. Maximum allowable voltage unbalance between phases is 2%
5. MCA/MFA  
MCA = 1.25 x RLA + ea. FLA  
MFA ≤ 2.25 x RLAA + ea. FLA  
(next lower standard fuse rating, min.15A)
6. Select wire size based on the larger value of MCA or TOCA
7. Instead of fuse, use circuit breaker

# 2 Specifications



## ELECTRICAL DATA

2

### RP125B7W1/T1

Unit combination		Power supply					Compressor		OFM		IFM			
Indoor unit	Outdoor unit	Hz - Volts	Voltage range			MCA	TOCA	MFA	LRA	RLA	kW	FLA	kW	FLA
FHYCP125/FUYYP125	RP125B7W1	50-400/230	Max. 50Hz-440V/253V Min. 50Hz-360V/197V	12.7	16.4	20	57.3	8.1	0.085 + 0.08	0.84 + 0.7	0.09	1.0		
FHYP125	RP125B7W1	50-400/230		12.6	16.3	20	57.3	8.1	0.085 + 0.08	0.84 + 0.7	0.13	0.9		
FHYBP125	RP125B7W1	50-400/230		13.1	16.8	20	57.3	8.1	0.085 + 0.08	0.84 + 0.7	0.225	1.4		
FDYP125	RP125B7W1	50-400/230		15.9	19.6	20	57.3	8.1	0.085 + 0.08	0.84 + 0.7	0.5	4.2		

Unit combination		Power supply					Compressor		OFM		IFM			
Indoor unit	Outdoor unit	Hz - Volts	Voltage range			MCA	TOCA	MFA	LRA	RLA	kW	FLA	kW	FLA
FHYCP125/FUYYP125	RP125B7T1	50-230	Max. 50Hz-253V Min. 50Hz-197V	19.7	26.5	32	98.8	13.7	0.085 + 0.08	0.84 + 0.7	0.09	1.0		
FHYP125	RP125B7T1	50-230		19.6	26.4	32	98.8	13.7	0.085 + 0.08	0.84 + 0.7	0.13	0.9		
FHYBP125	RP125B7T1	50-230		20.1	26.9	32	98.8	13.7	0.085 + 0.08	0.84 + 0.7	0.225	1.4		
FDYP125	RP125B7T1	50-230		22.9	29.7	32	98.8	13.7	0.085 + 0.08	0.84 + 0.7	0.5	4.2		

3TW23269-2

### RP200B7W1

Unit combination		Power supply					Compressor		OFM		IFM		
Indoor unit	Outdoor unit	Hz - Volts	Voltage range			MCA	MFA	LRA	RLA	kW	FLA	kW	FLA
FDYP200B7V1	RP200B7W1	50-400	Max. 50Hz-440V Min. 50Hz-360V	19.0	25	16	98	12.9	0.19 + 0.23	1.28 + 1.43	650	6.8	
FDYP250B7V1	RP250B7W1	50-400	Max. 50Hz-440V Min. 50Hz-360V	22.7	32	16	108	16.0	0.14 + 0.23	1.1 + 1.43	1000	7.6	

3TW23611-2

### SYMBOLS

- MCA : Min. Circuit Amps
- TOCA : Total Over Current Amps
- MFA : Max. Fuse Amps (see note 7)
- LRA : Locked Rotor Amps
- RLA : Rated Load Amps (A)
- OFM : Outdoor Fan Motor
- IFM : Indoor Fan Motor
- FLA : Full Load Amps
- kW : Rated motor output

### NOTES

1. RLA is based on the following conditions:  
Indoor temp.: 27°CDB/19.0°CWB  
Outdoor temp. : 35°CDB
2. TOCA means the total value of each OC set
3. Voltage range  
Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed operation range limits
4. Maximum allowable voltage unbalance between phases is 2%
5. MCA/MFA  
MCA = 1.25 x RLA + ea. FLA  
MFA ≤ 2.25 x RLAA + ea. FLA  
(next lower standard fuse rating, min.15A)
6. Select wire size based on the larger value of MCA or TOCA
7. Instead of fuse, use circuit breaker

# 3 Capacity tables



3

**R25GZ7V11 + FHEB25GZ7V1**  
**R25GZ7V11 + FT25JZV1NB**  
**R25GZ7V11 + FL25GZV1NB**  
**Cooling capacity**

**230V [50Hz]**

Model	FT..JZ	FHEB	FL..GZ
AFR	6.0	6.5	7.5
BF	0.19	0.43	0.21

Indoor		Outdoor temperature (°C)																	
EWB	EDB	20			25			32			35			40			46		
(°C)	(°C)	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	2.29	1.60	0.65	2.15	1.54	0.70	1.96	1.44	0.77	1.88	1.40	0.81	1.74	1.33	0.86	1.57	1.24	0.92
14.0	20.0	2.44	1.65	0.66	2.30	1.58	0.71	2.11	1.48	0.78	2.03	1.44	0.82	1.89	1.37	0.87	1.72	1.29	0.93
16.0	22.0	2.59	1.70	0.67	2.45	1.63	0.72	2.26	1.53	0.79	2.18	1.49	0.83	2.04	1.42	0.88	1.87	1.34	0.94
18.0	25.0	2.74	1.74	0.68	2.60	1.68	0.73	2.41	1.58	0.80	2.33	1.54	0.84	2.19	1.47	0.89	2.02	1.38	0.95
19.0	27.0	2.82	1.77	0.69	2.68	1.70	0.73	2.48	1.60	0.81	2.40	1.56	0.84	2.26	1.49	0.89	2.10	1.41	0.96
22.0	30.0	3.04	1.84	0.70	2.90	1.77	0.75	2.71	1.67	0.82	2.63	1.63	0.86	2.49	1.56	0.91	2.32	1.48	0.97
24.0	32.0	3.19	1.88	0.70	3.05	1.82	0.76	2.86	1.72	0.83	2.78	1.68	0.87	2.64	1.61	0.92	2.47	1.52	0.98

3TW00872-1E

Correction	TC	SHC	PI
FHEB	0	0	+0.04
FL..GZ	+0.05	+0.03	+0.02

**R35GZ7V11 + FT35JZV1NB**  
**+ FL35GZV1NB**  
**Cooling capacity**

**230V [50Hz]**

Model	FT..JZ	FL..GZ
AFR	6.9	8.0
BF	0.20	0.31

Indoor		Outdoor temperature (°C)																	
EWB	EDB	20			25			32			35			40			46		
(°C)	(°C)	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	3.35	2.33	0.86	3.20	2.26	0.96	2.99	2.17	1.09	2.90	2.12	1.15	2.75	2.05	1.24	2.57	1.97	1.36
14.0	20.0	3.51	2.37	0.89	3.36	2.30	0.99	3.15	2.20	1.12	3.06	2.16	1.18	2.91	2.09	1.27	2.73	2.00	1.38
16.0	22.0	3.67	2.40	0.92	3.52	2.33	1.01	3.31	2.23	1.14	3.22	2.19	1.20	3.07	2.12	1.30	2.89	2.04	1.41
18.0	25.0	3.82	2.44	0.94	3.67	2.37	1.04	3.46	2.27	1.17	3.37	2.23	1.23	3.22	2.16	1.32	3.04	2.07	1.44
19.0	27.0	3.90	2.45	0.96	3.75	2.38	1.05	3.54	2.28	1.18	3.45	2.24	1.24	3.30	2.17	1.34	3.12	2.09	1.45
22.0	30.0	4.13	2.50	0.99	3.98	2.43	1.09	3.77	2.34	1.22	3.68	2.29	1.28	3.53	2.22	1.37	3.35	2.14	1.49
24.0	32.0	4.29	2.54	1.02	4.14	2.47	1.12	3.93	2.37	1.25	3.84	2.33	1.31	3.69	2.26	1.40	3.51	2.17	1.51

3TW01912-1A

## SYMBOLS

AFR:	Air flow rate	(m3/min)
BF:	Bypass factor	
EWB:	Entering wet bulb temp.	(°CWB)
EDB:	Entering dry bulb temp.	(°CDB)
TC:	Total cooling capacity	(kW)
SHC:	Sensible heating capacity	(kW)
PI:	Power input	(kW)
	(comp.+indoor+outdoor fan motor)	

**Caution:**  
**TC and SHC are shown by kW**

## NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat
- Shows nominal capacities
- SHC is based on each EWB and EDB  
 SHC\* = SHC correction for other dry bulb  
 SHC\* = 0.34 x 60 x AFR (m<sup>3</sup>/min) x (DB-EDB)/1000.  
 Add SHC\* to SHC if SHC > TC, then TC equal SHC
- Direct interpolation is permissible Do not extrapolate.
- Capacities are based on the following conditions:  
 Corresponding refrigerant piping length: 7.5 m  
 Level difference: 0 m

Correction	TC	SHC	PI
FL..GZ	-0.05	-0.03	+0.05

# 3 Capacity tables



## R35GZ7V11 + FH35BZV1 + FHK35BZV1

Cooling capacity

230V [50Hz]

Model	FH	FHK
AFR	13	12
BF	0.20	0.16

3

Indoor		Outdoor temperature (°C)																	
EWB (°C)	EDB (°C)	20			25			32			35			40			46		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	3.65	2.53	0.94	3.50	2.46	1.04	3.29	2.36	1.17	3.20	2.32	1.23	3.05	2.25	1.32	2.87	2.16	1.44
14.0	20.0	3.81	2.56	0.97	3.66	2.49	1.07	3.45	2.39	1.20	3.36	2.35	1.26	3.21	2.28	1.35	3.03	2.20	1.46
16.0	22.0	3.97	2.60	1.00	3.82	2.53	1.09	3.61	2.43	1.22	3.52	2.39	1.28	3.37	2.32	1.38	3.19	2.23	1.49
18.0	25.0	4.12	2.63	1.02	3.97	2.56	1.12	3.76	2.46	1.25	3.67	2.42	1.31	3.52	2.35	1.40	3.34	2.27	1.52
19.0	27.0	4.20	2.65	1.04	4.05	2.58	1.13	3.84	2.48	1.26	3.75	2.44	1.32	3.60	2.37	1.42	3.42	2.28	1.53
22.0	30.0	4.43	2.70	1.07	4.28	2.63	1.17	4.07	2.53	1.30	3.98	2.49	1.36	3.83	2.42	1.45	3.65	2.33	1.57
24.0	32.0	4.59	2.73	1.10	4.44	2.66	1.20	4.23	2.56	1.33	4.14	2.52	1.39	3.99	2.45	1.48	3.81	2.37	1.59

3TW01912-2A

Correction	TC	SHC	PI
FH..B	0.00	+0.05	+0.18
FHK..B	0.00	+0.05	-0.03

## R35GZ7V11 + FHC35BZ7V1

Cooling capacity

230V [50Hz]

Model	FHC
AFR	14
BF	0.16

Indoor		Outdoor temperature (°C)																	
EWB (°C)	EDB (°C)	20			25			32			35			40			46		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	3.70	2.56	0.98	3.55	2.49	1.08	3.34	2.39	1.21	3.25	2.35	1.27	3.10	2.28	1.36	2.92	2.20	1.48
14.0	20.0	3.86	2.60	1.01	3.71	2.53	1.11	3.50	2.43	1.24	3.41	2.39	1.30	3.26	2.32	1.39	3.08	2.23	1.50
16.0	22.0	4.02	2.63	1.04	3.87	2.56	1.13	3.66	2.46	1.26	3.57	2.42	1.32	3.42	2.35	1.42	3.24	2.27	1.53
18.0	25.0	4.17	2.66	1.06	4.02	2.59	1.16	3.81	2.50	1.29	3.72	2.45	1.35	3.57	2.38	1.44	3.39	2.30	1.56
19.0	27.0	4.25	2.68	1.08	4.10	2.61	1.17	3.89	2.51	1.30	3.80	2.47	1.36	3.65	2.40	1.46	3.47	2.32	1.57
22.0	30.0	4.48	2.73	1.11	4.33	2.66	1.21	4.12	2.56	1.34	4.03	2.52	1.40	3.88	2.45	1.49	3.70	2.37	1.61
24.0	32.0	4.64	2.77	1.14	4.49	2.70	1.24	4.28	2.60	1.37	4.19	2.56	1.43	4.04	2.49	1.52	3.86	2.40	1.63

3TW01912-2A

### SYMBOLS

AFR:	Air flow rate	(m <sup>3</sup> /min)
BF:	Bypass factor	
EWB:	Entering wet bulb temp.	(°CWB)
EDB:	Entering dry bulb temp.	(°CDB)
TC:	Total cooling capacity	(kW)
SHC:	Sensible heating capacity	(kW)
PI:	Power input	(kW)
	(comp.+indoor+outdoor fan motor)	

**Caution:**  
TC and SHC are shown by kW

### NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat
- Shows nominal capacities
- SHC is based on each EWB and EDB  
 $SHC^* = SHC$  correction for other dry bulb  
 $SHC^* = 0.34 \times 60 \times AFR (m^3/min) \times (DB-EDB)/1000$ .  
 Add SHC\* to SHC if SHC > TC, then TC equal SHC
- Direct interpolation is permissible Do not extrapolate.
- Capacities are based on the following conditions:  
 Corresponding refrigerant piping length: 7.5 m  
 Level difference: 0 m

# 3 Capacity tables



3

## R35GZ7V11 + FHB35GZ7V1

Cooling capacity

230V [50Hz]

Model	FHB..GZ
AFR	11.5
BF	0.15

Indoor		Outdoor temperature (°C)																	
EWB (°C)	EDB (°C)	20			25			32			35			40			46		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	3.60	2.50	1.02	3.45	2.43	1.12	3.24	2.33	1.25	3.15	2.29	1.31	3.00	2.22	1.40	2.82	2.13	1.52
14.0	20.0	3.76	2.53	1.05	3.61	2.46	1.15	3.40	2.36	1.28	3.31	2.32	1.34	3.16	2.25	1.43	2.98	2.17	1.54
16.0	22.0	3.92	2.56	1.08	3.77	2.49	1.17	3.56	2.40	1.30	3.47	2.35	1.36	3.32	2.28	1.46	3.14	2.20	1.57
18.0	25.0	4.07	2.60	1.10	3.92	2.53	1.20	3.71	2.43	1.33	3.62	2.39	1.39	3.47	2.32	1.48	3.29	2.23	1.60
19.0	27.0	4.15	2.62	1.12	4.00	2.55	1.21	3.79	2.45	1.34	3.70	2.41	1.40	3.55	2.34	1.50	3.37	2.25	1.61
22.0	30.0	4.38	2.67	1.15	4.23	2.60	1.25	4.02	2.50	1.38	3.93	2.46	1.44	3.78	2.39	1.53	3.60	2.30	1.65
24.0	32.0	4.54	2.70	1.18	4.39	2.63	1.28	4.18	2.53	1.41	4.09	2.49	1.47	3.94	2.42	1.56	3.76	2.34	1.67

3TW01912-2A

## R45GZ7V11 + FT45GAZV1NB + FL45GZV1NB

Cooling capacity

230V [50Hz]

Model	FT..G	FL..G
AFR	11.8	10.8
BF	0.18	0.18

Indoor		Outdoor temperature (°C)																	
EWB (°C)	EDB (°C)	20			25			32			35			40			46		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	4.71	3.33	1.47	4.47	3.24	1.63	4.14	3.12	1.86	4.58	3.15	2.07	3.75	2.98	2.12	3.46	2.87	2.32
14.0	20.0	5.03	3.40	1.51	4.79	3.31	1.67	4.45	3.19	1.90	4.30	3.14	2.00	4.07	3.05	2.16	3.78	2.94	2.36
16.0	22.0	5.35	3.47	1.55	5.11	3.38	1.71	4.77	3.26	1.94	4.62	3.21	2.04	4.38	3.12	2.20	4.10	3.01	2.40
18.0	25.0	5.67	3.54	1.59	5.43	3.45	1.75	5.09	3.33	1.98	4.94	3.28	2.08	4.70	3.19	2.24	4.41	3.08	2.44
19.0	27.0	5.83	3.58	1.61	5.58	3.49	1.77	5.25	3.36	2.00	5.10	3.31	2.10	4.86	3.22	2.26	4.57	3.12	2.46
22.0	30.0	6.29	3.68	1.67	6.05	3.59	1.83	5.72	3.47	2.06	5.58	3.42	2.16	5.34	3.33	2.32	5.04	3.22	2.52
24.0	32.0	6.61	3.75	1.71	6.37	3.66	1.87	6.03	3.54	2.10	5.90	3.49	2.20	5.65	3.40	2.36	5.36	3.29	2.56

Correction	TC	SHC	PI
FL	-0.20	-0.11	+0.00

## R45GZ7W11 + FT45GAZV1NB + FL45GZV1NB

Cooling capacity

400V [50Hz]

Model	FT..G	FL..G
AFR	11.8	10.8
BF	0.18	0.18

Indoor		Outdoor temperature (°C)																	
EWB (°C)	EDB (°C)	20			25			32			35			40			46		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	4.71	3.33	1.37	4.47	3.24	1.53	4.14	3.12	1.76	4.58	3.15	1.97	3.75	2.98	2.02	3.46	2.87	2.22
14.0	20.0	5.03	3.40	1.41	4.79	3.31	1.57	4.45	3.19	1.80	4.30	3.14	1.90	4.07	3.05	2.06	3.78	2.94	2.26
16.0	22.0	5.35	3.47	1.45	5.11	3.38	1.61	4.77	3.26	1.84	4.62	3.21	1.94	4.38	3.12	2.10	4.10	3.01	2.30
18.0	25.0	5.67	3.54	1.49	5.43	3.45	1.65	5.09	3.33	1.88	4.94	3.28	1.98	4.70	3.19	2.14	4.41	3.08	2.34
19.0	27.0	5.83	3.58	1.51	5.58	3.49	1.67	5.25	3.36	1.90	5.10	3.31	2.00	4.86	3.22	2.16	4.57	3.12	2.36
22.0	30.0	6.29	3.68	1.57	6.05	3.59	1.73	5.72	3.47	1.96	5.58	3.42	2.06	5.34	3.33	2.22	5.04	3.22	2.42
24.0	32.0	6.61	3.75	1.61	6.37	3.66	1.77	6.03	3.54	2.00	5.90	3.49	2.10	5.65	3.40	2.26	5.36	3.29	2.46

3TW00912-1D

Correction	TC	SHC	PI
FL	-0.20	-0.11	+0.03

### SYMBOLS

AFR:	Air flow rate	(m <sup>3</sup> /min)
BF:	Bypass factor	
EWB:	Entering wet bulb temp.	(°CWB)
EDB:	Entering dry bulb temp.	(°CDB)
TC:	Total cooling capacity	(kW)
SHC:	Sensible heating capacity	(kW)
PI:	Power input	(kW)
	(comp.+indoor+outdoor fan motor)	

**Caution:**  
TC and SHC are shown by kW

### NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat
- Shows nominal capacities
- SHC is based on each EWB and EDB  
SHC\* = SHC correction for other dry bulb  
SHC\* = 0.34 x 60 x AFR (m<sup>3</sup>/min) x (DB-EDB)/1000.  
Add SHC\* to SHC if SHC > TC, then TC equal SHC
- Direct interpolation is permissible Do not extrapolate.
- Capacities are based on the following conditions:  
Corresponding refrigerant piping length: 7.5 m  
Level difference: 0 m
- Add the following correction value to power input (kW) of each unit

# 3 Capacity tables



## FHC45BZ7V1 + R45GZ7V11

Cooling capacity

230V [50Hz]

Model	FHC..B
AFR	15
BF	0.16

3

Indoor		Outdoor temperature (°C)																	
EWB (°C)	EDB (°C)	20			25			32			35			40			46		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	4.80	3.40	1.54	4.56	3.30	1.71	4.22	3.18	1.95	4.67	3.21	2.17	3.82	3.04	2.22	3.53	2.93	2.43
14.0	20.0	5.13	3.47	1.58	4.89	3.38	1.75	4.54	3.25	1.99	4.39	3.20	2.10	4.15	3.11	2.26	3.85	3.00	2.47
16.0	22.0	5.45	3.54	1.63	5.21	3.45	1.79	4.87	3.32	2.03	4.71	3.27	2.14	4.47	3.18	2.30	4.18	3.07	2.51
18.0	25.0	5.78	3.61	1.67	5.53	3.52	1.84	5.19	3.40	2.07	5.04	3.35	2.18	4.79	3.25	2.35	4.50	3.14	2.55
19.0	27.0	5.94	3.65	1.69	5.69	3.56	1.86	5.35	3.43	2.10	5.20	3.38	2.20	4.96	3.28	2.37	4.66	3.18	2.58
22.0	30.0	6.42	3.75	1.75	6.17	3.66	1.92	5.83	3.54	2.16	5.69	3.49	2.26	5.44	3.40	2.43	5.14	3.28	2.64
24.0	32.0	6.74	3.82	1.79	6.50	3.73	1.96	6.15	3.61	2.20	6.01	3.56	2.30	5.76	3.47	2.47	5.46	3.36	2.68

## R45GZ7V11 + FH45BZV1 + FHK45BZV1

Cooling capacity

230V [50Hz]

Model	FH..B	FHK..B
AFR	13	12
BF	0.09	0.18

Indoor		Outdoor temperature (°C)																	
EWB (°C)	EDB (°C)	20			25			32			35			40			46		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	4.78	3.38	1.51	4.54	3.28	1.68	4.20	3.16	1.91	4.04	3.10	2.02	3.81	3.02	2.18	3.52	2.91	2.39
14.0	20.0	5.11	3.45	1.55	4.87	3.36	1.72	4.52	3.23	1.95	4.37	3.18	2.06	4.13	3.09	2.22	3.84	2.98	2.43
16.0	22.0	5.43	3.52	1.60	5.19	3.43	1.76	4.85	3.30	1.99	4.69	3.25	2.10	4.45	3.16	2.26	4.16	3.05	2.46
18.0	25.0	5.76	3.59	1.64	5.51	3.50	1.81	5.17	3.38	2.03	5.02	3.33	2.14	4.77	3.23	2.31	4.48	3.12	2.50
19.0	27.0	5.92	3.63	1.66	5.67	3.54	1.83	5.33	3.41	2.06	5.18	3.36	2.16	4.94	3.26	2.33	4.64	3.16	2.53
22.0	30.0	6.40	3.73	1.72	6.15	3.64	1.89	5.81	3.52	2.12	5.67	3.47	2.22	5.42	3.38	2.39	5.12	3.26	2.59
24.0	32.0	6.71	3.80	1.76	6.48	3.71	1.92	6.13	3.59	2.16	5.99	3.54	2.26	5.74	3.45	2.43	5.44	3.34	2.63

Correction	TC	SHC	PI
FH..B	+0.02	+0.04	-0.01
FHK..B	0.0	+0.10	0.0

## R45GZ7V11 + FHB45GZ7V1

Cooling capacity

230V [50Hz]

Model	FHB
AFR	11.5
BF	0.15

Indoor		Outdoor temperature (°C)																	
EWB (°C)	EDB (°C)	20			25			32			35			40			46		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	4.52	3.20	1.56	4.30	3.10	1.73	3.98	2.99	1.98	3.83	2.94	2.09	3.60	2.86	2.25	3.33	2.76	2.46
14.0	20.0	4.83	3.26	1.60	4.61	3.18	1.77	4.28	3.06	2.02	4.14	3.01	2.13	3.91	2.93	2.29	3.63	2.82	2.50
16.0	22.0	5.14	3.33	1.65	4.91	3.25	1.81	4.59	3.12	2.06	4.44	3.08	2.17	4.21	2.99	2.33	3.94	2.89	2.54
18.0	25.0	5.45	3.40	1.69	5.21	3.31	1.87	4.89	3.20	2.10	4.75	3.15	2.21	4.51	3.06	2.38	4.24	2.95	2.58
19.0	27.0	5.60	3.43	1.71	5.36	3.35	1.89	5.04	3.23	2.13	4.90	3.18	2.23	4.67	3.09	2.40	4.39	2.99	2.62
22.0	30.0	6.05	3.53	1.77	5.81	3.44	1.95	5.49	3.33	2.19	5.36	3.28	2.29	5.13	3.20	2.46	4.84	3.09	2.68
24.0	32.0	6.35	3.59	1.81	6.13	3.51	1.99	5.80	3.40	2.23	5.66	3.35	2.33	5.43	3.26	2.50	5.15	3.16	2.72

3TW00904-2B

### SYMBOLS

AFR:	Air flow rate	(m <sup>3</sup> /min)
BF:	Bypass factor	
EWB:	Entering wet bulb temp.	(°CWB)
EDB:	Entering dry bulb temp.	(°CDB)
TC:	Total cooling capacity	(kW)
SHC:	Sensible heating capacity	(kW)
PI:	Power input	(kW)
	(comp.+indoor+outdoor fan motor)	

### NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat
- Shows nominal capacities
- SHC is based on each EWB and EDB  
SHC\* = SHC correction for other dry bulb  
SHC\* = 0.34 x 60 x AFR (m<sup>3</sup>/min) x (DB-EDB)/1000.  
Add SHC\* to SHC if SHC > TC, then TC equal SHC
- Direct interpolation is permissible Do not extrapolate.
- Capacities are based on the following conditions:  
Corresponding refrigerant piping length: 7.5 m  
Level difference: 0 m

**Caution:**  
TC and SHC are shown by kW

# 3 Capacity tables



3

## R45GZ7W11 + FHC45BZ7V1

Cooling capacity

400V [50Hz]

Model	FHC..B
AFR	15
BF	0.16

Indoor		Outdoor temperature (°C)																	
EWB (°C)	EDB (°C)	20			25			32			35			40			46		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	4.80	3.40	1.47	4.56	3.30	1.63	4.22	3.18	1.86	4.06	3.12	1.97	3.82	3.04	2.12	3.53	2.93	2.32
14.0	20.0	5.13	3.47	1.51	4.89	3.38	1.67	4.54	3.25	1.90	4.39	3.20	2.00	4.15	3.11	2.16	3.85	3.00	2.36
16.0	22.0	5.45	3.54	1.56	5.21	3.45	1.71	4.87	3.32	1.94	4.71	3.27	2.04	4.47	3.18	2.20	4.18	3.07	2.40
18.0	25.0	5.78	3.61	1.59	5.53	3.52	1.76	5.19	3.40	1.98	5.04	3.35	2.08	4.79	3.25	2.24	4.50	3.14	2.43
19.0	27.0	5.94	3.65	1.61	5.69	3.56	1.78	5.35	3.43	2.00	5.20	3.38	2.10	4.96	3.28	2.26	4.66	3.18	2.46
22.0	30.0	6.42	3.75	1.67	6.17	3.66	1.83	5.83	3.54	2.06	5.69	3.49	2.16	5.44	3.40	2.32	5.14	3.28	2.52
24.0	32.0	6.74	3.82	1.71	6.50	3.73	1.87	6.15	3.61	2.10	6.01	3.56	2.20	5.76	3.47	2.36	5.46	3.36	2.56

## R45GZ7W11 + FH45BZV1 + FHK45BZV1

Cooling capacity

400V [50Hz]

Model	FH..B	FHK..B
AFR	13	12
BF	0.09	0.18

Indoor		Outdoor temperature (°C)																	
EWB (°C)	EDB (°C)	20			25			32			35			40			46		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	4.78	3.38	1.44	4.54	3.28	1.60	4.20	3.16	1.83	4.04	3.10	1.93	3.81	3.02	2.08	3.52	2.91	2.28
14.0	20.0	5.11	3.45	1.48	4.87	3.36	1.64	4.52	3.23	1.86	4.37	3.18	1.97	4.13	3.09	2.12	3.84	2.98	2.31
16.0	22.0	5.43	3.52	1.53	5.19	3.43	1.68	4.85	3.30	1.90	4.69	3.25	2.00	4.45	3.16	2.15	4.16	3.05	2.35
18.0	25.0	5.76	3.59	1.56	5.51	3.50	1.72	5.17	3.38	1.94	5.02	3.33	2.04	4.77	3.23	2.20	4.48	3.12	2.39
19.0	27.0	5.92	3.63	1.58	5.67	3.54	1.74	5.33	3.41	1.97	5.18	3.36	2.06	4.94	3.26	2.22	4.64	3.16	2.42
22.0	30.0	6.40	3.73	1.64	6.15	3.64	1.80	5.81	3.52	2.02	5.67	3.47	2.12	5.42	3.38	2.28	5.12	3.26	2.47
24.0	32.0	6.71	3.80	1.68	6.48	3.71	1.84	6.13	3.59	2.06	5.99	3.54	2.15	5.74	3.45	2.31	5.44	3.34	2.51

Correction	TC	SHC	PI
FH..B	+0.02	+0.04	-0.01
FHK..B	0.0	+0.10	0.0

## R45GZ7W11 + FHB45GZ7V1

Cooling capacity

400V [50Hz]

Model	FHB
AFR	11.5
BF	0.15

Indoor		Outdoor temperature (°C)																	
EWB (°C)	EDB (°C)	20			25			32			35			40			46		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	4.52	3.20	1.49	4.30	3.10	1.66	3.98	2.99	1.89	3.83	2.94	1.99	3.60	2.86	2.15	3.33	2.76	2.35
14.0	20.0	4.83	3.26	1.53	4.61	3.18	1.69	4.28	3.06	1.93	4.14	3.01	2.03	3.91	2.93	2.19	3.63	2.82	2.39
16.0	22.0	5.14	3.33	1.58	4.91	3.25	1.73	4.59	3.12	1.97	4.44	3.08	2.07	4.21	2.99	2.23	3.94	2.89	2.43
18.0	25.0	5.45	3.40	1.62	5.21	3.31	1.78	4.89	3.20	2.00	4.75	3.15	2.11	4.51	3.06	2.28	4.24	2.95	2.47
19.0	27.0	5.60	3.43	1.64	5.36	3.35	1.80	5.04	3.23	2.03	4.90	3.18	2.13	4.67	3.09	2.29	4.392	.99	2.50
22.0	30.0	6.05	3.53	1.69	5.81	3.44	1.88	5.49	3.33	2.09	5.36	3.28	2.19	5.13	3.20	2.35	4.84	3.09	2.56
24.0	32.0	6.35	3.59	1.73	6.13	3.51	1.90	5.80	3.40	2.13	5.66	3.35	2.23	5.43	3.26	2.39	5.15	3.16	2.59

3TW00904-2B

### SYMBOLS

AFR:	Air flow rate	(m <sup>3</sup> /min)
BF:	Bypass factor	
EWB:	Entering wet bulb temp.	(°CWB)
EDB:	Entering dry bulb temp.	(°CDB)
TC:	Total cooling capacity	(kW)
SHC:	Sensible heating capacity	(kW)
PI:	Power input	(kW)
	(comp.+indoor+outdoor fan motor)	

**Caution:**  
TC and SHC are shown by kW

### NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat
- Shows nominal capacities
- SHC is based on each EWB and EDB  
SHC\* = SHC correction for other dry bulb  
SHC\* = 0.34 x 60 x AFR (m<sup>3</sup>/min) x (DB-EDB)/1000.  
Add SHC\* to SHC if SHC > TC, then TC equal SHC
- Direct interpolation is permissible Do not extrapolate.
- Capacities are based on the following conditions:  
Corresponding refrigerant piping length: 7.5 m  
Level difference: 0 m



# 3 Capacity tables



## R60GZ7W1 + FT60GZV1NB

Cooling capacity

400V [50Hz]

Model	FT
AFR	13.3
BF	0.15

3

Indoor		Outdoor temperature (°C)																	
EWB (°C)	EDB (°C)	20			25			32			35			40			46		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	6.09	4.46	1.74	5.82	4.39	1.96	5.44	4.28	2.26	5.28	4.24	2.39	5.01	4.16	2.60	4.69	4.07	2.86
14.0	20.0	6.44	4.52	1.79	6.17	4.45	2.01	5.79	4.34	2.31	5.63	4.30	2.44	5.36	4.22	2.66	5.04	4.13	2.92
16.0	22.0	6.79	4.58	1.85	6.52	4.51	2.06	6.14	4.40	2.37	5.98	4.36	2.50	5.71	4.28	2.71	5.38	4.19	2.97
18.0	25.0	7.14	4.64	1.90	6.87	4.57	2.12	6.49	4.46	2.42	6.33	4.42	2.55	6.06	4.34	2.77	5.73	4.25	3.03
19.0	27.0	7.31	4.67	1.93	7.04	4.60	2.15	6.66	4.49	2.45	6.50	4.45	2.58	6.23	4.37	2.80	5.91	4.28	3.06
22.0	30.0	7.83	4.76	2.01	7.56	4.69	2.23	7.18	4.58	2.53	7.02	4.54	2.66	6.75	4.46	2.88	6.43	4.37	3.14
24.0	32.0	8.18	4.82	2.07	7.91	4.75	2.28	7.53	4.64	2.59	7.37	4.60	2.72	7.10	4.52	2.93	6.78	4.43	3.19

3TW02102-1

## R60GZ7W1 + FHC60

+ FH60  
+ FHK60

Cooling capacity

400V [50Hz]

Model	FHC	FH	FHK
AFR	19.0	18.0	17.0
BF	0.10	0.10	0.10

Indoor		Outdoor temperature (°C)																	
EWB (°C)	EDB (°C)	20			25			32			35			40			46		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
12.0	18.0	5.98	4.05	1.89	5.78	3.97	2.07	5.49	3.87	2.35	5.36	3.82	2.47	5.13	3.76	2.70	4.84	3.66	3.01
14.0	20.0	6.32	4.11	1.94	6.12	4.03	2.11	5.81	3.93	2.39	5.67	3.88	2.53	5.43	3.81	2.77	5.12	3.73	3.08
16.0	22.0	6.67	4.18	1.97	6.46	4.09	2.16	6.14	3.99	2.45	5.99	3.94	2.58	5.74	3.87	2.83	5.41	3.79	3.15
18.0	25.0	7.04	4.24	2.01	6.82	4.16	2.21	6.48	4.05	2.51	6.33	4.00	2.64	6.06	3.93	2.89	5.71	3.84	3.21
19.0	27.0	7.23	4.26	2.03	7.01	4.19	2.23	6.66	4.08	2.53	6.50	4.03	2.67	6.22	3.96	2.93	5.86	3.87	3.24
22.0	30.0	7.82	4.35	2.10	7.58	4.27	2.31	7.21	4.18	2.62	7.03	4.13	2.77	6.73	4.05	3.02	6.34	3.96	3.34
24.0	32.0	8.22	4.41	2.15	7.97	4.33	2.36	7.59	4.24	2.68	7.40	4.19	2.83	7.08	4.11	3.08	6.67	4.02	3.41

3TW02102-2A

### SYMBOLS

AFR:	Air flow rate	(m <sup>3</sup> /min)
BF:	Bypass factor	
EWB:	Entering wet bulb temp.	(°CWB)
EDB:	Entering dry bulb temp.	(°CDB)
ED*:	Dry bulb temperature	(°CDB)
TC:	Total cooling capacity	(kW)
SHC:	Sensible heating capacity	(kW)
PI:	Power input	(kW)
	(comp.+indoor+outdoor fan motor)	

**Caution:**  
TC and SHC are shown by kW

### NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat
- Shows nominal capacities
- SHC is based on each EWB and EDB  
SHC\* = SHC correction for other dry bulb  
SHC\* = 0.34 x 60 x AFR (m<sup>3</sup>/min) x (DB-EDB)/1000.  
Add SHC\* to SHC if SHC > TC, then TC equal SHC
- Direct interpolation is permissible Do not extrapolate.
- Capacities are based on the following conditions:  
Corresponding refrigerant piping length: 7.5 m  
Level difference: 0 m

### 3 Capacity tables



3

RP(71~100)B7V1 + FAYP(71~100)BV1  
RP(71~100)B7W1

Cooling capacity

Outdoor	Indoor		Outdoor temperature (°C)																	
	EWB (°C)	EDB (°C)	20			25			32			35			40			46		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
71	12.0	18.0	6.2	4.9	1.86	6.1	4.8	2.12	5.7	4.7	2.30	5.5	4.6	2.47	5.3	4.5	2.74	4.9	4.2	3.00
	14.0	20.0	6.6	4.9	1.94	6.5	4.8	2.21	6.0	4.7	2.39	5.9	4.6	2.47	5.5	4.5	2.74	5.3	4.2	3.00
	16.0	22.0	7.2	5.0	1.94	7.0	4.9	2.21	6.5	4.8	2.39	6.3	4.7	2.56	6.0	4.6	2.83	5.5	4.3	3.09
	18.0	25.0	7.7	5.2	2.03	7.5	5.0	2.21	7.2	4.9	2.47	6.8	4.8	2.65	6.4	4.6	2.83	6.0	4.5	3.18
	19.0	27.0	8.0	5.3	2.03	7.7	5.2	2.21	7.3	5.0	2.47	7.1	4.8	2.65	6.6	4.7	2.92	6.2	4.6	3.18
	19.5	27.0	8.0	5.3	2.03	7.9	5.2	2.21	7.4	5.0	2.47	7.2	4.8	2.65	6.7	4.7	2.92	6.3	4.6	3.18
	22.0	30.0	8.7	5.4	2.12	8.5	5.3	2.30	8.0	5.2	2.56	7.9	4.9	2.74	7.4	4.8	2.92	6.8	4.6	3.27
	24.0	32.0	9.4	5.4	2.12	9.1	5.3	2.30	8.6	5.2	2.65	8.4	5.0	2.74	8.0	4.8	3.00	7.4	4.6	3.36
100	12.0	18.0	8.3	7.2	2.49	8.3	7.1	2.77	8.1	6.9	3.14	7.8	6.8	3.33	7.5	6.4	3.69	6.9	6.2	4.06
	14.0	20.0	8.9	7.2	2.59	8.8	7.1	2.77	8.6	6.9	3.14	8.3	6.8	3.33	7.8	6.4	3.69	7.5	6.2	4.06
	16.0	22.0	10.1	7.3	2.59	9.8	7.2	2.86	9.1	7.0	3.23	8.9	6.9	3.42	8.4	6.5	3.79	7.8	6.3	4.16
	18.0	25.0	10.8	7.6	2.68	10.5	7.5	2.86	9.8	7.1	3.23	9.6	7.0	3.42	9.0	6.8	3.79	8.3	6.4	4.25
	19.0	27.0	11.1	7.7	2.68	10.8	7.6	2.96	10.1	7.2	3.33	10.0	7.1	3.51	9.4	6.9	3.88	8.6	6.5	4.34
	19.5	27.0	11.2	7.7	2.68	11.0	7.6	2.96	10.3	7.2	3.33	10.1	7.1	3.51	9.5	6.9	3.88	8.8	6.5	4.34
	22.0	30.0	12.2	7.8	2.77	11.8	7.7	2.96	11.2	7.3	3.42	11.0	7.2	3.60	10.4	7.1	3.97	9.6	6.8	4.43
	24.0	32.0	13.0	7.9	2.86	12.7	7.8	3.05	11.9	7.5	3.51	11.7	7.3	3.69	11.1	7.2	4.06	10.3	6.9	4.53

3TW23282-6

**SYMBOLS**

- AFR: Air flow rate (m<sup>3</sup>/min)
- BF: Bypass factor
- EWB: Entering wet bulb temp. (°CWB)
- EDB: Entering dry bulb temp. (°CDB)
- DB\*: Dry bulb temperature (°CDB)
- TC: Total cooling capacity (kW)
- SHC: Sensible heating capacity (kW)
- PI: Power input (kW)
- (comp.+indoor+outdoor fan motor)

**Caution:**

TC and SHC are shown by kW  
V1: 230V [50Hz]  
W1: 400V [50Hz]

**NOTES**

1. Ratings shown are net capacities which include a deduction for indoor fan motor heat
2.  Shows nominal capacities
3. SHC is based on each EWB and EDB  
SHC\* = SHC correction for other dry bulb  
SHC\* = 0.29 x 60 x AFR (m<sup>3</sup>/min) x (DB-EDB)/860.  
Add SHC\* to SHC if SHC > TC, then TC equal SHC
4. Direct interpolation is permissible.  
Do not extrapolate..
5. Capacities are based on the following conditions:  
Corresponding refrigerant piping length: 7.5 m  
Level difference: 0 m

6. Air flow rate and BF are tabulated below.

Model		FAYP
71	AFR	19
	BF	0.1
100	AFR	23
	BF	0.1

7. Add the following correction value to power input (kW) of each unit

Model	Supply	FAYP
71	V1	0.1
	W1	0
100	V1	0.2
	W1	0

# 3 Capacity tables



RP71B7V1 + FHYKP71BV1  
RP71B7W1

3

**Cooling capacity**

Outdoor	Indoor		Outdoor temperature (°C)																	
	EWB (°C)	EDB (°C)	20			25			32			35			40			46		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
71	12.0	18.0	6.2	4.9	1.83	6.1	4.8	2.10	5.7	4.7	2.27	5.5	4.6	2.45	5.3	4.5	2.71	4.9	4.2	2.97
	14.0	20.0	6.6	4.9	1.92	6.5	4.8	2.18	6.0	4.7	2.36	5.9	4.6	2.45	5.5	4.5	2.71	5.3	4.2	2.97
	16.0	22.0	7.2	5.0	1.92	7.0	4.9	2.18	6.5	4.8	2.36	6.3	4.7	2.53	6.0	4.6	2.79	5.5	4.3	3.06
	18.0	25.0	7.7	5.2	2.01	7.5	5.0	2.18	7.2	4.9	2.45	6.8	4.8	2.62	6.4	4.6	2.79	6.0	4.5	3.14
	19.0	27.0	8.0	5.3	2.01	7.7	5.2	2.18	7.3	5.0	2.45	7.1	4.8	2.62	6.6	4.7	2.88	6.2	4.6	3.14
	19.5	27.0	8.0	5.3	2.01	7.9	5.2	2.18	7.4	5.0	2.45	7.2	4.8	2.62	6.7	4.7	2.88	6.3	4.6	3.14
	22.0	30.0	8.7	5.4	2.10	8.5	5.3	2.27	8.0	5.2	2.53	7.9	4.9	2.71	7.4	4.8	2.88	6.8	4.6	3.23
	24.0	32.0	9.4	5.4	2.10	9.1	5.3	2.27	8.6	5.2	2.62	8.4	5.0	2.71	8.0	4.8	2.97	7.4	4.6	3.32

3TW23282-7

**SYMBOLS**

- AFR: Air flow rate (m<sup>3</sup>/min)
- BF: Bypass factor
- EWB: Entering wet bulb temp. (°CWB)
- EDB: Entering dry bulb temp. (°CDB)
- DB\*: Dry bulb temperature (°CDB)
- TC: Total cooling capacity (kW)
- SHC: Sensible heating capacity (kW)
- PI: Power input (comp.+indoor+outdoor fan motor) (kW)

**Caution:**

TC and SHC are shown by kW  
V1: 230V [50Hz]  
W1: 400V [50Hz]

**NOTES**

1. Ratings shown are net capacities which include a deduction for indoor fan motor heat
2.  Shows nominal capacities
3. SHC is based on each EWB and EDB  
SHC\* = SHC correction for other dry bulb  
SHC\* = 0.29 x 60 x AFR (m<sup>3</sup>/min) x (DB-EDB)/860.  
Add SHC\* to SHC if SHC > TC, then TC equal SHC
4. Direct interpolation is permissible.  
Do not extrapolate..
5. Capacities are based on the following conditions:  
Corresponding refrigerant piping length: 7.5 m  
Level difference: 0 m

6. Air flow rate and BF are tabulated below.

Model		FHYKP
71	AFR	17
	BF	0.07

7. Add the following correction value to power input (kW) of each unit

Model	Supply	FHYKP
71	V1	0.2
	W1	0

# 3 Capacity tables



3

RP(71~100)B7V1 + FHYCP(71~125)B7V1  
 RP(71~125)B7W1  
 RP(71~125)B7T1

## Cooling capacity

Outdoor	Indoor		Outdoor temperature (°C)																	
	EWB (°C)	EDB (°C)	20			25			32			35			40			46		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
71	12.0	18.0	6.2	4.8	1.81	6.1	4.7	2.06	5.7	4.6	2.24	5.5	4.5	2.41	5.3	4.4	2.67	4.9	4.1	2.92
	14.0	20.0	6.6	4.8	1.89	6.5	4.7	2.15	6.0	4.6	2.32	5.9	4.5	2.41	5.5	4.4	2.67	5.3	4.1	2.92
	16.0	22.0	7.2	4.9	1.89	7.0	4.8	2.15	6.5	4.7	2.32	6.3	4.6	2.49	6.0	4.5	2.75	5.5	4.2	3.01
	18.0	25.0	7.7	5.1	1.98	7.5	4.9	2.15	7.2	4.8	2.41	6.8	4.7	2.58	6.4	4.5	2.75	6.0	4.4	3.10
	19.0	27.0	8.0	5.2	1.98	7.7	5.1	2.15	7.3	4.9	2.41	7.1	4.7	2.58	6.6	4.6	2.84	6.2	4.5	3.10
	19.5	27.0	8.0	5.2	1.98	7.9	5.1	2.15	7.4	4.9	2.41	7.2	4.7	2.58	6.7	4.6	2.84	6.3	4.5	3.10
	22.0	30.0	8.7	5.3	2.06	8.5	5.2	2.24	8.0	5.1	2.49	7.9	4.8	2.67	7.4	4.7	2.84	6.8	4.5	3.18
24.0	32.0	9.4	5.3	2.06	9.1	5.2	2.24	8.6	5.1	2.58	8.4	4.9	2.67	8.0	4.7	2.92	7.4	4.5	3.27	
100	12.0	18.0	8.3	7.0	2.52	8.3	6.9	2.80	8.1	6.7	3.18	7.8	6.6	3.36	7.5	6.2	3.74	6.9	6.0	4.11
	14.0	20.0	8.9	7.0	2.62	8.8	6.9	2.80	8.6	6.7	3.18	8.3	6.6	3.36	7.8	6.2	3.74	7.5	6.0	4.11
	16.0	22.0	10.1	7.1	2.62	9.8	7.0	2.90	9.1	6.8	3.27	8.9	6.7	3.46	8.4	6.3	3.83	7.8	6.1	4.20
	18.0	25.0	10.8	7.4	2.71	10.5	7.3	2.90	9.8	6.9	3.27	9.6	6.8	3.46	9.0	6.6	3.83	8.3	6.2	4.30
	19.0	27.0	11.1	7.5	2.71	10.8	7.4	2.99	10.1	7.0	3.36	10.0	6.9	3.55	9.4	6.7	3.92	8.6	6.3	4.39
	19.5	27.0	11.2	7.5	2.71	11.0	7.4	2.99	10.3	7.0	3.36	10.1	6.9	3.55	9.5	6.7	3.92	8.8	6.3	4.39
	22.0	30.0	12.2	7.6	2.80	11.8	7.5	2.99	11.2	7.1	3.46	11.0	7.0	3.64	10.4	6.9	4.02	9.6	6.6	4.48
24.0	32.0	13.0	7.7	2.90	12.7	7.6	3.08	11.9	7.3	3.55	11.7	7.1	3.74	11.1	7.0	4.11	10.3	6.7	4.58	
125	12.0	18.0	11.1	9.1	3.39	10.8	8.8	3.68	10.0	8.3	3.98	9.7	8.2	4.28	9.2	8.0	4.68	8.6	7.6	5.38
	14.0	20.0	11.8	9.1	3.48	11.4	8.8	3.68	10.7	8.3	4.08	10.4	8.2	4.38	9.8	8.0	4.78	9.2	7.6	5.38
	16.0	22.0	12.7	9.2	3.48	12.1	8.9	3.78	11.4	8.4	4.08	11.1	8.3	4.48	10.4	8.1	4.88	9.7	7.7	5.48
	18.0	25.0	13.3	9.5	3.58	13.0	9.1	3.78	12.1	8.7	4.18	11.8	8.6	4.58	11.2	8.3	4.98	10.4	8.0	5.48
	19.0	27.0	13.6	9.6	3.68	13.3	9.1	3.88	12.7	8.8	4.28	12.2	8.6	4.58	11.5	8.4	5.08	10.8	8.1	5.58
	19.5	27.0	13.8	9.6	3.68	13.5	9.1	3.88	12.8	8.8	4.28	12.4	8.7	4.58	11.7	8.4	5.08	11.0	8.1	5.58
	22.0	30.0	15.1	9.7	3.78	14.6	9.4	3.88	13.7	9.0	4.38	13.4	8.9	4.68	12.9	8.7	5.18	12.0	8.3	5.77
24.0	32.0	15.9	9.8	3.78	15.5	9.5	3.98	14.6	9.1	4.48	14.3	9.0	4.78	13.6	8.8	5.28	12.9	8.6	5.87	

3TW23282-1

### SYMBOLS

AFR:	Air flow rate	(m <sup>3</sup> /min)
BF:	Bypass factor	
EWB:	Entering wet bulb temp.	(°CWB)
EDB:	Entering dry bulb temp.	(°CDB)
ED*:	Dry bulb temperature	(°CDB)
TC:	Total cooling capacity	(kW)
SHC:	Sensible heating capacity	(kW)
PI:	Power input	(kW)
	(comp.+indoor+outdoor fan motor)	

### Caution:

TC and SHC are shown by kW  
 V1/T1: 230V [50Hz]  
 W1: 400V [50Hz]

### NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat
- Shows nominal capacities
- SHC is based on each EWB and EDB  
 SHC\* = SHC correction for other dry bulb  
 SHC\* = 0.29 x 60 x AFR (m<sup>3</sup>/min) x (DB-EDB)/860.  
 Add SHC\* to SHC if SHC > TC, then TC equal SHC
- Direct interpolation is permissible.  
 Do not extrapolate..
- Capacities are based on the following conditions:  
 Corresponding refrigerant piping length: 7.5 m  
 Level difference: 0 m

6. Air flow rate and BF are tabulated below.

Model		FHYCP
71	AFR	19
	BF	0.1
100	AFR	28
	BF	0.16
125	AFR	33
	BF	0.07

7. Add the following correction value to power input (kW) of each unit

Model	Supply	FHYCP
71	V1	0.04
	W1	0.00
100	V1	0.22
	W1	0.00
125	W1	0.00

# 3 Capacity tables



RP(71~100)B7V1 + FHYBP(71~125)B7V1  
 RP(71~125)B7W1  
 RP(71~125)B7T1

### Cooling capacity

Outdoor	Indoor		Outdoor temperature (°C)																	
	EWB (°C)	EDB (°C)	20			25			32			35			40			46		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
71	12.0	18.0	6.2	4.8	1.89	6.1	4.7	2.16	5.7	4.6	2.34	5.5	4.5	2.52	5.3	4.4	2.79	4.9	4.1	3.06
	14.0	20.0	6.6	4.8	1.98	6.5	4.7	2.25	6.0	4.6	2.43	5.9	4.5	2.52	5.5	4.4	2.79	5.3	4.1	3.06
	16.0	22.0	7.2	4.9	1.98	7.0	4.8	2.25	6.5	4.7	2.43	6.3	4.6	2.61	6.0	4.5	2.88	5.5	4.2	3.15
	18.0	25.0	7.7	5.1	2.07	7.5	4.9	2.25	7.2	4.8	2.52	6.8	4.7	2.70	6.4	4.5	2.88	6.0	4.4	3.24
	19.0	27.0	8.0	5.2	2.07	7.7	5.1	2.25	7.3	4.9	2.52	7.1	4.7	2.70	6.6	4.6	2.97	6.2	4.5	3.24
	19.5	27.0	8.0	5.2	2.07	7.9	5.1	2.25	7.4	4.9	2.52	7.2	4.7	2.70	6.7	4.6	2.97	6.3	4.5	3.24
	22.0	30.0	8.7	5.3	2.16	8.5	5.2	2.34	8.0	5.1	2.61	7.9	4.8	2.79	7.4	4.7	2.97	6.8	4.5	3.33
24.0	32.0	9.4	5.3	2.16	9.1	5.2	2.34	8.6	5.1	2.70	8.4	4.9	2.79	8.0	4.7	3.06	7.4	4.5	3.42	
100	12.0	18.0	8.3	7.0	2.52	8.3	6.9	2.80	8.1	6.7	3.18	7.8	6.6	3.36	7.5	6.2	3.74	6.9	6.0	4.11
	14.0	20.0	8.9	7.0	2.62	8.8	6.9	2.80	8.6	6.7	3.18	8.3	6.6	3.36	7.8	6.2	3.74	7.5	6.0	4.11
	16.0	22.0	10.1	7.1	2.62	9.8	7.0	2.90	9.1	6.8	3.27	8.9	6.7	3.46	8.4	6.3	3.83	7.8	6.1	4.20
	18.0	25.0	10.8	7.4	2.71	10.5	7.3	2.90	9.8	6.9	3.27	9.6	6.8	3.46	9.0	6.6	3.83	8.3	6.2	4.30
	19.0	27.0	11.1	7.5	2.71	10.8	7.4	2.99	10.1	7.0	3.36	10.0	6.9	3.55	9.4	6.7	3.92	8.6	6.3	4.39
	19.5	27.0	11.2	7.5	2.71	11.0	7.4	2.99	10.3	7.0	3.36	10.1	6.9	3.55	9.5	6.7	3.92	8.8	6.3	4.39
	22.0	30.0	12.2	7.6	2.80	11.8	7.5	2.99	11.2	7.1	3.46	11.0	7.0	3.64	10.4	6.9	4.02	9.6	6.6	4.48
24.0	32.0	13.0	7.7	2.90	12.7	7.6	3.08	11.9	7.3	3.55	11.7	7.1	3.74	11.1	7.0	4.11	10.3	6.7	4.58	
125	12.0	18.0	11.1	9.1	3.39	10.8	8.8	3.68	10.0	8.3	3.98	9.7	8.2	4.28	9.2	8.0	4.68	8.6	7.6	5.38
	14.0	20.0	11.8	9.1	3.48	11.4	8.8	3.68	10.7	8.3	4.08	10.4	8.2	4.38	9.8	8.0	4.78	9.2	7.6	5.38
	16.0	22.0	12.7	9.2	3.48	12.1	8.9	3.78	11.4	8.4	4.08	11.1	8.3	4.48	10.4	8.1	4.88	9.7	7.7	5.48
	18.0	25.0	13.3	9.5	3.58	13.0	9.1	3.78	12.1	8.7	4.18	11.8	8.6	4.58	11.2	8.3	4.98	10.4	8.0	5.48
	19.0	27.0	13.6	9.6	3.68	13.3	9.1	3.88	12.7	8.8	4.28	12.2	8.6	4.58	11.5	8.4	5.08	10.8	8.1	5.58
	19.5	27.0	13.8	9.6	3.68	13.5	9.1	3.88	12.8	8.8	4.28	12.4	8.7	4.58	11.7	8.4	5.08	11.0	8.1	5.58
	22.0	30.0	15.1	9.7	3.78	14.6	9.4	3.88	13.7	9.0	4.38	13.4	8.9	4.68	12.9	8.7	5.18	12.0	8.3	5.77
24.0	32.0	15.9	9.8	3.78	15.5	9.5	3.98	14.6	9.1	4.48	14.3	9.0	4.78	13.6	8.8	5.28	12.9	8.6	5.87	

3TW23282-2

### SYMBOLS

- AFR: Air flow rate (m<sup>3</sup>/min)
- BF: Bypass factor
- EWB: Entering wet bulb temp. (°CWB)
- EDB: Entering dry bulb temp. (°CDB)
- ED\*: Dry bulb temperature (°CDB)
- TC: Total cooling capacity (kW)
- SHC: Sensible heating capacity (kW)
- PI: Power input (kW)
- (comp.+indoor+outdoor fan motor)

### Caution:

TC and SHC are shown by kW  
 V1/T1: 230V [50Hz]  
 W1: 400V [50Hz]

### NOTES

1. Ratings shown are net capacities which include a deduction for indoor fan motor heat
2.  Shows nominal capacities
3. SHC is based on each EWB and EDB  
 SHC\* = SHC correction for other dry bulb  
 SHC\* = 0.29 x 60 x AFR (m<sup>3</sup>/min) x (DB-EDB)/860.  
 Add SHC\* to SHC if SHC > TC, then TC equal SHC
4. Direct interpolation is permissible.  
 Do not extrapolate..
5. Capacities are based on the following conditions:  
 Corresponding refrigerant piping length: 7.5 m  
 Level difference: 0 m

6. Air flow rate and BF are tabulated below.

Model		FHYBP
71	AFR	19
	BF	0.11
100	AFR	27
	BF	0.2
125	AFR	35
	BF	0.14

7. Add the following correction value to power input (kW) of each unit

Model	Supply	FHYBP
71	V1	0.04
	W1	0.00
100	V1	0.17
	W1	0.00
125	W1	0.00

### 3 Capacity tables



#### 3 RP125B7W1 + FDYP125B7V1 RP125B7T1

##### Cooling capacity

Outdoor	Indoor		Outdoor temperature (°C)																	
	EWB (°C)	EDB (°C)	20			25			32			35			40			46		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
125	12.0	18.0	11.2	10.5	3.47	10.9	10.1	3.78	10.2	9.6	4.09	9.9	9.5	4.39	9.4	9.2	4.80	8.7	8.8	5.52
	14.0	20.0	12.0	10.5	3.58	11.6	10.1	3.78	10.9	9.6	4.19	10.6	9.5	4.50	10.0	9.2	4.90	9.4	8.8	5.52
	16.0	22.0	12.9	10.6	3.58	12.3	10.2	3.88	11.6	9.7	4.19	11.2	9.6	4.60	10.6	9.4	5.01	9.9	8.9	5.62
	18.0	25.0	13.6	10.9	3.68	13.2	10.5	3.88	12.3	10.0	4.29	12.0	9.9	4.70	11.3	9.6	5.11	10.6	9.2	5.62
	19.0	27.0	13.9	11.0	3.78	13.6	10.5	3.98	12.9	10.1	4.39	12.4	9.9	4.70	11.7	9.7	5.21	10.9	9.4	5.72
	19.5	27.0	14.0	11.0	3.78	13.8	10.5	3.98	13.0	10.1	4.39	12.6	10.0	4.70	11.9	9.7	5.21	11.1	9.4	5.72
	22.0	30.0	15.3	11.2	3.88	14.8	10.8	3.98	14.0	10.3	4.50	13.7	10.2	4.80	13.1	10.0	5.31	12.2	9.6	5.93
	24.0	32.0	16.2	11.3	3.88	15.8	10.9	4.09	14.8	10.5	4.60	14.5	10.3	4.90	13.9	10.1	5.42	13.1	9.9	6.03

3TW23382-3

#### SYMBOLS

AFR:	Air flow rate	(m <sup>3</sup> /min)
BF:	Bypass factor	
EWB:	Entering wet bulb temp.	(°CWB)
EDB:	Entering dry bulb temp.	(°CDB)
DB*:	Dry bulb temperature	(°CDB)
TC:	Total cooling capacity	(kW)
SHC:	Sensible heating capacity	(kW)
PI:	Power input	(kW)
	(comp.+indoor+outdoor fan motor)	

#### Caution:

TC and SHC are shown by kW  
 V1/T1: 230V [50Hz]  
 W1: 400V [50Hz]

6. Air flow rate and BF are tabulated below.

Model		FDYP
125	AFR	45
	BF	0.25

#### NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat
- Shows nominal capacities
- SHC is based on each EWB and EDB  
 SHC\* = SHC correction for other dry bulb  
 SHC\* = 0.29 x 60 x AFR (m<sup>3</sup>/min) x (DB-EDB)/860.  
 Add SHC\* to SHC if SHC > TC, then TC equal SHC
- Direct interpolation is permissible.  
 Do not extrapolate..
- Capacities are based on the following conditions:  
 Corresponding refrigerant piping length: 7.5 m  
 Level difference: 0 m

# 3 Capacity tables



RP(71~100)B7V1 + FHYP(71~125)BV1  
RP(71~125)B7W1

3

### Cooling capacity

Outdoor	Indoor		Outdoor temperature (°C)																	
	EWB (°C)	EDB (°C)	20			25			32			35			40			46		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
71	12.0	18.0	6.2	4.8	1.83	6.1	4.7	2.09	5.7	4.6	2.26	5.5	4.5	2.44	5.3	4.4	2.70	4.9	4.1	2.96
	14.0	20.0	6.6	4.8	1.91	6.5	4.7	2.18	6.0	4.6	2.35	5.9	4.5	2.44	5.5	4.4	2.70	5.3	4.1	2.96
	16.0	22.0	7.2	4.9	1.91	7.0	4.8	2.18	6.5	4.7	2.35	6.3	4.6	2.52	6.0	4.5	2.78	5.5	4.2	3.05
	18.0	25.0	7.7	5.1	2.00	7.5	4.9	2.18	7.2	4.8	2.44	6.8	4.7	2.61	6.4	4.5	2.78	6.0	4.4	3.13
	19.0	27.0	8.0	5.2	2.00	7.7	5.1	2.18	7.3	4.9	2.44	7.1	4.7	2.61	6.6	4.6	2.87	6.2	4.5	3.13
	19.5	27.0	8.0	5.2	2.00	7.9	5.1	2.18	7.4	4.9	2.44	7.2	4.7	2.61	6.7	4.6	2.87	6.3	4.5	3.13
	22.0	30.0	8.7	5.3	2.09	8.5	5.2	2.26	8.0	5.1	2.52	7.9	4.8	2.70	7.4	4.7	2.87	6.8	4.5	3.22
	24.0	32.0	9.4	5.3	2.09	9.1	5.2	2.26	8.6	5.1	2.61	8.4	4.9	2.70	8.0	4.7	2.96	7.4	4.5	3.31
100	12.0	18.0	8.3	7.0	2.57	8.3	6.9	2.86	8.1	6.7	3.24	7.8	6.6	3.43	7.5	6.2	3.81	6.9	6.0	4.19
	14.0	20.0	8.9	7.0	2.67	8.8	6.9	2.86	8.6	6.7	3.24	8.3	6.6	3.43	7.8	6.2	3.81	7.5	6.0	4.19
	16.0	22.0	10.1	7.1	2.67	9.8	7.0	2.95	9.1	6.8	3.33	8.9	6.7	3.52	8.4	6.3	3.91	7.8	6.1	4.29
	18.0	25.0	10.8	7.4	2.76	10.5	7.3	2.95	9.8	6.9	3.33	9.6	6.8	3.52	9.0	6.6	3.91	8.3	6.2	4.38
	19.0	27.0	11.1	7.5	2.76	10.8	7.4	3.05	10.1	7.0	3.43	10.0	6.9	3.62	9.4	6.7	4.00	8.6	6.3	4.48
	19.5	27.0	11.2	7.5	2.76	11.0	7.4	3.05	10.3	7.0	3.43	10.1	6.9	3.62	9.5	6.7	4.00	8.8	6.3	4.48
	22.0	30.0	12.2	7.6	2.86	11.8	7.5	3.05	11.2	7.1	3.52	11.0	7.0	3.72	10.4	6.9	4.10	9.6	6.6	4.57
	24.0	32.0	13.0	7.7	2.95	12.7	7.6	3.14	11.9	7.3	3.62	11.7	7.1	3.81	11.1	7.0	4.19	10.3	6.7	4.67
125	12.0	18.0	11.3	9.1	3.47	11.0	8.8	3.77	10.3	8.3	4.08	10.0	8.2	4.38	9.5	8.0	4.79	8.8	7.6	5.51
	14.0	20.0	12.1	9.1	3.57	11.7	8.8	3.77	10.9	8.3	4.18	10.6	8.2	4.49	10.1	8.0	4.89	9.5	7.6	5.51
	16.0	22.0	13.0	9.2	3.57	12.4	8.9	3.87	11.7	8.4	4.18	11.3	8.3	4.59	10.6	8.1	5.00	10.0	7.7	5.61
	18.0	25.0	13.7	9.5	3.67	13.3	9.1	3.87	12.4	8.7	4.28	12.1	8.6	4.69	11.4	8.3	5.10	10.6	8.0	5.61
	19.0	27.0	14.0	9.6	3.77	13.7	9.1	3.98	13.0	8.8	4.38	12.5	8.6	4.69	11.8	8.4	5.20	11.0	8.1	5.71
	19.5	27.0	14.2	9.6	3.77	13.9	9.1	3.98	13.1	8.8	4.38	12.7	8.7	4.69	12.0	8.4	5.20	11.2	8.1	5.71
	22.0	30.0	15.4	9.7	3.87	14.9	9.4	3.98	14.1	9.0	4.49	13.8	8.9	4.79	13.2	8.7	5.30	12.3	8.3	5.91
	24.0	32.0	16.3	9.8	3.87	15.9	9.5	4.08	14.9	9.1	4.59	14.6	9.0	4.89	14.0	8.8	5.40	13.2	8.6	6.02

3TW23282-4

### SYMBOLS

AFR:	Air flow rate	(m <sup>3</sup> /min)
BF:	Bypass factor	
EWB:	Entering wet bulb temp.	(°CWB)
EDB:	Entering dry bulb temp.	(°CDB)
ED*:	Dry bulb temperature	(°CDB)
TC:	Total cooling capacity	(kW)
SHC:	Sensible heating capacity	(kW)
PI:	Power input	(kW)
	(comp.+indoor+outdoor fan motor)	

6. Air flow rate and BF are tabulated below.

Model		FHYP
71	AFR	17
	BF	0.1
100	AFR	24
	BF	0.14
125	AFR	30
	BF	0.13

### Caution:

TC and SHC are shown by kW  
V1/T1: 230V [50Hz]  
W1: 400V [50Hz]

7. Add the following correction value to power input (kW) of each unit

Model	Supply	FHYP
71	V1	0.04
	W1	0.00
100	V1	0.20
	W1	0.00
125	W1	0.00

### NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat
- Shows nominal capacities
- SHC is based on each EWB and EDB  
SHC\* = SHC correction for other dry bulb  
SHC\* = 0.29 x 60 x AFR (m<sup>3</sup>/min) x (DB-EDB)/860.  
Add SHC\* to SHC if SHC > TC, then TC equal SHC
- Direct interpolation is permissible.  
Do not extrapolate..
- Capacities are based on the following conditions:  
Corresponding refrigerant piping length: 7.5 m  
Level difference: 0 m

# 3 Capacity tables



3

RP(71~100)B7V1 + FUYP(71~125)BV1  
RP(71~125)B7W1

## Cooling capacity

Outdoor	Indoor		Outdoor temperature (°C)																	
	EWB (°C)	EDB (°C)	20			25			32			35			40			46		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
71	12.0	18.0	6.2	4.9	1.85	6.1	4.8	2.11	5.7	4.7	2.29	5.5	4.6	2.46	5.3	4.5	2.73	4.9	4.2	2.99
	14.0	20.0	6.6	4.9	1.94	6.5	4.8	2.20	6.0	4.7	2.38	5.9	4.6	2.46	5.5	4.5	2.73	5.3	4.2	2.99
	16.0	22.0	7.2	5.0	1.94	7.0	4.9	2.20	6.5	4.8	2.38	6.3	4.7	2.55	6.0	4.6	2.82	5.5	4.3	3.08
	18.0	25.0	7.7	5.2	2.02	7.5	5.0	2.20	7.2	4.9	2.46	6.8	4.8	2.64	6.4	4.6	2.82	6.0	4.5	3.17
	19.0	27.0	8.0	5.3	2.02	7.7	5.2	2.20	7.3	5.0	2.46	7.1	4.8	2.64	6.6	4.7	2.90	6.2	4.6	3.17
	19.5	27.0	8.0	5.3	2.02	7.9	5.2	2.20	7.4	5.0	2.46	7.2	4.8	2.64	6.7	4.7	2.90	6.3	4.6	3.17
	22.0	30.0	8.7	5.4	2.11	8.5	5.3	2.29	8.0	5.2	2.55	7.9	4.9	2.73	7.4	4.8	2.90	6.8	4.6	3.26
	24.0	32.0	9.4	5.4	2.11	9.1	5.3	2.29	8.6	5.2	2.64	8.4	5.0	2.73	8.0	4.8	2.99	7.4	4.6	3.34
100	12.0	18.0	8.3	7.2	2.57	8.3	7.1	2.85	8.1	6.9	3.23	7.8	6.8	3.42	7.5	6.4	3.80	6.9	6.2	4.18
	14.0	20.0	8.9	7.2	2.66	8.8	7.1	2.85	8.6	6.9	3.23	8.3	6.8	3.42	7.8	6.4	3.80	7.5	6.2	4.18
	16.0	22.0	10.1	7.3	2.66	9.8	7.2	2.95	9.1	7.0	3.33	8.9	6.9	3.52	8.4	6.5	3.90	7.8	6.3	4.28
	18.0	25.0	10.8	7.6	2.76	10.5	7.5	2.95	9.8	7.1	3.33	9.6	7.0	3.52	9.0	6.8	3.90	8.3	6.4	4.37
	19.0	27.0	11.1	7.7	2.76	10.8	7.6	3.04	10.1	7.2	3.42	10.0	7.1	3.61	9.4	6.9	3.99	8.6	6.5	4.47
	19.5	27.0	11.2	7.7	2.76	11.0	7.6	3.04	10.3	7.2	3.42	10.1	7.1	3.61	9.5	6.9	3.99	8.8	6.5	4.47
	22.0	30.0	12.2	7.8	2.85	11.8	7.7	3.04	11.2	7.3	3.52	11.0	7.2	3.71	10.4	7.1	4.09	9.6	6.8	4.56
	24.0	32.0	13.0	7.9	2.95	12.7	7.8	3.14	11.9	7.5	3.61	11.7	7.3	3.80	11.1	7.2	4.18	10.3	6.9	4.66
125	12.0	18.0	11.3	9.5	3.44	11.0	9.2	3.75	10.3	8.7	4.05	10.0	8.6	4.36	9.5	8.4	4.76	8.8	8.0	5.47
	14.0	20.0	12.1	9.5	3.55	11.7	9.2	3.75	10.9	8.7	4.15	10.6	8.6	4.46	10.1	8.4	4.86	9.5	8.0	5.47
	16.0	22.0	13.0	9.6	3.55	12.4	9.3	3.85	11.7	8.8	4.15	11.3	8.7	4.56	10.6	8.5	4.96	10.0	8.1	5.57
	18.0	25.0	13.7	9.9	3.65	13.3	9.5	3.85	12.4	9.1	4.25	12.1	9.0	4.66	11.4	8.7	5.07	10.6	8.4	5.57
	19.0	27.0	14.0	10.0	3.75	13.7	9.5	3.95	13.0	9.2	4.36	12.5	9.0	4.66	11.8	8.8	5.17	11.0	8.5	5.67
	19.5	27.0	14.2	10.0	3.75	13.9	9.5	3.95	13.1	9.2	4.36	12.7	9.1	4.66	12.0	8.8	5.17	11.2	8.5	5.67
	22.0	30.0	15.4	10.2	3.85	14.9	9.8	3.95	14.1	9.4	4.46	13.8	9.3	4.76	13.2	9.1	5.27	12.3	8.7	5.88
	24.0	32.0	16.3	10.3	3.85	15.9	9.9	4.05	14.9	9.5	4.56	14.6	9.4	4.86	14.0	9.2	5.37	13.2	9.0	5.98

3TW23282-5

### SYMBOLS

AFR:	Air flow rate	(m <sup>3</sup> /min)
BF:	Bypass factor	
EWB:	Entering wet bulb temp.	(°CWB)
EDB:	Entering dry bulb temp.	(°CDB)
ED*:	Dry bulb temperature	(°CDB)
TC:	Total cooling capacity	(kW)
SHC:	Sensible heating capacity	(kW)
PI:	Power input	(kW)
	(comp.+indoor+outdoor fan motor)	

### Caution:

TC and SHC are shown by kW  
V1: 230V [50Hz]  
W1: 400V [50Hz]

### NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat
- Shows nominal capacities
- SHC is based on each EWB and EDB  
SHC\* = SHC correction for other dry bulb  
SHC\* = 0.29 x 60 x AFR (m<sup>3</sup>/min) x (DB-EDB)/860.  
Add SHC\* to SHC if SHC > TC, then TC equal SHC
- Direct interpolation is permissible.  
Do not extrapolate..
- Capacities are based on the following conditions:  
Corresponding refrigerant piping length: 7.5 m  
Level difference: 0 m

6. Air flow rate and BF are tabulated below.

Model		FUYP
71	AFR	19
	BF	0.07
100	AFR	29
	BF	0.07
125	AFR	32
	BF	0.07

7. Add the following correction value to power input (kW) of each unit

Model	Supply	FUYP
71	V1	0.2
	W1	0
100	V1	0.3
	W1	0
125	W1	0



### 3 Capacity tables



**RP(200–250)B7W1 + FDYP(200–250)B7V1**

**Cooling capacity**

Model	FDYP200	FDYP250
AFR	69	89
BF	0.25	0.25

3

Outdoor	Indoor		Outdoor temperature (°C)																	
	EWB (°C)	EDB (°C)	20			25			32			35			40			46		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
RP200	12.0	18.0	17.9	15.2	6.51	17.2	14.7	7.00	16.2	14.0	7.84	15.8	13.8	8.25	15.1	13.3	9.04	14.4	12.9	10.10
	14.0	20.0	19.2	15.3	6.60	18.4	14.8	7.09	17.4	14.2	7.96	16.9	13.9	8.38	16.3	13.5	9.17	15.5	13.0	10.24
	16.0	22.0	20.5	15.4	6.70	19.7	14.9	7.21	18.6	14.3	8.08	18.1	14.0	8.51	17.4	13.6	9.31	16.7	13.1	10.40
	18.0	25.0	21.8	16.3	6.80	21.0	15.8	7.33	19.8	15.2	8.21	19.4	15.0	8.64	18.6	14.6	9.45	17.8	14.1	10.56
	19.0	27.0	22.5	17.2	6.86	21.6	16.8	7.39	20.5	16.1	8.28	20.0	15.9	8.71	19.3	15.5	9.53	18.4	15.0	10.64
	22.0	30.0	24.7	17.2	7.04	23.8	16.8	7.57	22.6	16.2	8.49	22.0	15.9	8.94	21.2	15.5	9.78	20.3	15.0	10.91
RP250	12.0	18.0	22.4	19.1	8.03	21.5	18.5	8.63	20.2	17.7	9.67	19.7	17.3	10.18	18.9	16.8	11.14	18.0	16.2	12.46
	14.0	20.0	24.0	19.2	8.14	23.0	18.6	8.75	21.7	17.8	9.82	21.2	17.5	10.34	20.3	17.0	11.30	19.4	16.4	12.63
	16.0	22.0	25.6	19.3	8.26	24.6	18.7	8.89	23.2	17.9	9.96	22.7	17.6	10.49	21.8	17.1	11.48	20.8	16.5	12.82
	18.0	25.0	27.2	20.5	8.39	26.2	19.9	9.04	24.8	19.2	10.12	24.2	18.8	10.65	23.3	18.3	11.65	22.3	17.7	13.02
	19.0	27.0	28.1	21.7	8.46	27.0	21.1	9.11	25.6	20.3	10.21	25.0	20.0	10.74	24.1	19.5	11.75	23.0	18.9	13.12
	22.0	30.0	30.9	21.6	8.68	29.7	21.1	9.34	28.2	20.3	10.47	27.6	20.0	11.03	26.5	19.5	12.05	25.4	18.9	13.45
	24.0	32.0	32.8	21.7	8.83	31.6	21.1	9.51	30.0	20.4	10.67	29.4	20.0	11.23	28.3	19.5	12.27	27.1	18.9	13.68

3TW23612-1A

**SYMBOLS**

AFR:	Air flow rate	(m <sup>3</sup> /min)
BF:	Bypass factor	
EWB:	Entering wet bulb temp.	(°CWB)
EDB:	Entering dry bulb temp.	(°CDB)
TC:	Total cooling capacity	(kW)
SHC:	Sensible heating capacity	(kW)
PI:	Power input	(kW)
	(comp.+indoor+outdoor fan motor)	

**NOTES**

1. Ratings shown are net capacities which include a deduction for indoor fan motor heat
2.  Shows nominal capacities
3. SHC is based on each EWB and EDB  
 SHC\* = SHC correction for other dry bulb  
 SHC\* = 0.29 x 60 x AFR (m<sup>3</sup>/min) x (DB-EDB).  
 Add SHC\* to SHC if SHC > TC, then TC equal SHC
4. Direct interpolation is permissible.  
 Do not extrapolate..
5. Capacities are based on the following conditions:  
 Corresponding refrigerant piping length: 7.5 m  
 Level difference: 0 m





# 4 Dimensional drawings

4



## R25-35-45GZ7

unit (mm)

- 1 Drain outlet
- 2 4 x holes for anchor bolts (M8 or M10)
- 3 Service cover + wiring diagram
- 4 Power intake
- 5 Low pressure gas stop valve
- 6 Liquid stop valve (Cu1/4")
- 7 Low pressure service port
- 8 Name plate

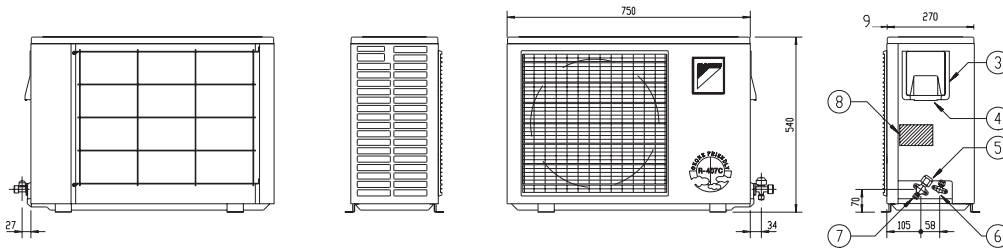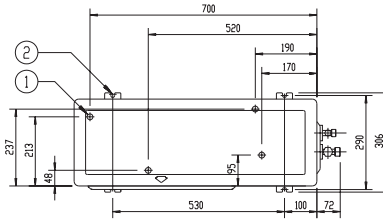


Minimum installation space (mm)

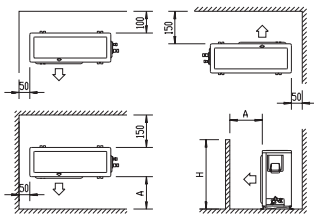

H	A
≤ 1000	≥ 250
> 1000	≥ 500

	⑤	⑥
R25GZ7V11	φ 9.5mm or 3/8"CuT	φ 6.4mm or 1/4"CuT
R35GZ7V11	φ 12.7mm or 1/2"CuT	φ 6.4mm or 1/4"CuT
R45GZ7V11	φ 15.9mm or 5/8"CuT	φ 6.4mm or 1/4"CuT
R45GZ7W11		





3TW01714-1B


## R60GZ7

unit (mm)



- 1 Drain outlet (3x)
- 2 4x holes for anchor bolts (M10)
- 3 Service cover
- 4 Power intake
- 5 Gas stopvalve φ 15.9mm or 5/8 CuT
- 6 Liquid stopvalve φ 6.4mm or 1/4 CuT
- 7 Service port
- 8 Nameplate
- 9 Outdoor air thermostat

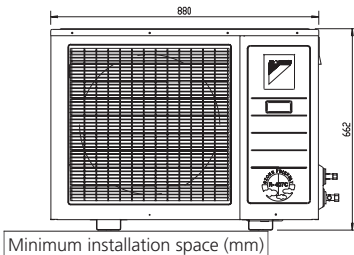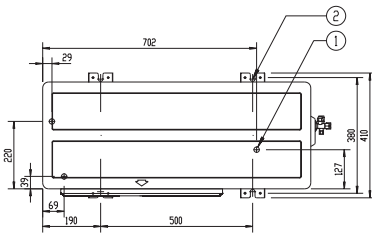

Minimum installation space (mm)



H	A
H < 1000	350
H > 1000	600

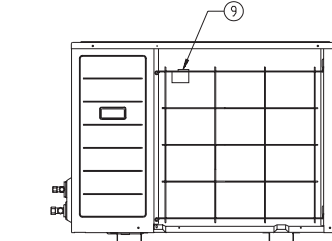

3TW02104-1

# 4 Dimensional drawings



4

**RP71B7** unit (mm)

- 1 Gas pipe connection  $\phi$  15.9 flare
- 2 Liquid pipe connection -  $\phi$  9.5 flare
- 3 Service port (in the unit)
- 4 Grounding terminal M5 (in switch box)
- 5 Drain outlet

3TW23184-1

**RP100-125B7** unit (mm)

- 1 Gas pipe connection  $\phi$  19.1 flare
- 2 Liquid pipe connection -  $\phi$  9.5 flare
- 3 Service port (in the unit)
- 4 Grounding terminal M5 (in switch box)
- 5 Drain outlet

3TW23224-1


# 4 Dimensional drawings



4


RP200B7

unit (mm)

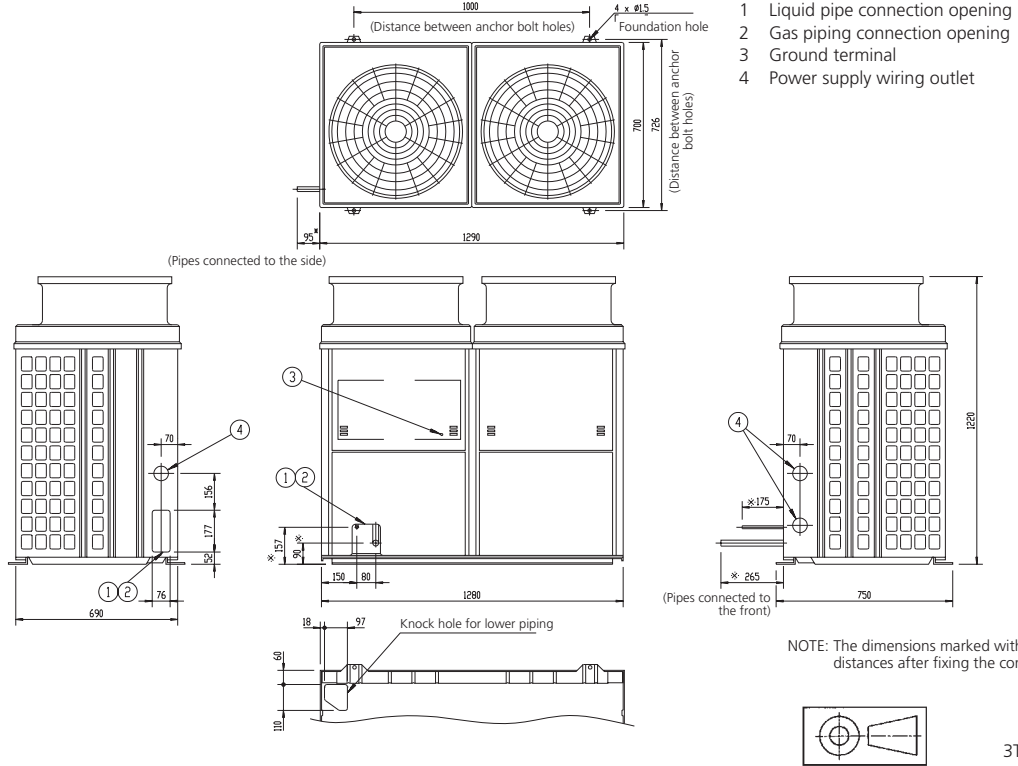

RP250B7



unit (mm)

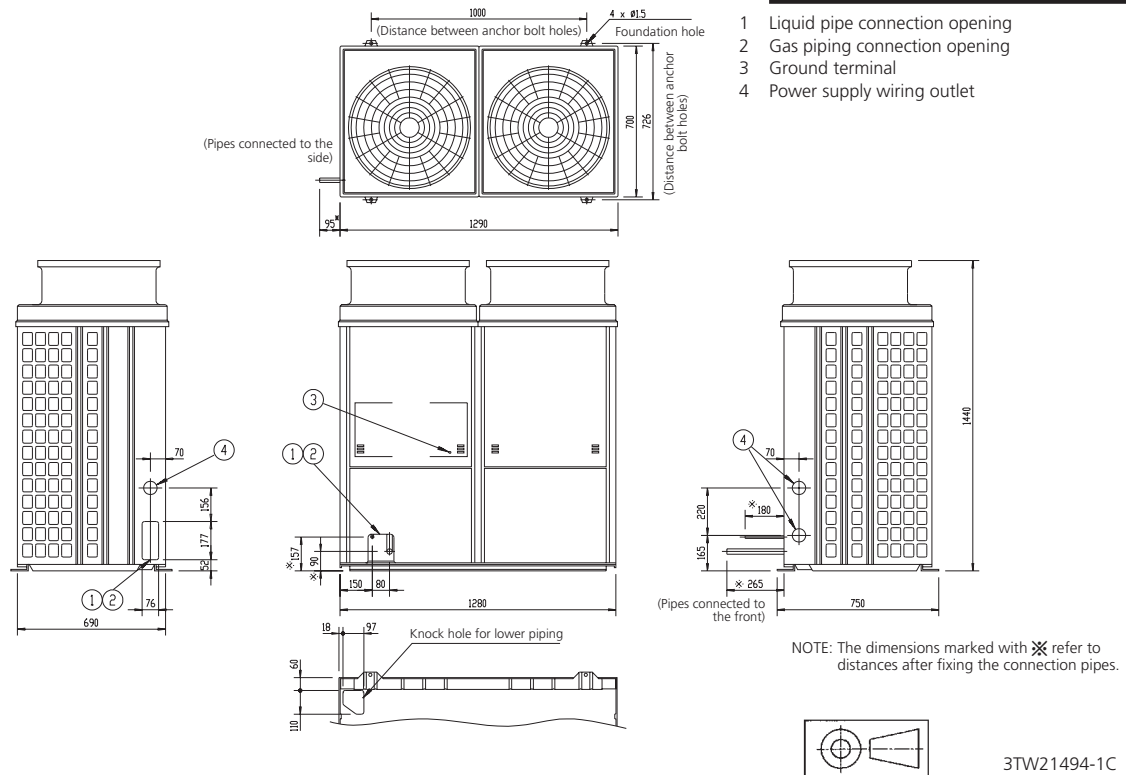

# 5 Operation range



5

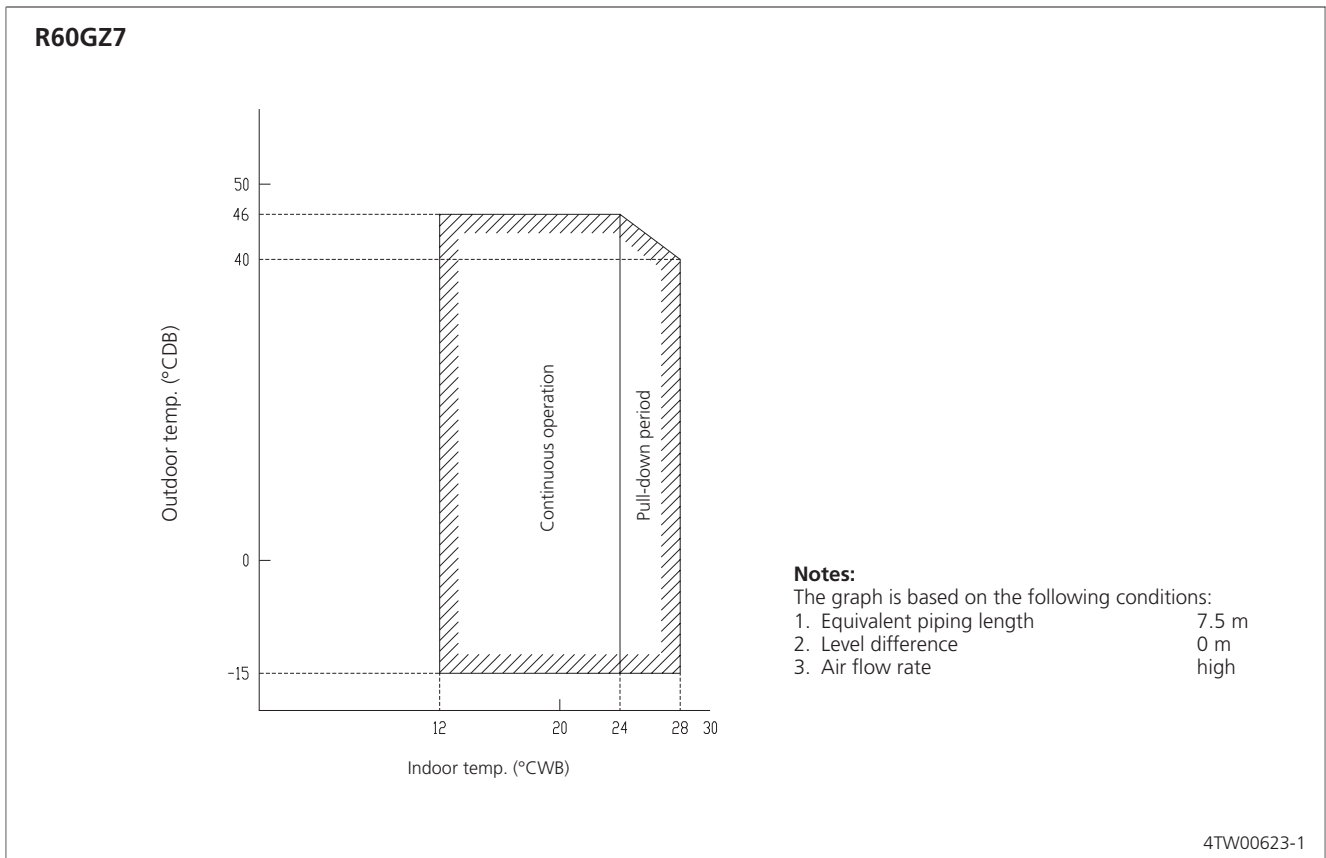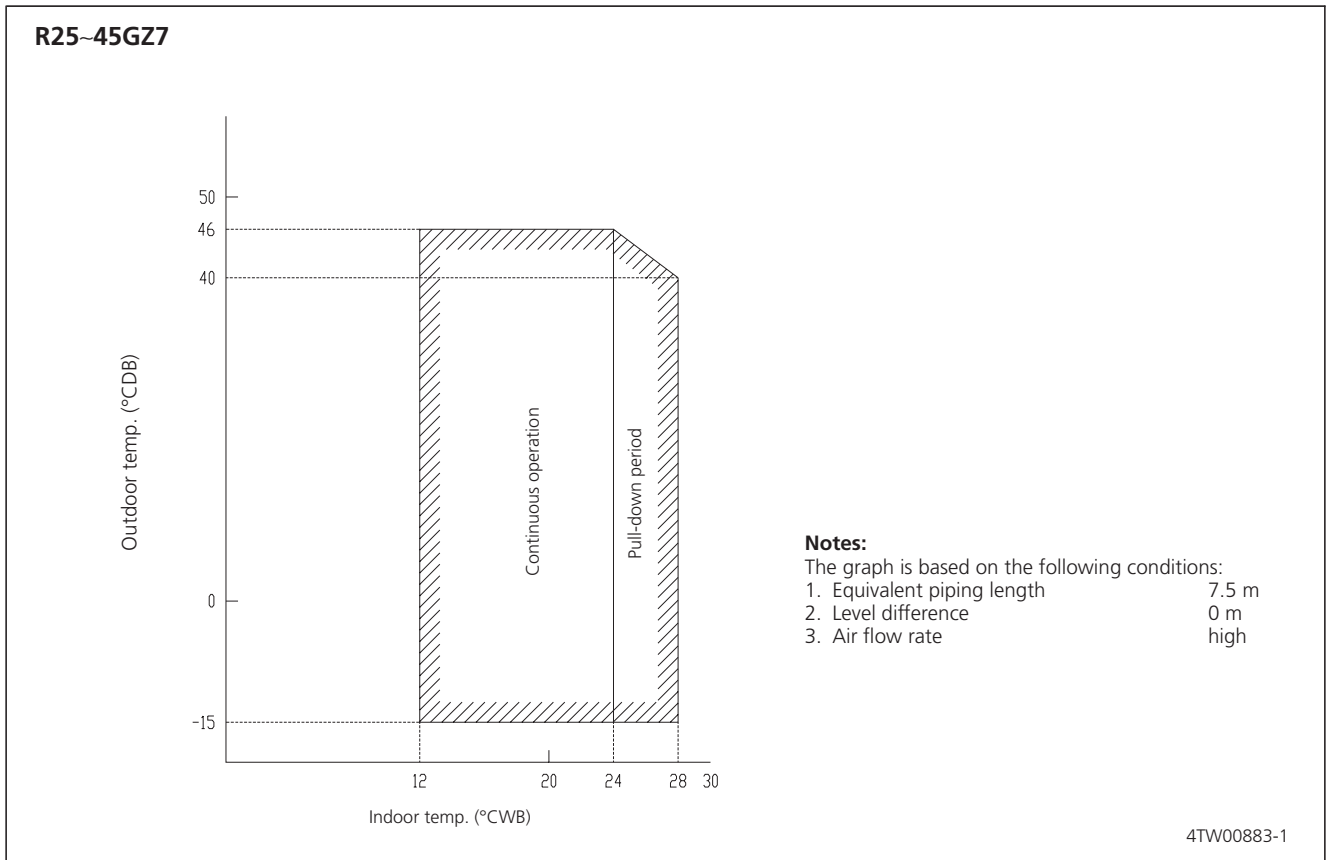


# 5 Operation range



5


## RP71-100-125B7

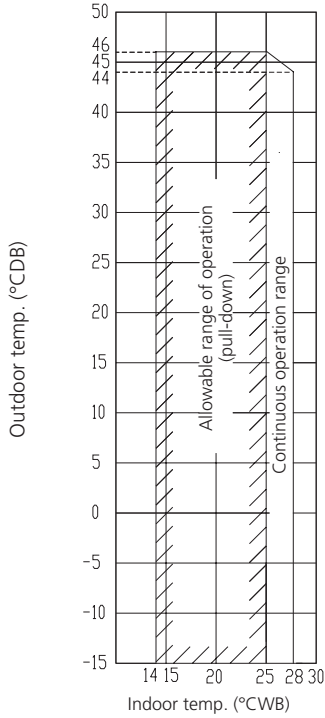

Model name	
RP71B7V1	RP100B7W1
RP71B7W1	RP100B7T1
RP71B7T1	RP125B7W1
RP100B7V1	RP125B7T1

3TW23183-1

## RP200-250B7

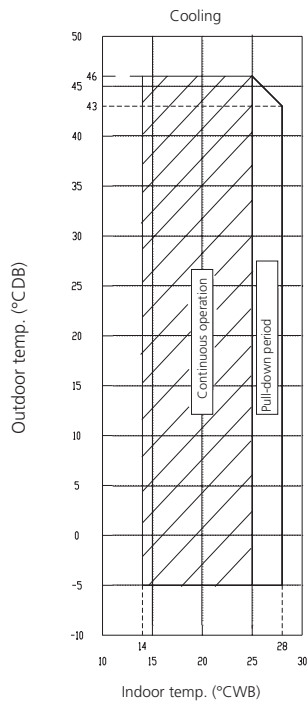

**Notes:**

The graph is based on the following conditions:



1. Equivalent piping length 70 m
2. Level difference 30 m
3. Indoor air flow rate 72m<sup>3</sup>/min (200 class)  
90m<sup>3</sup>/min (250 class)

3TW23613-1

# 6 Piping diagrams



6

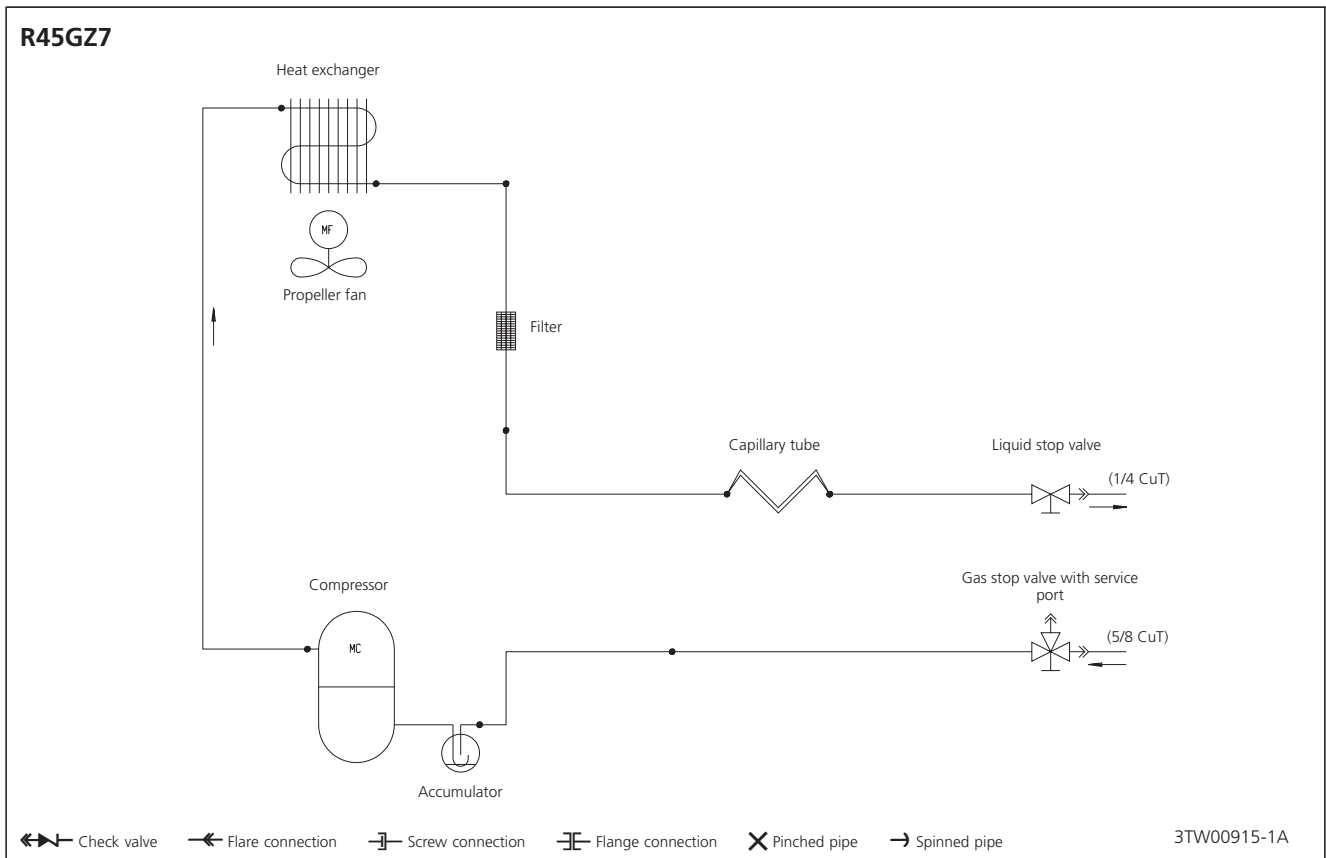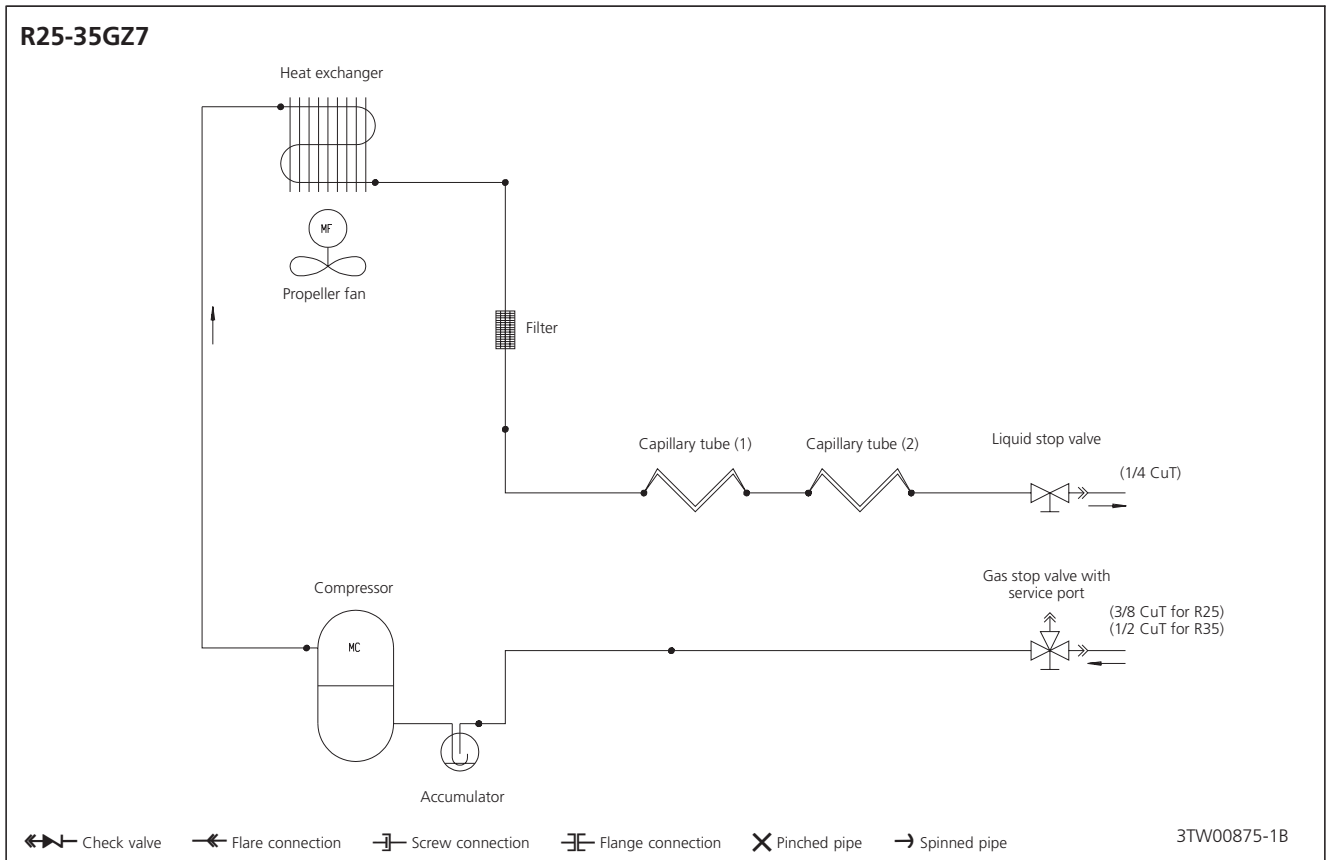


# 6 Piping diagrams



6


R60GZ7

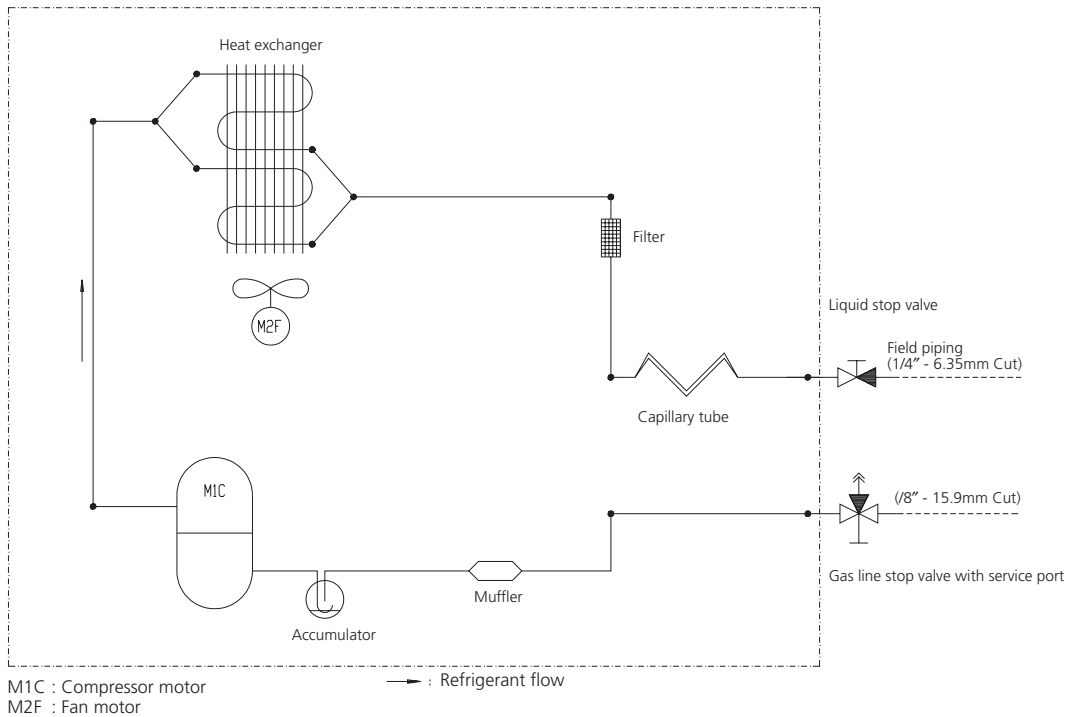

Check valve  
 Flare connection  
 Screw connection  
 Flange connection  
 Pinched pipe  
 Spinned pipe

3TW02105-1

RP71B7

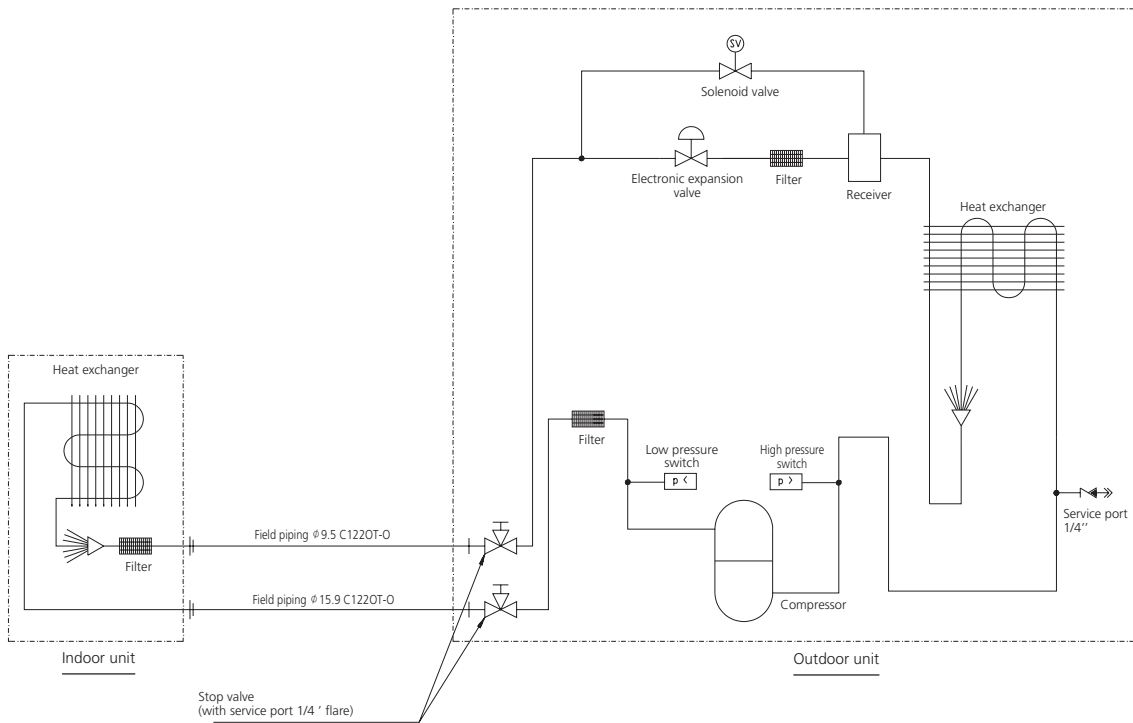

Check valve  
 Flare connection  
 Screw connection  
 Flange connection  
 Pinched pipe  
 Spinned pipe



3TW23285-1



# 6 Piping diagrams



6

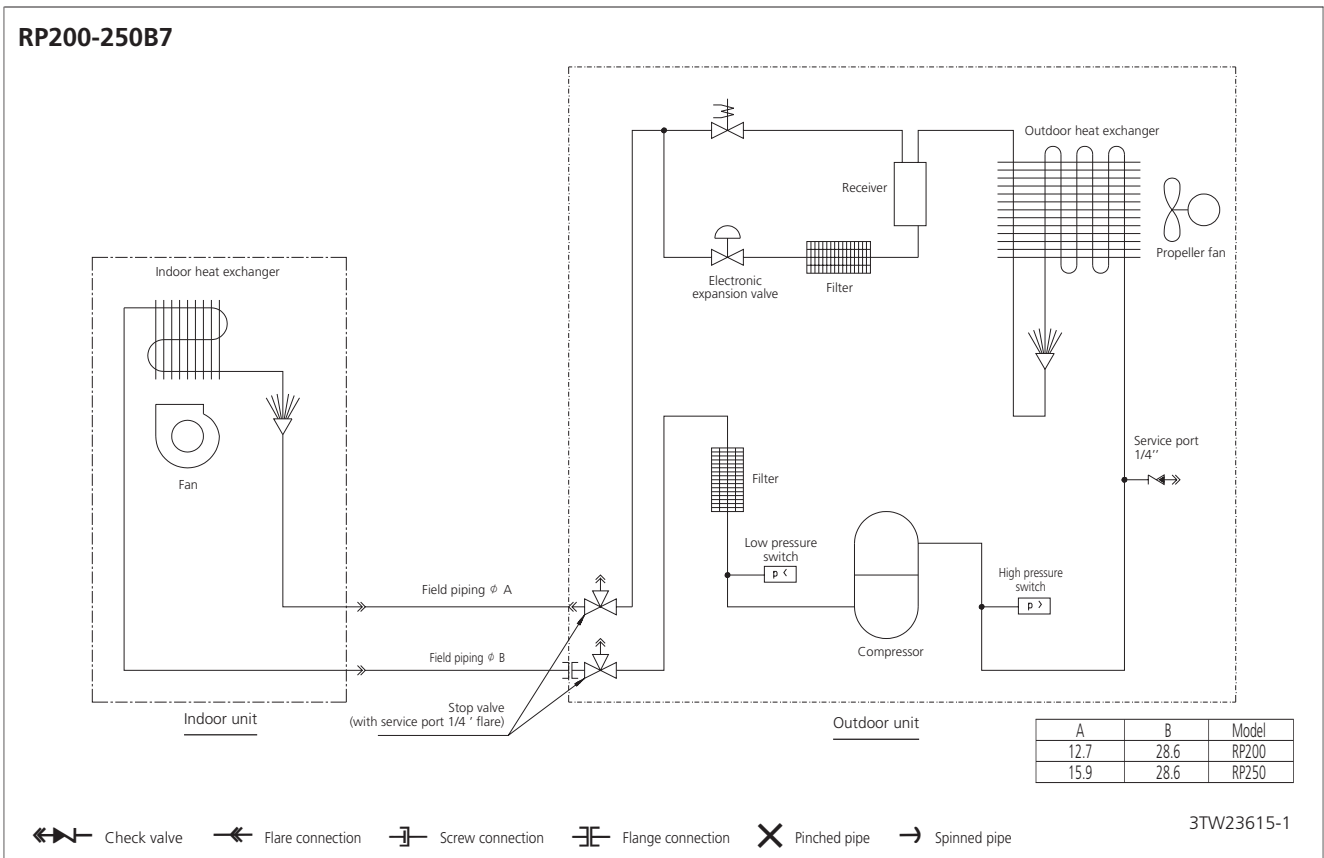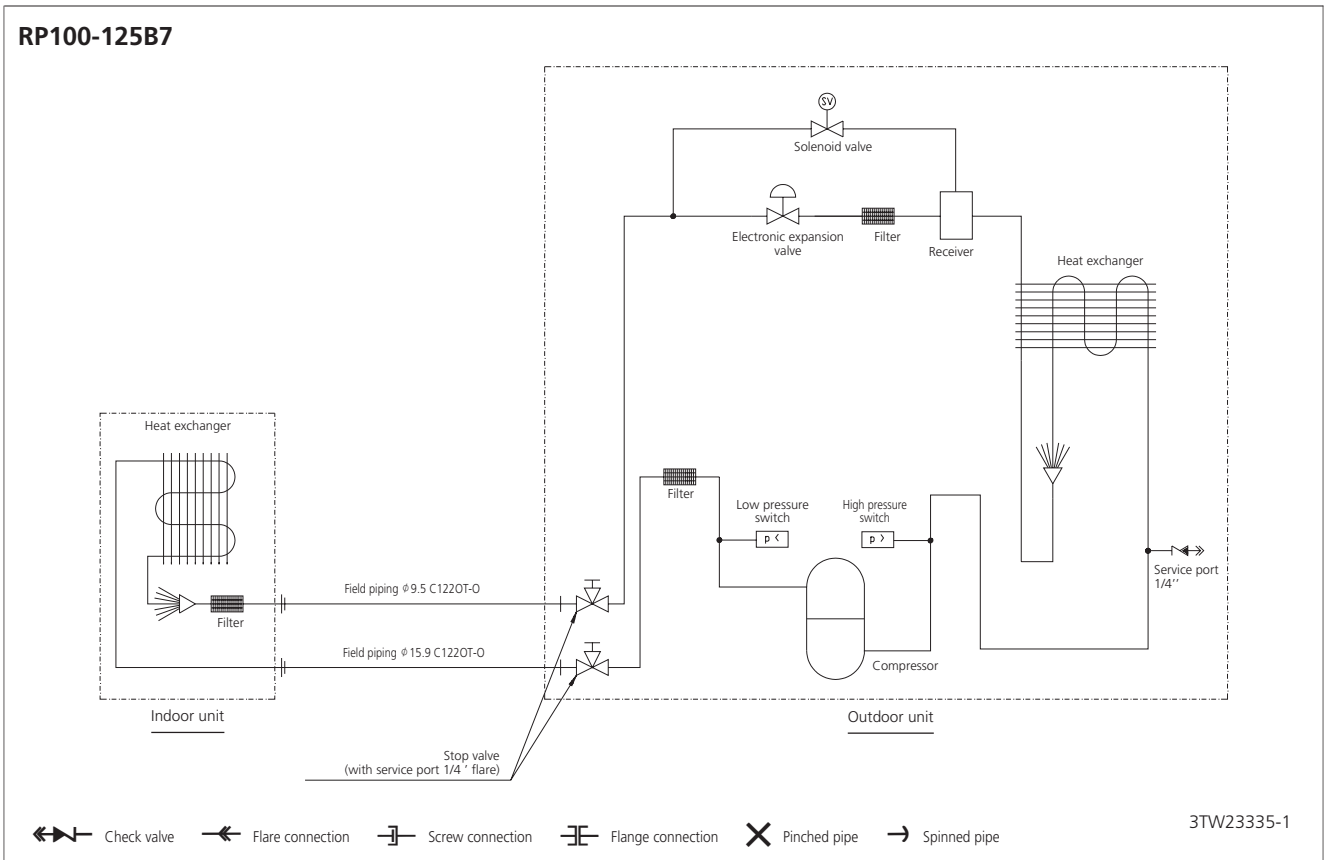

# 7 Wiring diagrams




7

## R25-35GZ7V11

L Live  
N Neutral  
⊕ Protective earth

Field wiring

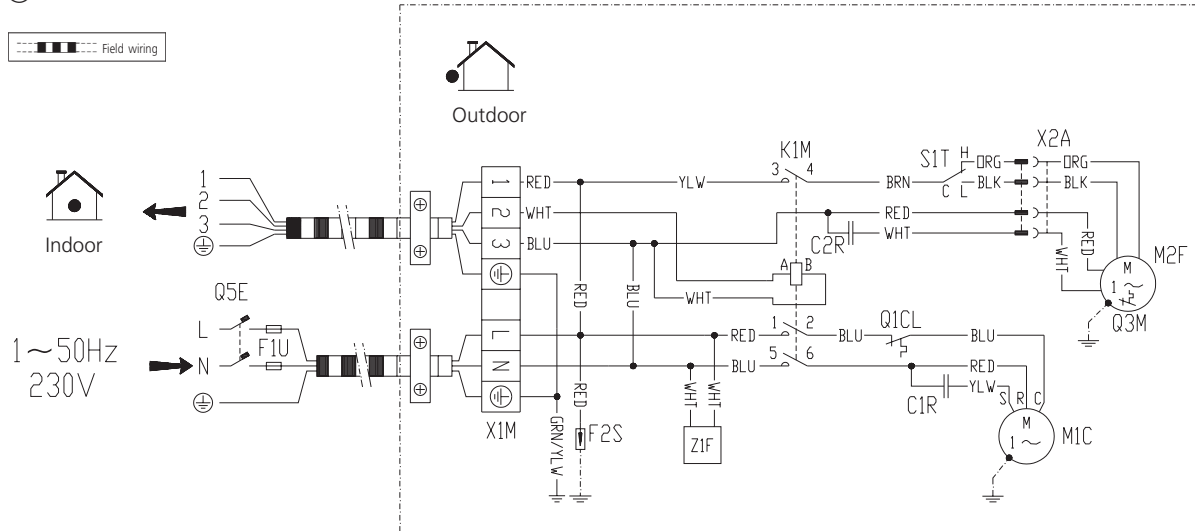

C1R,C2R : Running capacitor  
F1U : Field fuse  
F2S : Surge absorber  
K1M : Compressor contactor  
M1C : Compressor motor  
M2F : Fan motor


Q1CL : Overcurrent overload switch (compressor)  
Q3M : Thermal protector  
Q5E : Field earth leak detector  
S1T : Thermostat  
X1M : Terminal strip  
X2A : Connector  
Z1F : Noise filter

3TW01906-1

## R45GZ7V11

L Live  
N Neutral  
⊕ Protective earth

Field wiring

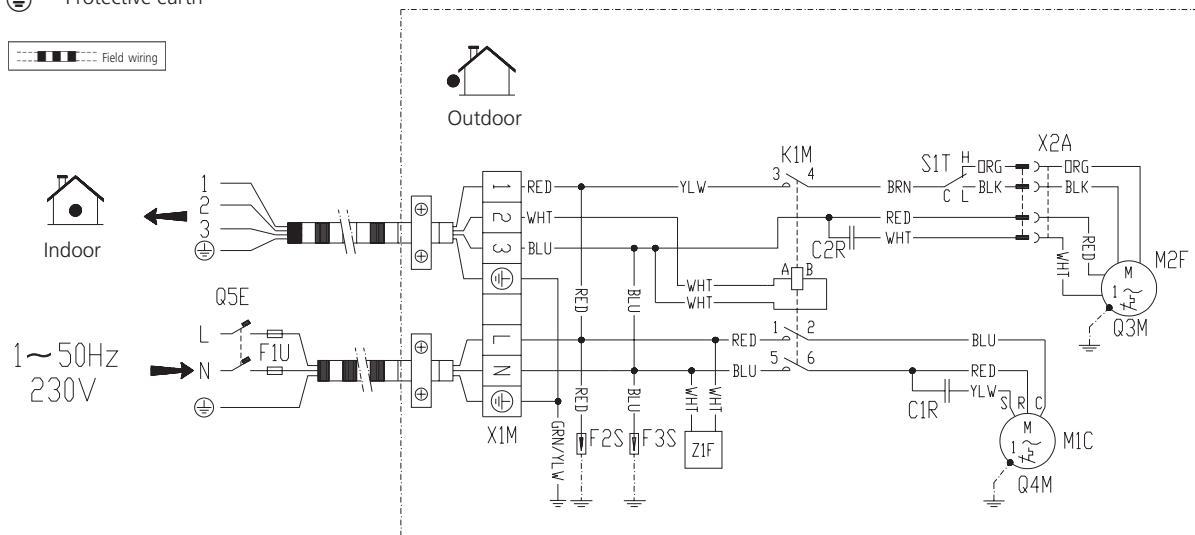

C1R,C2R : Running capacitor  
F1U : Field fuse  
F2S : Surge absorber  
K1M : Compressor contactor  
M1C : Compressor motor  
M2F : Fan motor



Q2L : Overload protector (compressor)  
Q3M,Q4M : Thermal protector  
Q5E : Field earth leak detector  
S1T : Thermostat  
X1M : Terminal strip  
X2A : Connector  
Z1F : Noise filter

3TW01926-1

# 7 Wiring diagrams



7

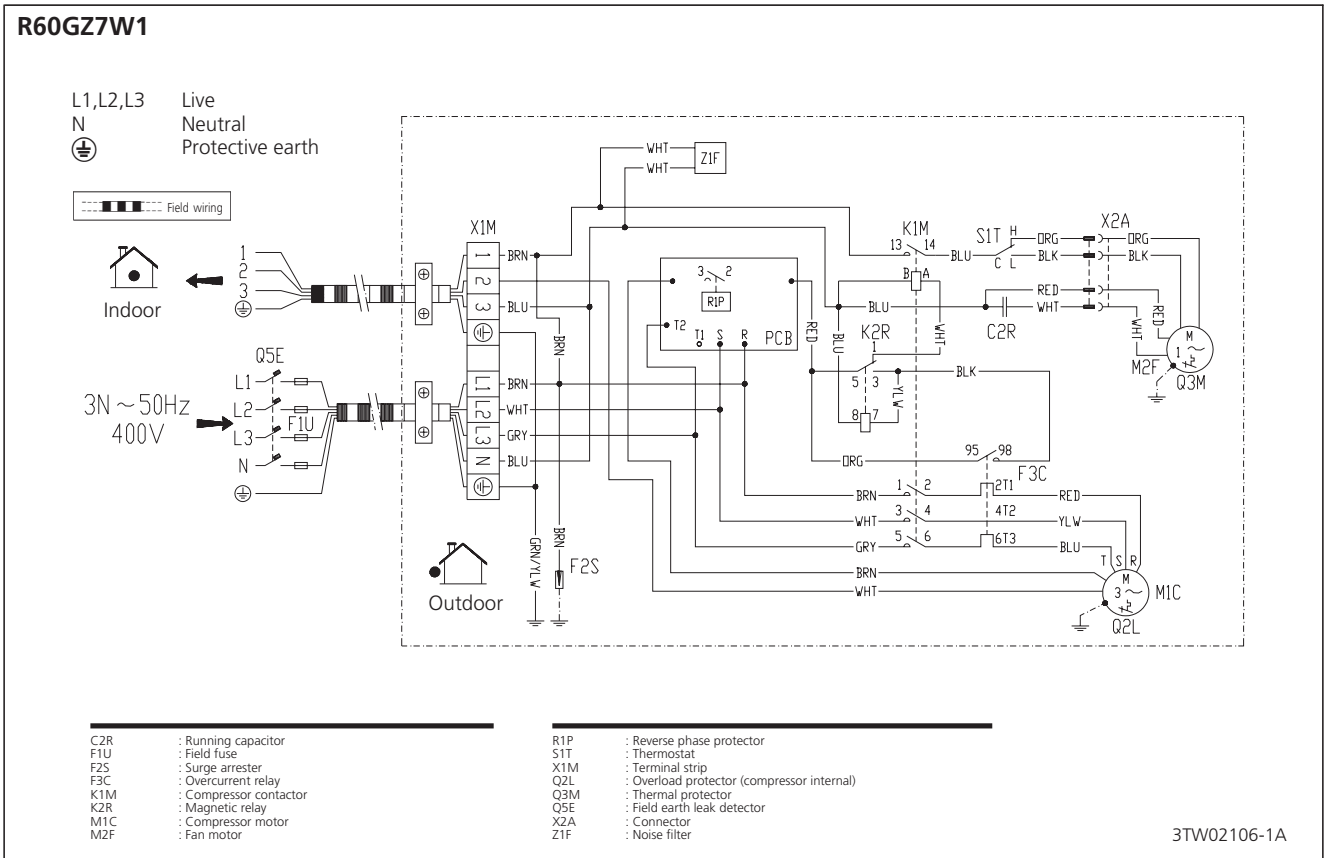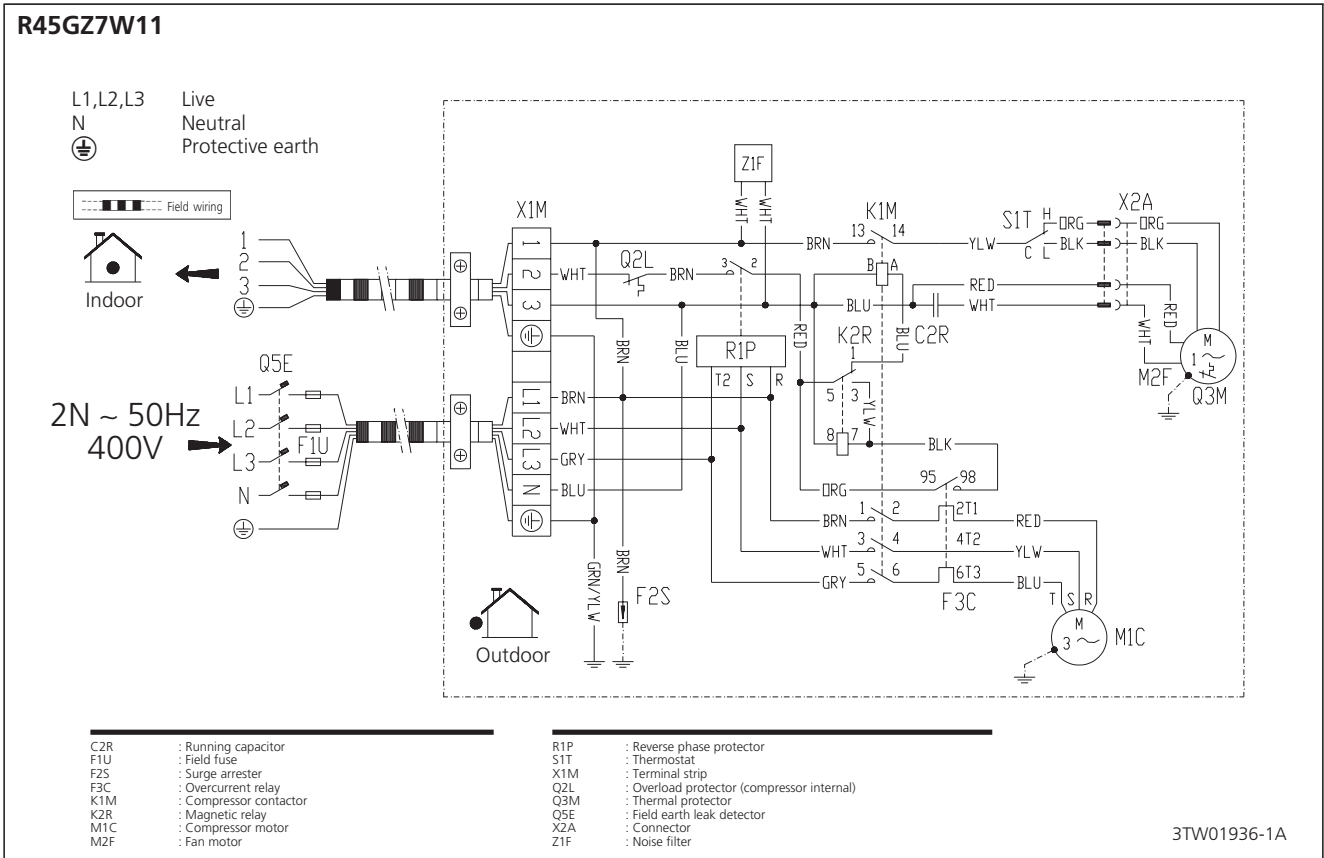

# 7 Wiring diagrams




7

## RP71B7V1

Note:  
Do not operate the unit by short-circuiting S1LP

- Field wiring
- Terminal
- Connector
- Wire clamp
- Protective earth (screw)
- Live
- Neutral

Colours  
BLK: Black/ BLU: Blue/ WHT: White/  
RED: Red/ ORG: Orange/ YLW: Yellow

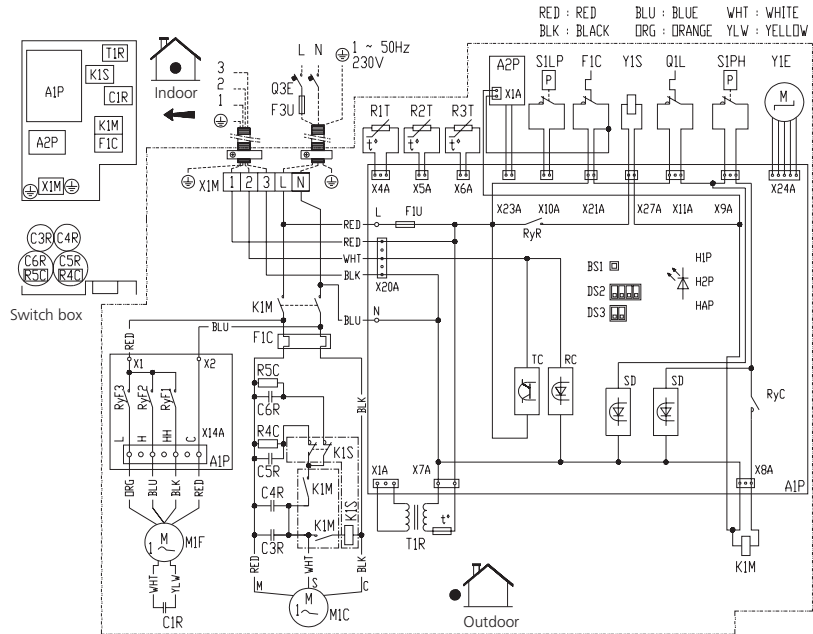

L-RED N-BLU

- |                                       |  |                                 |                                       |
|---------------------------------------|--|---------------------------------|---------------------------------------|
| A1P,A2P Printed circuit board         | F3U Field fuse                                     | R1T Thermistor (air)            | S1PH Pressure switch (high)           |
| BS1 Push button (pump down)           | HAP Light emitting diode (service monitor green)   | R2T Thermistor (coil)           | SD Safety devices input               |
| C1R Capacitor (M1F)                   | H1P,H2P Light emitting diode (service monitor red) | R3T Thermistor (discharge pipe) | T1R Transformer (220-240V/16V)        |
| C3R,C4R Capacitor (M1C)               | K1M Magnetic contactor (M1C)                       | R4C,R5C Resistor                | TC Signal transmission circuit        |
| C5R,C6R Starting capacitor (M1C)      | K1S Starting contactor (M1C)                       | RC Signal receiver circuit      | X1M Terminal strip                    |
| DS2 Selector switch (various see PCB) | M1C Motor (compressor)                             | RyC Magnetic relay (K1M)        | Y1E Expansion valve (electronic type) |
| DS3 Selector switch (emergency)       | M1F Motor (fan)                                    | RyF1-3 Magnetic relay (M1F)     | Y1S Solenoid valve                    |
| F1C Overcurrent relay (M1C)           | Q1L Thermo switch (M1F)                            | RyR Magnetic relay (Y1S)        |                                       |
| F1U Fuse (250V, 5A)                   | Q3E Earth leak detector                            | S1LP Pressure switch (low)      |                                       |


2TW23286-1

## RP71B7W1

Note:  
Do not operate the unit by short-circuiting S1LP

- Field wiring
- Terminal
- Connector
- Wire clamp
- Protective earth (screw)
- Live
- Neutral

Colours  
BLK: Black/ BLU: Blue/ WHT: White/  
RED: Red/ ORG: Orange/ YLW: Yellow

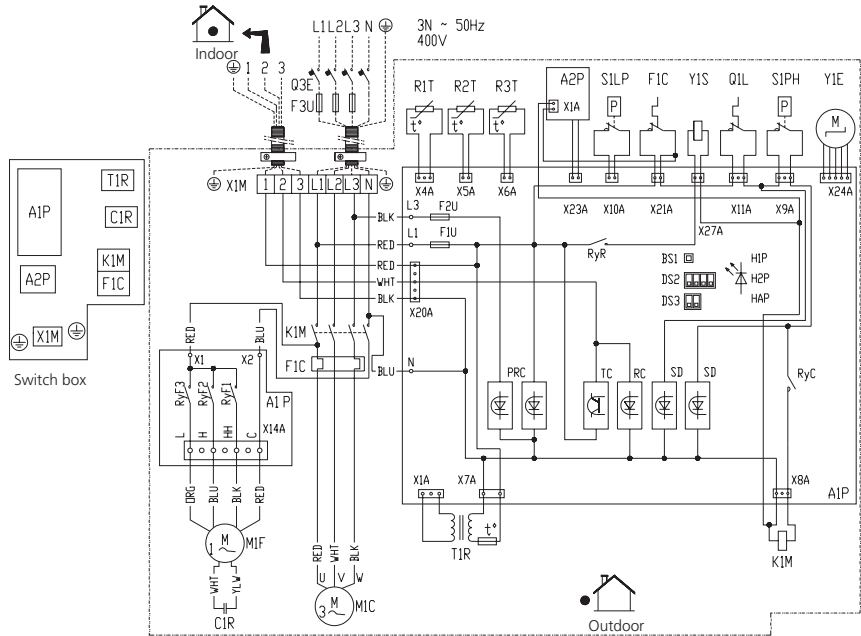

L1-RED L2-WHT L3-BLK N-BLU



- |                                       |  |                                 |                                       |
|---------------------------------------|--|---------------------------------|---------------------------------------|
| A1P,A2P Printed circuit board         | H1P,H2P Light emitting diode (service monitor red) | R3T Thermistor (discharge pipe) | TC Signal transmission circuit        |
| BS1 Push button (pump down)           | K1M Magnetic contactor (M1C)                       | RC Signal receiver circuit      | X1M Terminal strip                    |
| C1R Capacitor (M1F)                   | M1C Motor (compressor)                             | RyC Magnetic relay (K1M)        | Y1E Expansion valve (electronic type) |
| C3R,C4R Capacitor (M1C)               | M1F Motor (fan)                                    | RyF1-3 Magnetic relay (M1F)     | Y1S Solenoid valve                    |
| C5R,C6R Starting capacitor (M1C)      | PRC Phase reverse circuit                          | RyR Magnetic relay (Y1S)        |                                       |
| DS2 Selector switch (various see PCB) | Q1L Thermo switch (M1F)                            | S1LP Pressure switch (low)      |                                       |
| DS3 Selector switch (emergency)       | Q3E Earth leak detector                            | S1PH Pressure switch (high)     |                                       |
| F1C Overcurrent relay (M1C)           | F3U Field fuse                                     | SD Safety devices input         |                                       |
| F1U,F2U Fuse (250V, 5A)               | HAP Light emitting diode (service monitor green)   | T1R Transformer (220-240V/16V)  |                                       |

2TW23296-1

# 7 Wiring diagrams



7

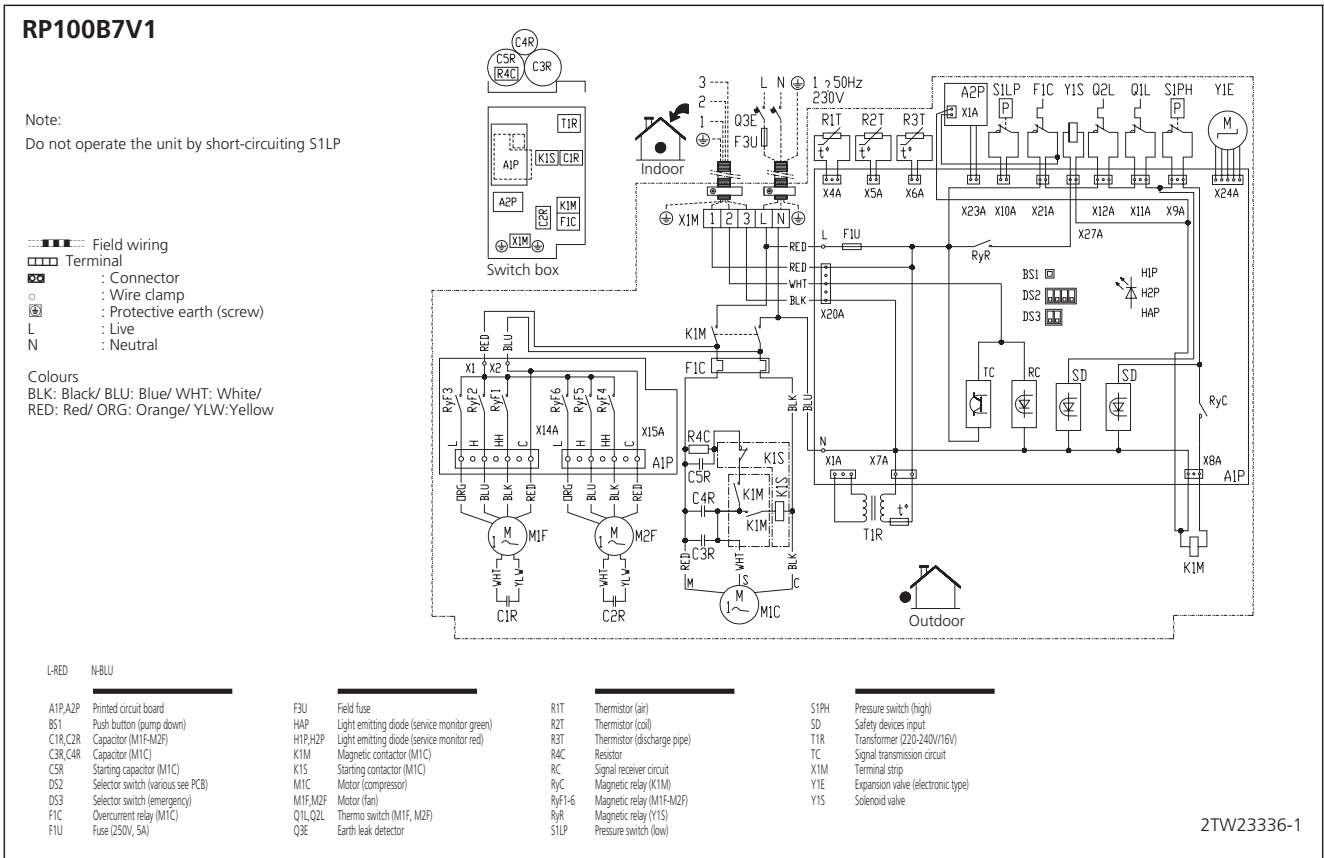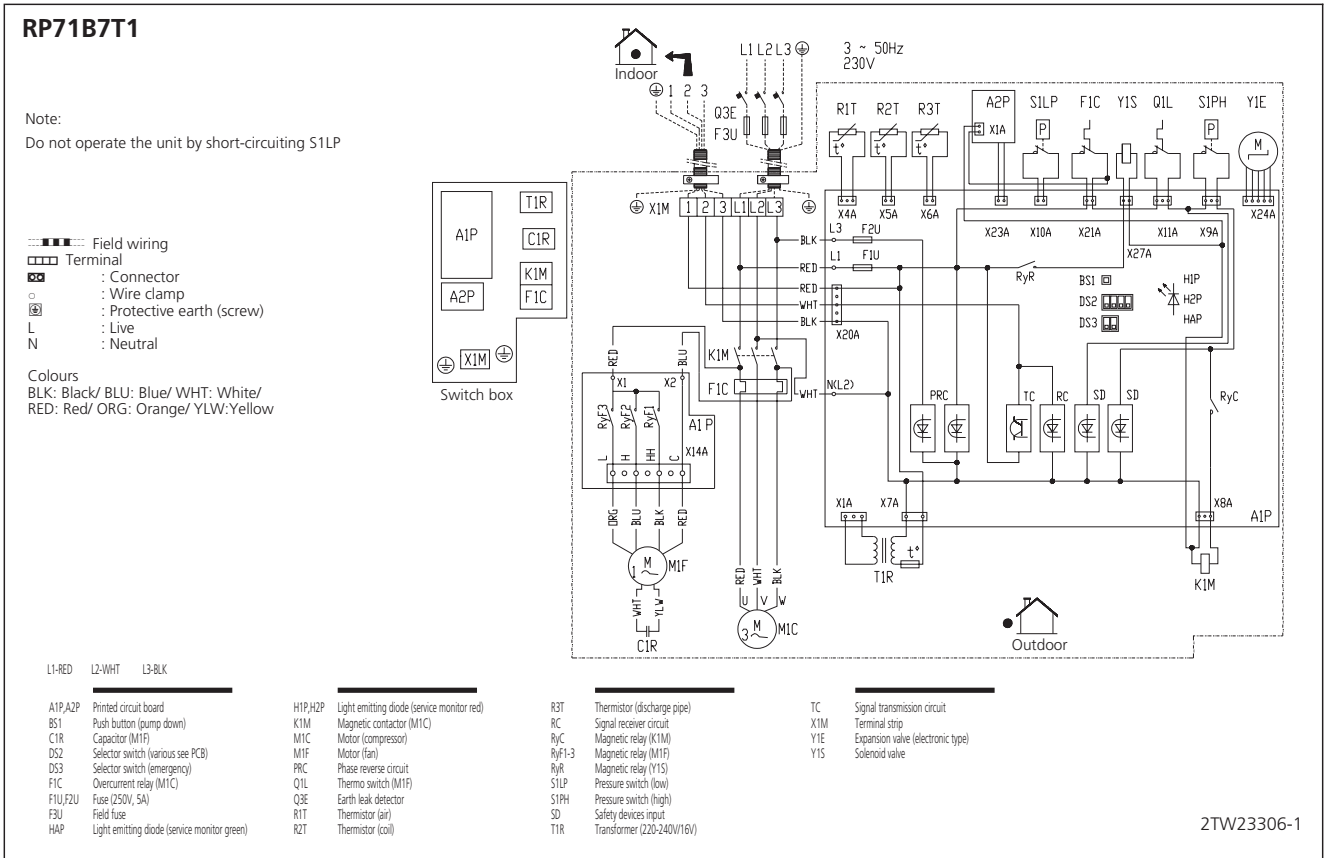

# 7 Wiring diagrams




7

## RP100-125B7W1

Note:  
Do not operate the unit by short-circuiting S1LP

- Field wiring
- Terminal
- Connector
- Wire clamp
- Protective earth (screw)
- Live
- Neutral

Colours  
BLK: Black/ BLU: Blue/ WHT: White/  
RED: Red/ ORG: Orange/ YLW: Yellow

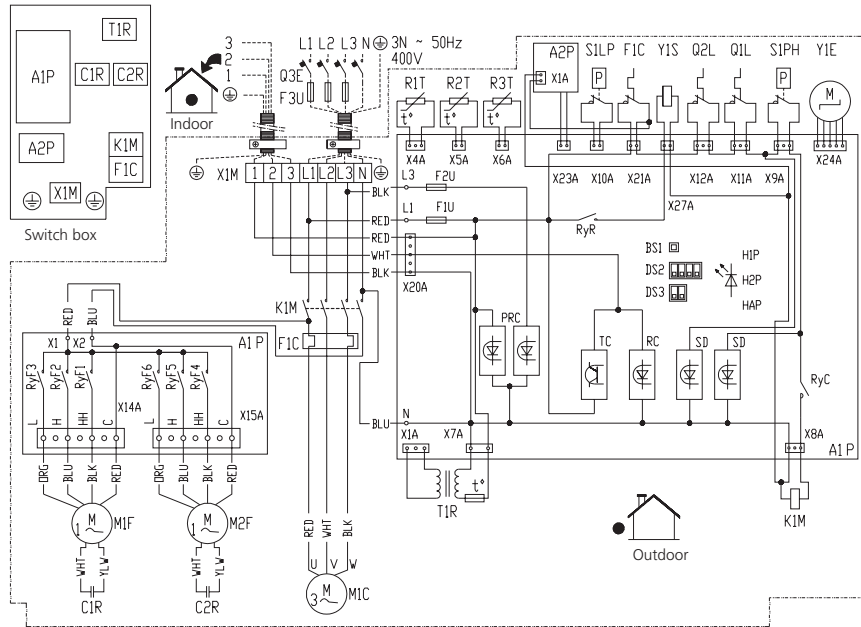

L1-RED L2-WHT L3-BLK N-BLU

- |  |  |                                 |                                       |
|--|--|---------------------------------|---------------------------------------|
| A1P,A2P Printed circuit board                    | H1P,H2P Light emitting diode (service monitor red) | R3T Thermistor (discharge pipe) | TC Signal transmission circuit        |
| BS1 Push button (pump down)                      | K1M Magnetic contactor (M1C)                       | RC Signal receiver circuit      | X1M Terminal strip                    |
| C1R,C2R Capacitor (M1F-M2F)                      | M1C Motor (compressor)                             | RyC Magnetic relay (K1M)        | Y1E Expansion valve (electronic type) |
| DS2 Selector switch (various see PCB)            | M1F,M2F Motor (fan)                                | RyF1-6 Magnetic relay (M1F-M2F) | Y1S Solenoid valve                    |
| DS3 Selector switch (emergency)                  | PRC Phase reverse circuit                          | RyR Magnetic relay (Y1S)        |                                       |
| F1C Overcurrent relay (M1C)                      | Q1L,Q2L Thermo switch (M1F, M2F)                   | S1LP Pressure switch (low)      |                                       |
| F1U,F2U Fuse (250V, 5A)                          | Q3E Earth leak detector                            | S1PH Pressure switch (high)     |                                       |
| F3U Field fuse                                   | R1T Thermistor (air)                               | SD Safety devices input         |                                       |
| HAP Light emitting diode (service monitor green) | R2T Thermistor (coil)                              | T1R Transformer (220-240V/16V)  |                                       |


2TW23346-1

## RP100-125B7T1

Note:  
Do not operate the unit by short-circuiting S1LP

- Field wiring
- Terminal
- Connector
- Wire clamp
- Protective earth (screw)
- Live
- Neutral

Colours  
BLK: Black/ BLU: Blue/ WHT: White/  
RED: Red/ ORG: Orange/ YLW: Yellow

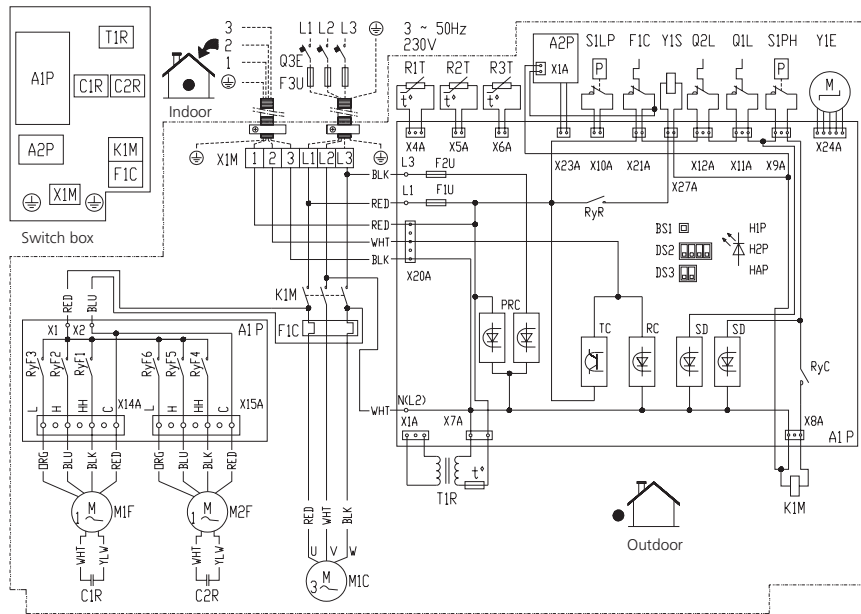

L1-RED L2-WHT L3-BLK

- |  |  |                                 |                                       |
|--|--|---------------------------------|---------------------------------------|
| A1P,A2P Printed circuit board                    | H1P,H2P Light emitting diode (service monitor red) | R3T Thermistor (discharge pipe) | TC Signal transmission circuit        |
| BS1 Push button (pump down)                      | K1M Magnetic contactor (M1C)                       | RC Signal receiver circuit      | X1M Terminal strip                    |
| C1R,C2R Capacitor (M1F-M2F)                      | M1C Motor (compressor)                             | RyC Magnetic relay (K1M)        | Y1E Expansion valve (electronic type) |
| DS2 Selector switch (various see PCB)            | M1F,M2F Motor (fan)                                | RyF1-6 Magnetic relay (M1F-M2F) | Y1S Solenoid valve                    |
| DS3 Selector switch (emergency)                  | PRC Phase reverse circuit                          | RyR Magnetic relay (Y1S)        |                                       |
| F1C Overcurrent relay (M1C)                      | Q1L,Q2L Thermo switch (M1F, M2F)                   | S1LP Pressure switch (low)      |                                       |
| F1U,F2U Fuse (250V, 5A)                          | Q3E Earth leak detector                            | S1PH Pressure switch (high)     |                                       |
| F3U Field fuse                                   | R1T Thermistor (air)                               | SD Safety devices input         |                                       |
| HAP Light emitting diode (service monitor green) | R2T Thermistor (coil)                              | T1R Transformer (220-240V/16V)  |                                       |

2TW23356-1

# 7 Wiring diagrams



7



## RP200-250B7W1

Note:

Do not operate the unit by short-circuiting S1LP

- Field wiring
- Terminal
- Connector
- Wire clamp
- Protective earth (screw)
- L : Live
- N : Neutral

Colours  
 BLK: Black/ BLU: Blue/ WHT: White/  
 RED: Red/ ORG: Orange/ YLW: Yellow

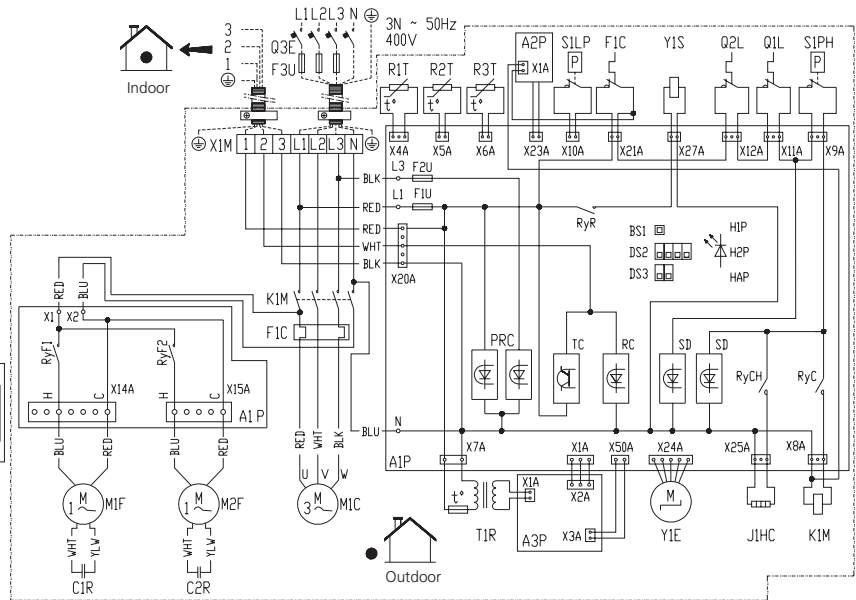

L1-RED L2-WHT L3-BLK N-BLU

A1P, A2P, A3P	Printed circuit board	H1P, H2P	Light emitting diode (service monitor red)	R2T	Thermistor (coil)	SD	Safety devices input
B1S	Push button (pump down)	J1HC	Crankcase heater	R3T	Thermistor (discharge pipe)	T1R	Transformer (220-240V/16V)
C1R, C2R	Capacitor (M1F-M2F)	K1M	Magnetic contactor (M1C)	RC	Signal receiver circuit	TC	Signal transmission circuit
DS2	Selector switch (various see PCB)	M1C	Motor (compressor)	RyC	Magnetic relay (K1M)	X1M	Terminal strip
DS3	Selector switch (emergency)	M1F, M2F	Motor (fan)	RyCH	Magnetic relay (J1HC)	Y1E	Expansion valve (electronic type)
F1C	Overcurrent relay (M1C)	PRC	Phase reverse circuit	RyF1-2	Magnetic relay (M1F-M2F)	Y1S	Solenoid valve
F1U, F2U	Fuse (250V, 5A)	Q1L, Q2L	Thermo switch (M1F, M2F)	RyR	Magnetic relay (Y1S)		
F3U	Field fuse	Q3E	Earth leak detector	S1LP	Pressure switch (low)		
HAP	Light emitting diode (service monitor green)	R1T	Thermistor (air)	S1PH	Pressure switch (high)		

2TW23616-1A

# 8 Sound level






## 8-1 Sound level data

8  
8-1

Model	Sound pressure level		Measuring location	Sound power level (H)
	230V			
	50Hz			
	H	L		
R25GZ7	44	–	Outdoor unit  Location of microphone	58
R35GZ7	48	–		61
R45GZ7	51	–		64
R60GZ7	55	–		67
RP71B7	50	–		63
RP100B7	53	–		66
RP125B7	53	–		67
RP200B7	56	–		77
RP250B7	56	–		77

## 8-2 Sound pressure spectrum

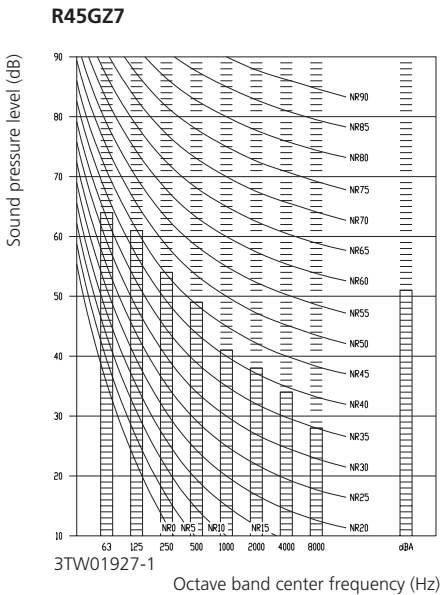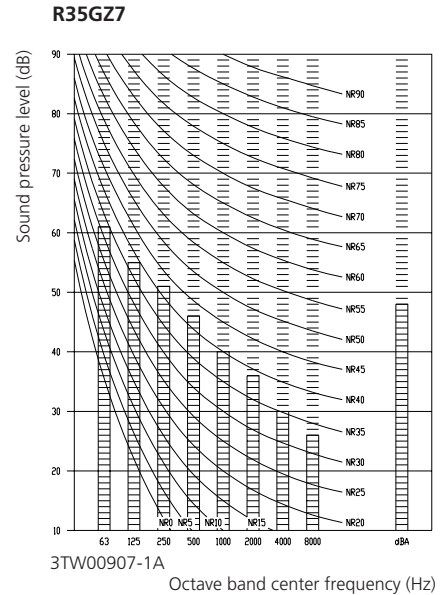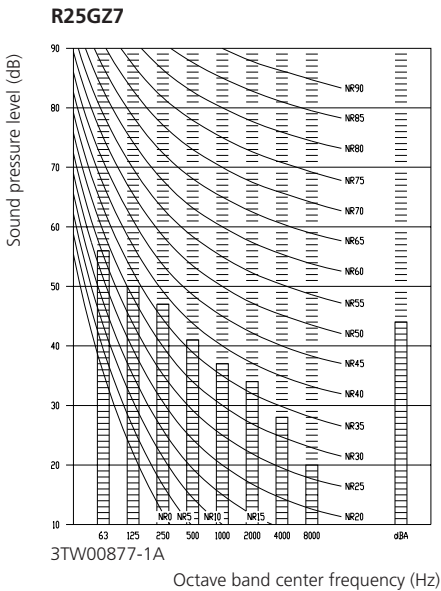

Legend

- High speed
- Low speed

Notes

- Data is valid at free field condition for 230V/50Hz
- Operation sound levels are valid at nominal operation condition
- dBA = A-weighted sound pressure level (A-scale according to IEC)
- Reference acoustic pressure 0dB = 20μPa




# 8 Sound level

## 8-2 Sound pressure spectrum



**R60GZ7**

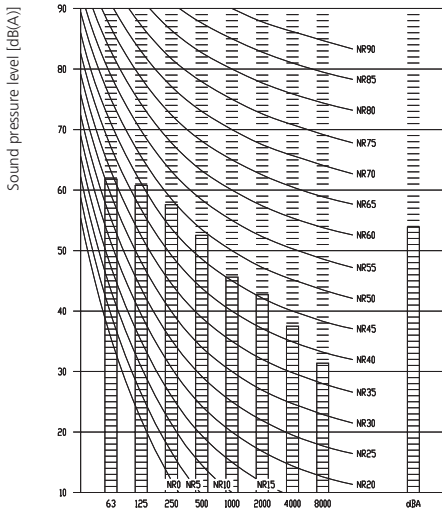


- ① 50Hz, 220V
- ② 50Hz, 240V

3TW02107-1

Octave band center frequency (Hz)


**RP71B7**

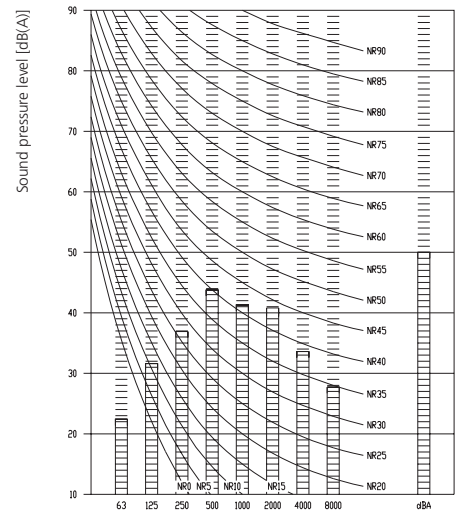

3TW23287-1

Octave band center frequency (Hz)


**RP100B7**

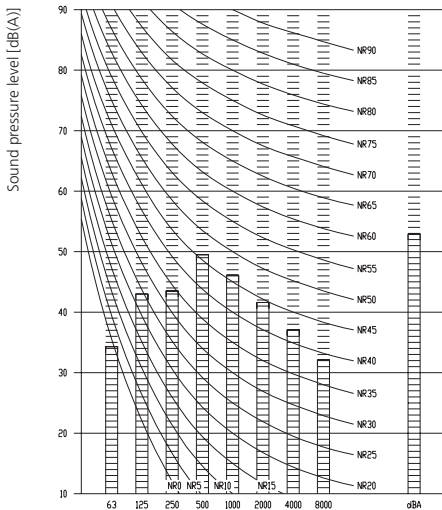

3TW23337-1

Octave band center frequency (Hz)


**RP125B7**

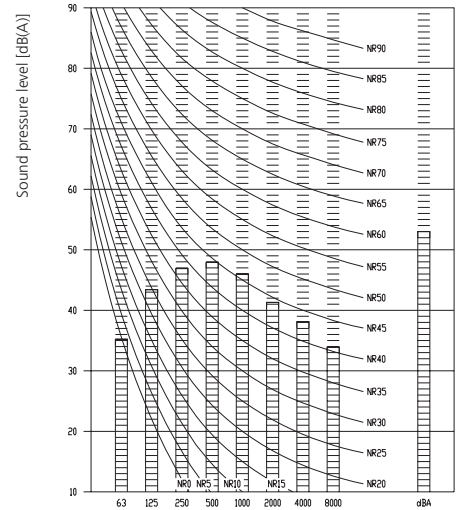

3TW23387-1

Octave band center frequency (Hz)

**RP200B7W1**

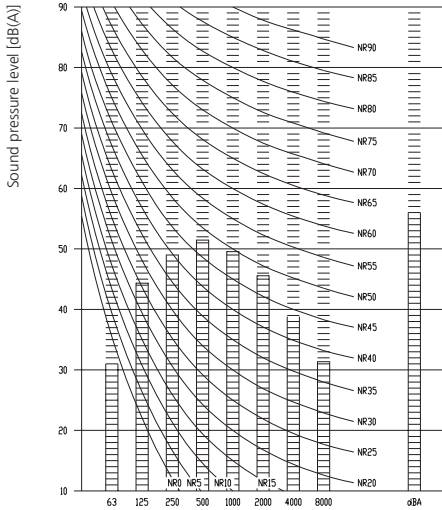


3TW23617-1

Octave band center frequency (Hz)

**Notes**

- Data is valid at free field condition
- Operation sound levels are valid at nominal operation condition
- dBA = A-weighted sound pressure level (A-scale according to IEC)
- Reference acoustic pressure 0dB = 20μPa

**RP250B7**

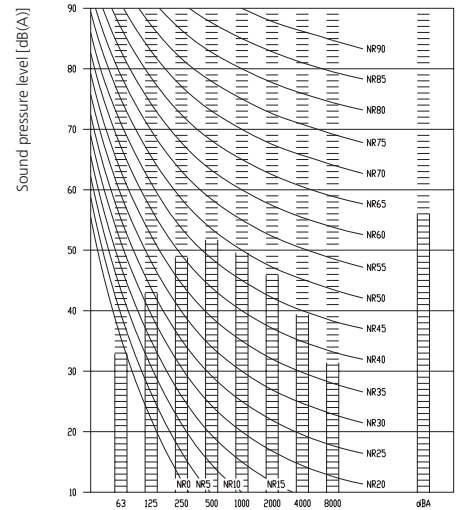

3TW23627-1

Octave band center frequency (Hz)



## 9 Accessories

### 9-1 Standard accessories


9

R25-45GZ7: Low ambient temperature kit: KIS111Z7

9-1

RP200-205B7

Check if the following accessories (gas pipes) are included with your unit.

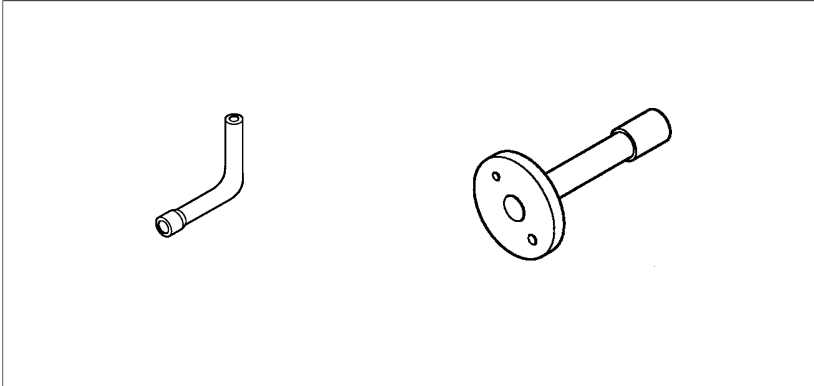

# 9 Accessories

## 9-2 Optional accessories



### R25-35GZ7V11/R45GZ7V11/W11

Description	Option
Drain piping kit - one drain outlet	KIS95

9  
9-2

### Available options for RP71-125B7(V1,W1,T1)

Name of option	Kit name		
	RP71B7	RP100B7	RP125B7
Central drain plug	KKPJ5F180		
Refrigerant branch piping	Twin	KHRP79BA7	
	Triple	-	KHRP96H7

3TW23189-1



### Available options for RP200-250B7W1

Option	Option name	RP200B7	RP250B7
Fan motor size up	NFM22C5	X	
Fan motor size up	NFM22C10		X
Kit for discharge duct	EKND26A10	X	X
Refnet	KHRP79BA7	Refer to the table with possible indoor combinations*	
Refnet	KHRP102BA7		
Refnet	KHRP127HA7		

3TW23619-2

\*Table with possible indoor combinations = combination matrix 3TW23619-1, see chapter RP-B7 (twin / triple / double twin application).

Refnet kits overview

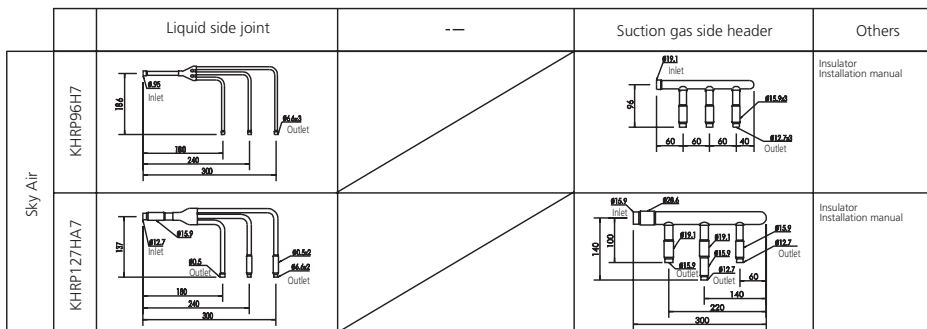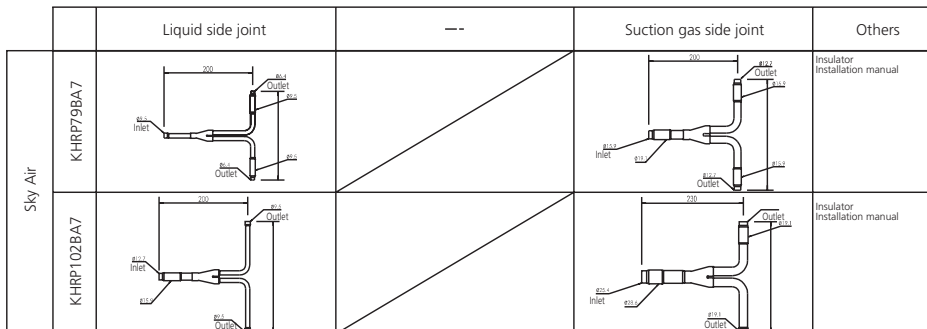

# 10 Safety device settings



## 10 Outdoor units

Safety device	Model	R25GZ7V11	R35GZ7V11	R45GZ7V11	R45GZ7W11	R60GZ7W1
Fan motor Thermal protector		Off 135 ±5°C On 87 ±15°C	Off 145 ±5°C On 75 ±15°C	Off 135 ±5°C On 87 ±15°C	Off 135 ±5°C On 87 ±15°C	Off 135 ±5°C On 86 ±15°C
Compressor Internal protector		-	-	Off 165 ±5°C On 100 ±11°C	~	Off 120 ±5°C On 98 ±11°C
Overload relay		Off 140 ±5°C On 69 ±11°C	Off 150 ±5°C On 69 ±11°C	Off 120 ±3°C On 95 ±10°C	Off 120 ±5°C On 98 ±11°C	~
Overcurrent relay		*Off Minimum 6,7A Maximum 8.7A	*Off Minimum 10,1A Maximum 13.0A	~	Off 5A ±10%	Off 7A ±10%

Note: \* shows U/T data (based on air temp. 80°C)

4TW00871-2D

# 11 Installation




The numerical figures used here represent the dimensions for the models R71 to 125. The figures inside ( ) indicate the dimensions for the models R100 and 125. (Unit:mm)  
 The figures inside < > indicate the dimension of discharge grille when it is installed facing downward  
 When installing multiple units in lateral connection, discharge grille cannot be set to discharge air in Left/Right direction

## (A) In case obstacles exist in front of the air inlet

- Where there are no obstacles above the unit


- 1 Installation of single unit
  - In case obstacles exist only in front of the air inlet.
  - In case obstacles exist in front of the air inlet and on both sides of the unit.
- 2 Installation of multiple units in lateral connection (2 units or more).

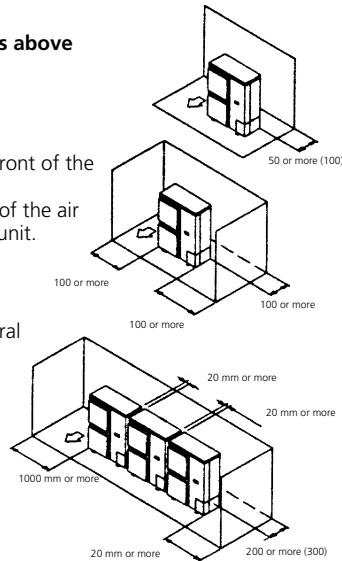

- In case obstacles exist in front of the air inlet and on both sides of the unit.

- Where there are obstacles above the unit.


- 1 Installation of single unit
    - In case obstacles exist only in front of the air inlet.
    - In case obstacles exist in front of the air inlet and on both sides of the unit.
  - 2 Installation of multiple units in lateral connection (2 units or more).
- In case obstacles exist in front of the air inlet and on both sides of the unit.

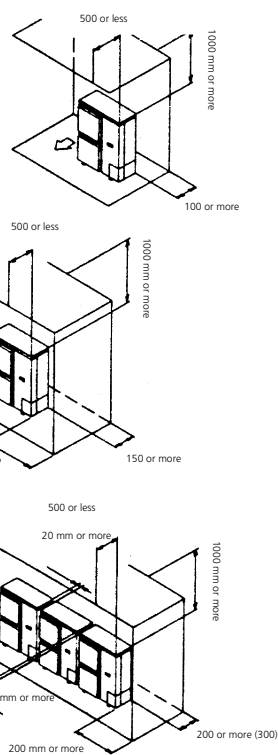

## (B) In case obstacles exist only in front of outlet side


- Where there are no obstacles above the unit.

- 1 Installation of single unit
  - In case obstacles exist only in front of outlet side.
- 2 Installation of multiple units in lateral connection (2 units or more).

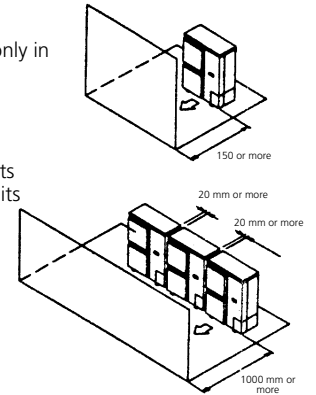

- Where there are obstacles above the unit.

- 1 Installation of single unit
    - In case obstacles exist only in front of outlet side.
  - 2 Installation of multiple units in lateral connection (2 units or more).
- In case obstacles exist only in front of outlet side.

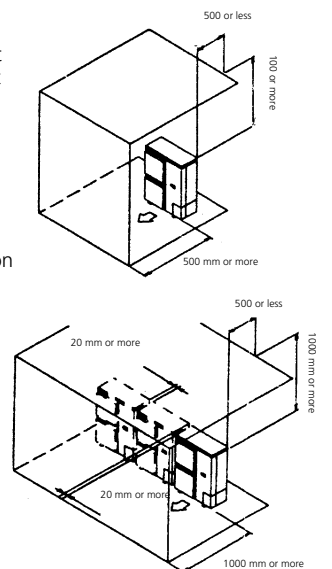


## (C) In case obstacles exist in front of both the air inlet and outlet sides.

Pattern 1

Where obstacle in front of the air outlet is higher than the unit.

- Where there are no obstacles above the unit.

- 1 Installation of single unit.
- 2 Installation of multiple units in lateral connection (2 units or more).

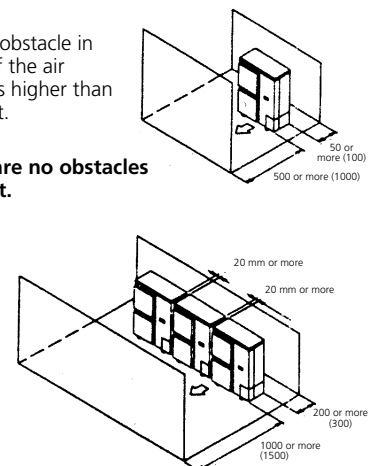

DU427-826



# 11 Installation


## 11

### • Where there are obstacles above the unit.

1 Installation of single unit.

Relation of dimensions of H, A, and L are shown in the table below.

	L	A
L ≤ H	0 < L ≤ 1/2 H	750 < 1250 >
	1/2 H < L	1000 < 1500 >
H < L	Set the frame to be L ≤ H	




Get the lower part of the frame sealed so that air from the outlet does not bypass

2 Installation of multiple units in lateral connection (2 units or more).

Relation of dimensions of H, A, and L are shown in the table below.

	L	A
L ≤ H	0 < L ≤ 1/2 H	1000 < 1500 >
	1/2 H < L	1250 < 1750 >
H < L	Set the frame to be L ≤ H	

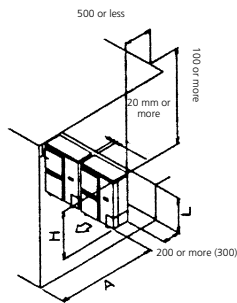


Get the lower part of the frame sealed so that air from the outlet does not bypass  
Do not install more than 2 units

#### Pattern 2

Where obstacle in front of the air outlet is lower than the unit.

### • Where there are no obstacles above the unit.


1 Installation of single unit.



2 Installation of multiple units in lateral connection (2 units or more).

Relation of dimensions of H, A, and L are shown in the table below.

	L	A
L ≤ H	0 < L ≤ 1/2 H	150 (250)
	1/2 H < L	200 (300)

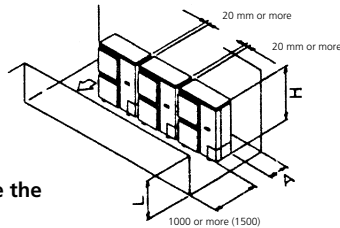


### • Where there are obstacles above the unit.

1 Installation of single unit.

Relation of dimensions of H, A, and L are shown in the table below.

	L	A
L ≤ H	0 < L ≤ 1/2 H	50 (100)
	1/2 H < L	100 (200)
H < L	Set the frame to be L ≤ H	




Get the lower part of the frame sealed so that air from the outlet does not bypass

2 Installation of multiple units in lateral connection (2 units or less).

Relation of dimensions of H, A, and L are shown in the table below.

	L	A
L ≤ H	0 < L ≤ 1/2 H	150 (250)
	1/2 H < L	200 (300)
H < L	Set the frame to be L ≤ H	



Get the lower part of the frame sealed so that air from the outlet does not bypass

Do not install more than 2 units


### (D) In case of stacked installation

1 In case obstacles exist in front of the outlet side.

Do not stack more than one unit.

About 100mm is required as the dimension for laying the upper outdoor unit's drain pipe.

Get the portion A sealed so that air from the outlet does not bypass.




2 In case obstacles exist in front of the air inlet.

Do not stack more than one unit.


About 100mm is required as the dimension for laying the upper outdoor unit's drain pipe.

Get the portion A sealed so that air from the outlet does not bypass.




### (E) In case of multiple-low installation (for roof top use, etc.).

1 In case of installing one unit per row.

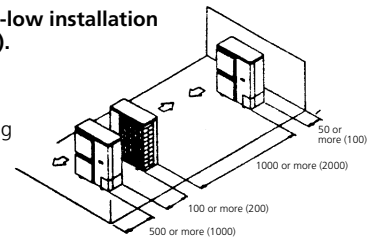

2 In case of installing multiple units (2 units or more) in lateral connection per row.

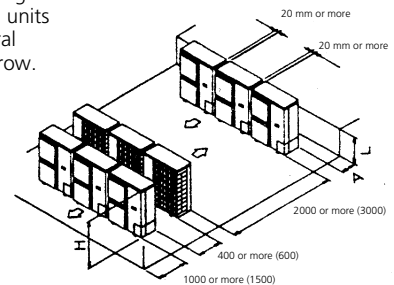

Relation of dimensions of H, A, and L are shown in the table below.

	L	A
L ≤ H	0 < L ≤ 1/2 H	150 (250)
	1/2 H < L	200 (300)
H < L	Installation impossible	

# 11 Installation




DAIKIN


DAIKIN

## Single installation


### Case 1



### Case 2




### Case 3




## Installation in a row


### Case 1

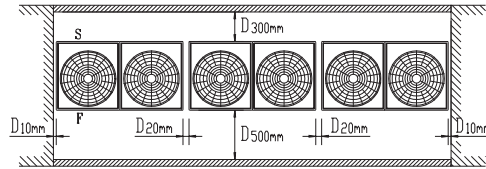

### Case 2

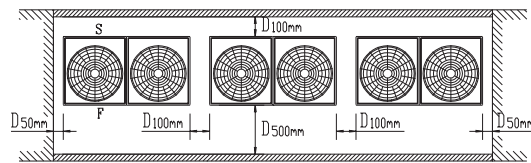


### Case 3




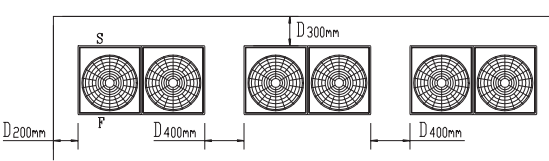


## Concentrated installation

### Case 1

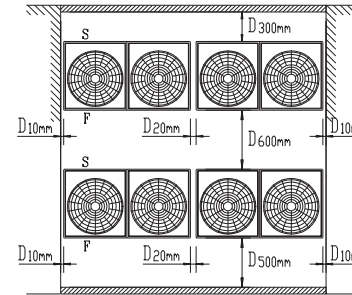

### Case 2

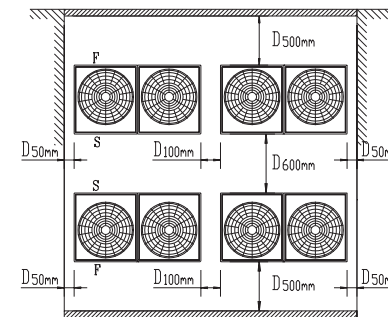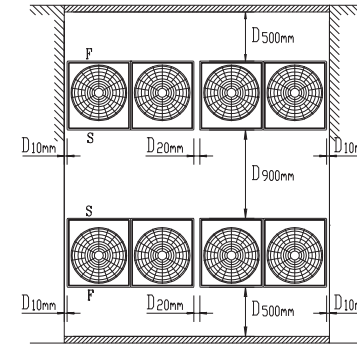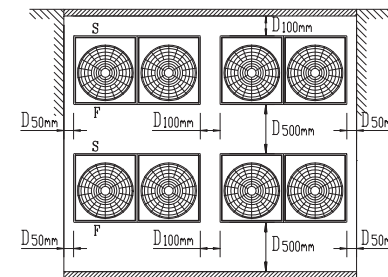

- 1 Case 1 and case 2
  - Front wall height is 1500mm
  - Suction wall height is 500mm
  - Side wall height has no limit
  - Case 3 wall height has no limit
- 2 If the wall is higher than mentioned in note 1: ADO h2/2 (front side) and ANO h1/2 (suction side) to the mentioned values for installation. (h1 and h2: see figure to the left)
- 3 Before installing, please check the passage of humans and air at the side, and select a place which is suitable for the case. (If there are a lot of units to be installed, take care that there is no shortcircuit of air)
- 4 Please install considering piping installation at the front side.

3TW23619-4

# 11 Installation



## 11 Refrigerant pipe size

### 1. Pair system (fig. 1)

Outdoor unit	Refrigerant pipe size	
	Gas pipe	Liquid pipe
RP200	∅ 28.8	∅ 12.7
RP250	∅ 28.8	∅ 15.9

### Additional charge

The units require additional charging of refrigerant, according to the length of pipe connected at the size. The correct amount of refrigerant to charge 'G' (kg) can be found by using the following formulas (If  $G < 0$ : no addition is required).

### 1. Pair system

L1 (m) One way length of liquid pipe

RP200	$G = (L1-30) \cdot 0.06$
RP250	$G = (L1-30) \cdot 0.09$

### Allowable pipe length

See the table below concerning lengths and heights. Refer to the figures. Assume that the longest line in the figure corresponds with the actual longest pipe, and the highest unit in the figure corresponds with the actual highest unit.

Maximum allowable pipe length (figures between parenthesis represent equivalent length)	Pair	L1	50m (70m)
Maximum height between indoor and outdoor	All	H1	30m

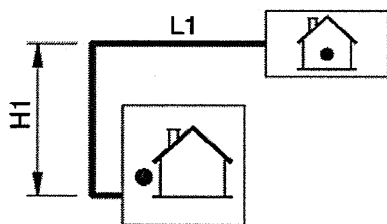


fig. 1: Pair

3TW23619-3