



Air Conditioning Technical Data



EEDEN13-100

RZQSG-L(3/8)V1

TABLE OF CONTENTS

RZQSG-L(3/8)V1

1	Features	2
2	Specifications	3
	Nominal Capacity And Nominal Input	3
	Technical Specifications	5
	Electrical Specifications	7
3	Electrical data	8
	Electrical Data	8
4	Options	11
	Options	11
5	Combination table	12
	Combination Table	12
6	Capacity tables	13
	Cooling Capacity Tables	13
	Heating Capacity Tables	17
	Capacity Correction Factor	21
7	Dimensional drawings	22
	Dimensional Drawings	22
8	Centre of gravity	24
	Centre of Gravity	24
9	Piping diagrams	26
	Piping Diagrams	26
	Piping Diagram Twin Application	27
	Piping Diagram Triple Application	28
	Piping Diagram Double Twin Application	29
10	Wiring diagrams	30
	Wiring Diagrams - Single Phase	30
11	Sound data	32
	Sound Power Spectrum	32
	Sound Pressure Spectrum - Cooling	33
	Sound Pressure Spectrum - Heating	34
	Sound Pressure Spectrum Quiet Mode	35
12	Installation	36
	Installation Method	36
13	Operation range	39
	Operation Range	39

1 Features

- Seasonal classic series already comply with EU's 2014 Eco-Design requirements
- Top efficiency: - new compressor that offers substantial efficiency improvements - new control logic that optimises efficiency at the most frequently encountered operating conditions and that optimises the auxiliary modes (when the unit is not active) - newly designed heat exchangers that optimise the refrigerant flow at the most frequent operating conditions (temperature and load) - via improved nominal performances
- Re-use of existing R-22 or R-407C technology
- Guarantees operation in heating mode down to -15°C
- Maximum piping length up to 50m, minimum piping length is 5m.
- Daikin outdoor units are neat, sturdy and can easily be mounted on a roof or terrace or simply placed against an outside wall
- Seasonal efficiency, optimized for all seasons.
- Seasonal efficiency gives an indication on how efficient an air conditioner operates over an entire heating or cooling season.



Inverter

2 Specifications

2-1 Nominal Capacity And Nominal Input			FCQHG71F/RZQSG71L3V1	FCQHG100F/RZQSG100L8V1	FCQHG125F/RZQSG125L8V1	FCQHG140F/RZQSG140L1V1	
Cooling capacity	Nom.	kW	6.8	9.5	12.0	13.4	
Heating capacity	Nom.	kW	7.5	10.8	13.5	15.5	
Seasonal efficiency (according to EN14825)	Cooling	Energy label		A++		A	-
		Pdesign	kW	6.80	9.50	12.00	-
		SEER		6.50	6.70	5.40	-
		Annual energy consumption	kWh	366	496	777	-
	Heating (Average climate)	Energy label		A+		-	-
		Pdesign	kW	7.60	8.03		-
		SCOP		4.15	4.30	4.10	-
		Annual energy consumption	kWh	2,563	2,614	2,741	-
Nominal efficiency (cooling at 35°/27° nominal load, heating at 7°/20° nominal load)	EER		3.50	3.70	3.23	3.21	
	COP		4.10	4.30	3.75	3.61	
	Annual energy consumption		kWh	1,059	1,285	1,855	2,085
	Energy label	Cooling		A		-	-
		Heating		A		-	-

Notes

(1) EER/COP according to Eurovent 2012

2-1 Nominal Capacity And Nominal Input			FCQG71F/RZQSG71L3V1	FCQG100F/RZQSG100L8V1	FCQG125F/RZQSG125L8V1	FCQG140F/RZQSG140L1V1	
Cooling capacity	Nom.	kW	6.8	9.5	12.0	13.4	
Heating capacity	Nom.	kW	7.5	10.8	13.5	15.5	
Seasonal efficiency (according to EN14825)	Cooling	Energy label		A++		A	-
		Pdesign	kW	6.80	9.50	12.00	-
		SEER		6.10	6.50	5.30	-
		Annual energy consumption	kWh	390	511	792	-
	Heating (Average climate)	Energy label		A+		-	-
		Pdesign	kW	6.33	7.60	8.03	-
		SCOP		4.10		4.01	-
		Annual energy consumption	kWh	2,162	2,595	2,803	-
Nominal efficiency (cooling at 35°/27° nominal load, heating at 7°/20° nominal load)	EER		3.21	3.30	3.21	3.01	
	COP		3.61	3.54	3.41		
	Annual energy consumption		kWh	971	1,440	1,870	2,225
	Energy label	Cooling		A		-	-
		Heating		A	B		-

Notes

(1) EER/COP according to Eurovent 2012

2-1 Nominal Capacity And Nominal Input			FAQ71C/RZQSG71L3V1		FAQ100C/RZQSG100L8V1		
Cooling capacity	Nom.	kW	6.8		9.5		
Heating capacity	Nom.	kW	7.5		10.8		
Seasonal efficiency (according to EN14825)	Cooling	Energy label		A+		-	
		Pdesign	kW	6.80		9.50	
		SEER		6.05		5.61	
		Annual energy consumption	kWh	393		592	
	Heating (Average climate)	Energy label		A		A+	
		Pdesign	kW	6.00		6.81	
		SCOP		3.90		4.01	
		Annual energy consumption	kWh	2,155		2,377	

2 Specifications

2-1 Nominal Capacity And Nominal Input			FAQ71C/RZQSG71L3V1	FAQ100C/RZQSG100L8V1
Nominal efficiency (cooling at 35°/27° nominal load, heating at 7°/20° nominal load)	EER		3.21	3.01
	COP		3.61	3.41
	Annual energy consumption	kWh	1,059	1,580
	Energy label	Cooling		A
Heating			A	B

Notes

(1) EER/COP according to Eurovent 2012

2-1 Nominal Capacity And Nominal Input			FVQ71C/RZQSG71L3V1	FVQ100C/RZQSG100L8V1	FVQ125C/RZQSG125L8V1	FVQ140C/RZQSG140L1V1	
Cooling capacity	Nom.	kW	6.8	9.5	12.0	13.4	
Heating capacity	Nom.	kW	7.5	10.8	13.5	15.5	
Seasonal efficiency (according to EN14825)	Cooling	Energy label		A			-
		Pdesign	kW	6.80	9.50	12.00	-
		SEER		5.50			-
		Annual energy consumption	kWh	433	604	763	-
	Heating (Average climate)	Energy label		A	A+	A	-
		Pdesign	kW	6.33	7.60		-
		SCOP		3.86	4.01	3.85	-
		Annual energy consumption	kWh	2,296	2,653	2,763	-
Nominal efficiency (cooling at 35°/27° nominal load, heating at 7°/20° nominal load)	EER		3.21			3.01	
	COP		3.61			3.41	
	Annual energy consumption	kWh	1,059	1,480	2,135	2,225	
	Energy label	Cooling		A		C	-
Heating			A		B	-	

Notes

(1) EER/COP according to Eurovent 2012

2-1 Nominal Capacity And Nominal Input			FBQ71C8/RZQSG71L3V1	FBQ100C8/RZQSG100L8V1	FBQ125C8/RZQSG125L8V1	FBQ140C8/RZQSG140L1V1	
Cooling capacity	Nom.	kW	6.8	9.5	12.0	13.4	
Heating capacity	Nom.	kW	7.5	10.8	13.5	15.5	
Seasonal efficiency (according to EN14825)	Cooling	Energy label		A+	A		-
		Pdesign	kW	6.80	9.50	12.00	-
		SEER		5.81	5.50	5.20	-
		Annual energy consumption	kWh	410	604	807	-
	Heating (Average climate)	Energy label		A	A+	A	-
		Pdesign	kW	6.00	7.60		-
		SCOP		3.88	4.01	3.90	-
		Annual energy consumption	kWh	2,166	2,653	2,728	-
Nominal efficiency (cooling at 35°/27° nominal load, heating at 7°/20° nominal load)	EER		3.28	3.31	3.21	3.02	
	COP		3.61	3.65	3.51	3.41	
	Annual energy consumption	kWh	1,037	1,435	1,870	2,220	
	Energy label	Cooling		A			-
Heating			A		B	-	

Notes

(1) EER/COP according to Eurovent 2012

2 Specifications

2-1 Nominal Capacity And Nominal Input			FDQ125C/RZQSG125L8V1		
Cooling capacity	Nom.	kW	12.0		
Heating capacity	Nom.	kW	13.5		
Seasonal efficiency (according to EN14825)	Cooling	Energy label		A	
		Pdesign	kW	12.00	
		SEER		5.20	
		Annual energy consumption	kWh	807	
	Heating (Average climate)	Energy label		A	
		Pdesign	kW	7.60	
		SCOP		3.90	
		Annual energy consumption	kWh	2,728	
Nominal efficiency (cooling at 35°/27° nominal load, heating at 7°/20° nominal load)	EER		3.21		
	COP		3.51		
	Annual energy consumption		kWh	1,870	
	Energy label	Cooling		A	
		Heating		B	

Notes

(1) EER/COP according to Eurovent 2012

2-1 Nominal Capacity And Nominal Input			FHQ71C/RZQSG71L3V1	FHQ100C/RZQSG100L8V1	FHQ125C/RZQSG125L8V1	FHQ140C/RZQSG140LV1	
Cooling capacity	Nom.	kW	6.8	9.5	12.0	13.4	
Heating capacity	Nom.	kW	7.5	10.8	13.5	15.5	
Seasonal efficiency (according to EN14825)	Cooling	Energy label		A+		-	
		Pdesign	kW	6.80	9.50	12.00	-
		SEER		5.61		-	
		Annual energy consumption	kWh	424	592	748	-
	Heating (Average climate)	Energy label		A		A+	-
		Pdesign	kW	7.60		-	
		SCOP		3.90	3.91	4.01	-
		Annual energy consumption	kWh	2,727	2,721	2,653	-
Nominal efficiency (cooling at 35°/27° nominal load, heating at 7°/20° nominal load)	EER		3.46	3.21	2.89	3.01	
	COP		4.00	3.61	3.62	3.41	
	Annual energy consumption		kWh	983	1,480	2,075	2,225
	Energy label	Cooling		A		C	-
		Heating		A		-	

Notes

(1) EER/COP according to Eurovent 2012

2-2 Technical Specifications				RZQSG71L3V1	RZQSG100L8V1	RZQSG125L8V1	RZQSG140LV1
Capacity control	Method			Inverter controlled			
Casing	Colour			Ivory white			
	Material			Painted galvanized steel plate			
Dimensions	Unit	Height	mm	770	990		1,430
		Width	mm	900	940		
		Depth	mm	320			
	Packed unit	Height	mm	900	1,170		1,610
		Width	mm	980	1,015		
		Depth	mm	420	422		
Weight	Unit		kg	67	81		102
	Packed unit		kg	71	92		115

2 Specifications

2

2-2 Technical Specifications					RZQSG71L3V1	RZQSG100L8V1	RZQSG125L8V1	RZQSG140LV1	
Heat exchanger	Length		mm	857					
	Rows	Quantity		2					
	Fin pitch		mm	1.4					
	Passes	Quantity		8					
	Face area		m ²	0.641					
	Stages	Quantity		34					
	Empty tubeplate hole	Quantity		0					
	Tube type		ø8 Hi-XSS						
	Fin	Type	WF fin						
Treatment		Anti-corrosion treatment (PE)							
Compressor	Quantity		1						
	Model		2YC63DXD						
	Type		Hermetically sealed swing compressor						
	Output	W	1,700						
	Starting method		Inverter driven						
Fan	Type		Propeller fan						
	Discharge direction		Horizontal						
	Quantity		1			2			
	Air flow rate	Cooling	Nom.	m ³ /min	52	76	77	83	
			Super low	m ³ /min					
		Heating	Nom.	m ³ /min	48	83		62	
			Super low	m ³ /min					
			cfm						
			cfm						
Fan motor	Quantity		1			2			
	Model		KFD-325-70-8A		Brushless DC motor				
	Output	W	70	200		94			
	Drive		Direct drive						
	Speed	Steps		8					
		Cooling	Nom.	rpm	800				
			Super low	rpm					
	Heating	Nom.	rpm	745					
		Super low	rpm						
Sound power level	Cooling	Nom.	dBA	65	69	70	69		
Sound pressure level	Cooling	Nom.	dBA	49	53	54	53		
		Silent operation	dBA	47	49				
	Heating	Nom.	dBA	51	57	58	54		
Operation range	Cooling	Ambient	Min.	°CDB	-5.0				
			Max.	°CDB	46				
	Heating	Ambient	Min.	°CWB	-15				
			Max.	°CWB	15.5				
Refrigerant	Type		R-410A						
	Charge		kg	2.75	2.9		4.0		
	Control		Expansion valve (electronic type)						
	GWP		1,975						
	Circuits	Quantity		1					
Refrigerant oil	Type		FVC50K						
	Charged volume		l	0.75	0.9		1.35		

2 Specifications

2-2 Technical Specifications				RZQSG71L3V1	RZQSG100L8V1	RZQSG125L8V1	RZQSG140LV1
Piping connections	Liquid	Quantity		1			
		Type		Flare connection			
		OD	mm	9.52			
	Gas	Quantity		1			
		Type		Flare connection			
		OD	mm	15.9			
	Drain	Quantity		3	5		
		Type		Hole			
		ID	mm	-			
		OD	mm	26			
	Piping length	OU - IU	Min.	m	5		
			Max.	m	30	50	
		System	Equivalent	m	40	70	
Chargeless			m	30			
Additional refrigerant charge			kg/m	-	See installation manual		
Level difference	IU - OU	Max.	m	15	30.0		
	IU - IU	Max.	m	0.5			
Heat insulation			Both liquid and gas pipes				
Defrost method			Pressure equalising	Reversed cycle			
Defrost control			Sensor for outdoor heat exchanger temperature				
Safety devices	Item	01		High pressure switch			
		02		Fan motor thermal protection	Fan driver overload protector		
		03		Fuse			

2-3 Electrical Specifications				RZQSG71L3V1	RZQSG100L8V1	RZQSG125L8V1	RZQSG140LV1
Power supply	Name		V1				
	Phase		1~				
	Frequency		Hz	50			
	Voltage		V	220-240			
	Voltage range	Min.	%	10			
		Max.	%	10			
Current	Zmax	List	-	Complies to EN61000-3-11			
	Recommended fuses		A	25	40		
Current - 50Hz	Maximum fuse amps (MFA)		A	20	32		
Current - 60Hz	Maximum fuse amps (MFA)		A	-			
Wiring connections	For power supply	Remark	-	See installation manual outdoor unit			
	For connection with indoor	Remark	-	See installation manual outdoor unit			
Power supply intake			Outdoor unit only				

Notes

- (1) PED: assembly = category I : excluded from scope of PED due to article 1, item 3.6 of 97/23/EC
- (2) Equipment complying with EN/IEC 61000-3-12: European/international technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current $> 16A$ and $\leq 75A$ per phase
- (3) See separate drawings for electrical data
- (4) See separate drawing for electrical data
- (5) European/international technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current larger than $16A$ and $\leq 75A$ per phase.
- (6) Short-circuit power
- (7) Related to 3D076918

3 Electrical data

3 - 1 Electrical Data

RZQSG71L3V1

Indoor	Outdoor	Hz-Power supply	Voltage range	Comp					OFM		IFM		
				MCA	TOCA	MFA	MSC	RLA	kW	FLA	kW	FLA	
FCQH71FVEB		RZQSG71L3V1	50Hz 220-240V	Min. 198V Max. 264V	18.8	—	20	—	16.2	0.07	0.3	0.091	0.5
FCQG35FVEB	x2				18.9	—	20	—	16.2	0.07	0.3	0.044x2	0.3x2
FCQG71FVEB					18.7	—	20	—	16.2	0.07	0.3	0.054	0.4
FFQ35B9V1B	x2				19.2	—	20	—	16.2	0.07	0.3	0.055x2	0.4x2
FFQ35C2VEB	x2				18.9	—	20	—	16.2	0.07	0.3	0.050x2	0.3x2
FBC35C8VEB	x2				21.2	—	25	—	16.2	0.07	0.3	0.140x2	1.2x2
FBQ71C8VEB					19.5	—	20	—	16.2	0.07	0.3	0.350	1.1
FHQ35B9V1B	x2				19.7	—	20	—	16.2	0.07	0.3	0.062x2	0.6x2
FHQG71CVEB					19.2	—	20	—	16.2	0.07	0.3	0.091	0.8
FAQ71CVEB					18.7	—	20	—	16.2	0.07	0.3	0.048	0.4
FVQ71CVEB					18.9	—	20	—	16.2	0.07	0.3	0.117	0.6

SYMBOLS

MCA	: Min. Circuit Amps. (A)
TOCA	: Total Over-Current Amps. (A)
MFA	: Max. Fuse Amps. (See note 7) (A)
MSC	: Max. current during the starting compressor. (A)
RLA	: Rated Load Amps. (A)
OFM	: Outdoor Fan Motor. (A)
IFM	: Indoor Fan Motor.
FLA	: Full Load Amps.
kW	: Fan Motor Rated Output. (kW)

NOTES

- 1 RLA is based on the following conditions:
Power supply: 50Hz 230V
Cooling
Indoor temperature 27.0°CDB/19.0°CWB
Outdoor temperature 35.0°CDB
Heating
Indoor temperature 20.0°CDB
Outdoor temperature 7.0°CDB / 6.0°CWB
- 2 TOCA means the total value of each OC set.
- 3 Voltage range
Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed range limits.
- 4 Maximum allowable voltage variation between phases is 2%.
- 5 MCA represents maximum input current. MFA represents capacity which may accept MCA.
(next lower standard fuse rating, min.15A)
- 6 Select wire size based on the larger value of MCA or TOCA.
- 7 MFA is used to select the circuit breaker and the ground fault circuit interrupter.
(earth leakage circuit breaker)

3D082372

3 Electrical data

3 - 1 Electrical Data

RZQSG100L8V1

Indoor	Outdoor	Hz-Power supply	Voltage range				Comp		OFM		IFM		
				MCA	TOCA	MFA	MSC	RLA	kW	FLA	kW	FLA	
FCQHG100FVEB	RZQSG100L8V1	50Hz 220-240V	Min. 198V Max. 264V	29,1	—	32	—	24,4	0,2	0,6	0,221	1,3	
FCQG35FVEB				x3	28,6	—	32	—	24,4	0,2	0,6	0,044x3	0,3x3
FCQG50FVEB				x2	28,3	—	32	—	24,4	0,2	0,6	0,039x2	0,3x2
FCQG100FVEB					28,4	—	32	—	24,4	0,2	0,6	0,117	0,7
FFQ35B9V1B				x3	29,0	—	32	—	24,4	0,2	0,6	0,055x3	0,4x3
FFQ50B9V1B				x2	29,3	—	32	—	24,4	0,2	0,6	0,055x2	0,7x2
FBQ35C8VEB				x3	32,0	—	40	—	24,4	0,2	0,6	0,140x3	1,2x3
FBQ50C8VEB				x2	30,5	—	32	—	24,4	0,2	0,6	0,140x2	1,2x2
FBQ100C8VEB					29,5	—	32	—	24,4	0,2	0,6	0,350	1,6
FHQ35B9V1B				x3	29,8	—	32	—	24,4	0,2	0,6	0,062x3	0,6x3
FHQ50B9V1B				x2	29,0	—	32	—	24,4	0,2	0,6	0,062x2	0,6x2
FHQG100CVEB					29,0	—	32	—	24,4	0,2	0,6	0,150	1,2
FAQ100CVEB					28,0	—	32	—	24,4	0,2	0,6	0,064	0,4
FVQ100CVEB					29,0	—	32	—	24,4	0,2	0,6	0,238	1,2
FHQ35CAVEB				x3	29,8	—	32	—	24,4	0,2	0,6	0,060 x 3	0,6 x 3
FHQ50CAVEB				x2	29,0	—	32	—	24,4	0,2	0,6	0,060 x 2	0,6 x 2
FHQ100CAVEB					29,1	—	32	—	24,4	0,2	0,6	0,150	1,3

SYMBOLS

MCA	: Min. Circuit Amps. (A)
TOCA	: Total Over-Current Amps. (A)
MFA	: Max. Fuse Amps. (See note 7) (A)
MSC	: Max. current during the starting compressor. (A)
RLA	: Rated Load Amps. (A)
OFM	: Outdoor Fan Motor. (A)
IFM	: Indoor Fan Motor.
FLA	: Full Load Amps.
kW	: Fan Motor Rated Output. (kW)

NOTES

- 1 RLA is based on the following conditions:
Power supply: 50Hz 230V
Cooling
Indoor temperature 27.0°CDB/19.0°CWB
Outdoor temperature 35.0°CDB
Heating
Indoor temperature 20.0°CDB
Outdoor temperature 7.0°CDB / 6.0°CWB
- 2 TOCA means the total value of each OC set.
- 3 Voltage range
Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed range limits.
- 4 Maximum allowable voltage variation between phases is 2%.
- 5 MCA represents maximum input current. MFA represents capacity which may accept MCA. (next lower standard fuse rating, min.15A)
- 6 Select wire size based on the larger value of MCA or TOCA.
- 7 MFA is used to select the circuit breaker and the ground fault circuit interrupter. (earth leakage circuit breaker)

3D076357A

3 Electrical data

3 - 1 Electrical Data

RZQSG125-140L(8)V1

Indoor	Outdoor	Hz-Power supply	Voltage range	MCA		TOCA		MFA		Comp		OFM		IFM				
				MCA	TOCA	MFA	MSC	RLA	kW	FLA	kW	FLA						
FCQHG125FVEB		RZQSG125L8V1	50Hz 220-240V	Min. 198V Max. 264V	29,3	—	32	—	24,4	0,2	0,6	0,244	1,4					
FCQG35FVEB	x4				29,0	—	32	—	24,4	0,2	0,6	0,044x4	0,3x4					
FCQG50FVEB	x3				28,6	—	32	—	24,4	0,2	0,6	0,039x3	0,3x3					
FCQG60FVEB	x2				28,3	—	32	—	24,4	0,2	0,6	0,044x2	0,3x2					
FCQG125FVEB					28,8	—	32	—	24,4	0,2	0,6	0,168	1,0					
FFQ35B9V1B	x4				29,5	—	32	—	24,4	0,2	0,6	0,055x4	0,4x4					
FFQ50B9V1B	x3				30,1	—	32	—	24,4	0,2	0,6	0,055x3	0,7x3					
FFQ60B9V1B	x2				29,3	—	32	—	24,4	0,2	0,6	0,055x2	0,7x2					
FBQ35C8VEB	x4				33,5	—	40	—	24,4	0,2	0,6	0,140x4	1,2x4					
FBQ50C8VEB	x3				32,0	—	40	—	24,4	0,2	0,6	0,140x3	1,2x3					
FBQ60C8VEB	x2				30,3	—	32	—	24,4	0,2	0,6	0,350x2	1,1x2					
FBQ125C8VEB					30,1	—	32	—	24,4	0,2	0,6	0,350	2,1					
FHQ35BWW1B	x4				30,5	—	32	—	24,4	0,2	0,6	0,062x4	0,6x4					
FHQ50BWW1B	x3				29,8	—	32	—	24,4	0,2	0,6	0,062x3	0,6x3					
FHQ60BWW1B	x2				29,0	—	32	—	24,4	0,2	0,6	0,062x2	0,6x2					
FHQG125CVEB					29,5	—	32	—	24,4	0,2	0,6	0,150	1,6					
FDQ125C7VEB					30,1	—	32	—	24,4	0,2	0,6	0,350	2,1					
FVQ125CVEB					29,0	—	32	—	24,4	0,2	0,6	0,238	1,2					
FHQ35CAVEB	x4				30,5	—	32	—	24,4	0,2	0,6	0,060x4	0,6 x 4					
FHQ50CAVEB	x3				29,8	—	32	—	24,4	0,2	0,6	0,060x3	0,6 x 3					
FHQ60CAVEB	x2				29,0	—	32	—	24,4	0,2	0,6	0,091x2	0,6 x 2					
FHQ125CAVEB					29,4	—	32	—	24,4	0,2	0,6	0,150	1,5					
FCQHG71FVEB	x2				RZQSG140L1V1	50Hz 220-240V	Min. 198V Max. 264V	28,8	—	32	—	24,2	0,094+0,094	0,4+0,4	0,091x2	0,5x2		
FCQHG140FVEB								29,3	—	32	—	24,2	0,094+0,094	0,4+0,4	0,244	1,4		
FCQG35FVEB	x4							29,0	—	32	—	24,2	0,094+0,094	0,4+0,4	0,044x4	0,3x4		
FCQG50FVEB	x3							28,6	—	32	—	24,2	0,094+0,094	0,4+0,4	0,039x3	0,3x3		
FCQG71FVEB	x2							28,5	—	32	—	24,2	0,094+0,094	0,4+0,4	0,054x2	0,4x2		
FCQG140FVEB								28,8	—	32	—	24,2	0,094+0,094	0,4+0,4	0,168	1,0		
FFQ35B9V1B	x4	29,5	—	32				—	24,2	0,094+0,094	0,4+0,4	0,055x4	0,4x4					
FFQ50B9V1B	x3	30,1	—	32				—	24,2	0,094+0,094	0,4+0,4	0,055x3	0,7x3					
FBQ35C8VEB	x4	33,5	—	40				—	24,2	0,094+0,094	0,4+0,4	0,140x4	1,2x4					
FBQ50C8VEB	x3	32,0	—	40				—	24,2	0,094+0,094	0,4+0,4	0,140x3	1,2x3					
FBQ71C8VEB	x2	30,3	—	32				—	24,2	0,094+0,094	0,4+0,4	0,350x2	1,1x2					
FBQ140C8VEB		30,1	—	32				—	24,2	0,094+0,094	0,4+0,4	0,350	2,1					
FHQ35BWW1B	x4	30,5	—	32				—	24,2	0,094+0,094	0,4+0,4	0,062x4	0,6x4					
FHQ50BWW1B	x3	29,8	—	32				—	24,2	0,094+0,094	0,4+0,4	0,062x3	0,6x3					
FHQG71CVEB	x2	29,5	—	32				—	24,2	0,094+0,094	0,4+0,4	0,091x2	0,8x2					
FHQG140CVEB		29,8	—	32				—	24,2	0,094+0,094	0,4+0,4	0,150	1,8					
FAQ71CVEB	x2	28,5	—	32				—	24,2	0,094+0,094	0,4+0,4	0,048x2	0,4x2					
FVQ140CVEB		29,3	—	32				—	24,2	0,094+0,094	0,4+0,4	0,276	1,4					
FHQ35CAVEB	x4	30,5	—	32				—	24,2	0,094+0,094	0,4+0,4	0,060 x 4	0,6 x 4					
FHQ50CAVEB	x3	29,8	—	32				—	24,2	0,094+0,094	0,4+0,4	0,060 x 3	0,6 x 3					
FHQ71CAVEB	x2	29,5	—	32				—	24,2	0,094+0,094	0,4+0,4	0,091 x 2	0,8 x 2					
FHQ140CAVEB		29,8	—	32				—	24,2	0,094+0,094	0,4+0,4	0,15	1,8					

SYMBOLS

MCA	: Min. Circuit Amps. (A)
TOCA	: Total Over-Current Amps. (A)
MFA	: Max. Fuse Amps. (See note 7) (A)
MSC	: Max. current during the starting compressor. (A)
RLA	: Rated Load Amps. (A)
OFM	: Outdoor Fan Motor. (A)
IFM	: Indoor Fan Motor.
FLA	: Full Load Amps.
kW	: Fan Motor Rated Output. (kW)

NOTES

- 1 RLA is based on the following conditions:
Power supply: 50Hz 230V
Cooling
Indoor temperature 27.0°CDB/19.0°CWB
Outdoor temperature 35.0°CDB
Heating
Indoor temperature 20.0°CDB
Outdoor temperature 7.0°CDB / 6.0°CWB
- 2 TOCA means the total value of each OC set.
- 3 Voltage range
Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed range limits.
- 4 Maximum allowable voltage variation between phases is 2%.
- 5 MCA represents maximum input current. MFA represents capacity which may accept MCA. (next lower standard fuse rating, min.15A)
- 6 Select wire size based on the larger value of MCA or TOCA.
- 7 MFA is used to select the circuit breaker and the ground fault circuit interrupter. (earth leakage circuit breaker)

3D076357A

4 Options

4 - 1 Options

RZQSG71L3V1

Available options for RZQSG models:

Name of option	Kit name	
	RZQSG71L3V1	
Bottom plate heater	-	
Refrigerant branch piping	Twin	KHRQ22M20TA (KHRQ58T): See note 2
Demand adapter kit	KRP58M51	

3D082349

4

RZQSG100-140L(8)V1

Available options for RZQSG models:

Name of option	Kit name		
	RZQSG100L8V1	RZQSG125L8V1	RZQSG140LV1
Bottom plate heater	-		
Refrigerant branch piping	Twin	KHRQ22M20TA (KHRQ58T): See note 2	
	Triple	KHRQ127H (KHRQ58H): See note 2	
	Double twin	-	KHRQ22M20TA (KHRQ58T): See note 2
Demand adapter kit	KRP58M51		

3D076079

NOTES


- 1 For combination of RZQG71L7V1B and EKBPH140L7 it is required to use the demand adapter kit KRP58M51 in order to connect the bottom plate heater.
- 2 For RZQ(S)G71-140LY1 in combination with FCQG35-71F or FCQH71F use the refrigerant branch piping mentioned between brackets.

6 Capacity tables

6 - 1 Cooling Capacity Tables

RZQSG71L3V1

Cooling

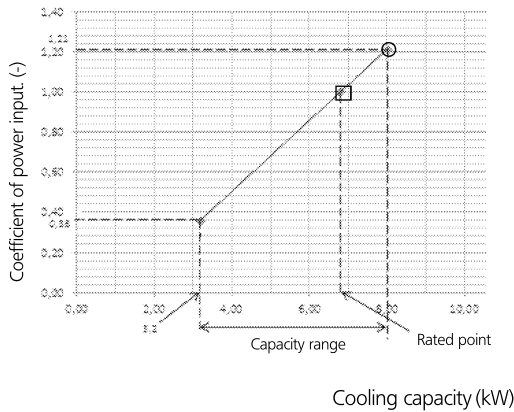

Cooling

Indoor		Outdoor temperature (°CDB)											
		25			30			35			40		
°CWB	°CDB	TC kW	SHC kW	CPI -	TC kW	SHC kW	CPI -	TC kW	SHC kW	CPI -	TC kW	SHC kW	CPI -
16.0	22	7.29	4.95	0.92	7.28	4.99	1.08	7.50	5.21	1.20	7.20	5.06	1.32
18.0	25	8.37	5.43	1.00	8.11	5.32	1.11	7.83	5.19	1.21	7.52	5.04	1.34
19.0	27	8.54	5.41	1.01	8.28	5.31	1.11	8.00	5.18	1.21	7.68	5.03	1.34
19.5	27	8.63	5.40	1.01	8.37	5.30	1.11	8.08	5.17	1.21	7.76	5.03	1.34
22.0	30	9.07	5.33	1.03	8.80	5.23	1.12	8.51	5.12	1.22	8.18	4.97	1.35
24.0	32	9.43	5.25	1.03	9.15	5.16	1.13	8.85	5.05	1.23	8.51	4.90	1.36

NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the mark with ○ show the max. at standard conditions.
On the figure the mark with □ show the rated capacity and rated coefficient of power input.
However the max. capacity is not guaranteed, except at standard condition.
- SHC is based on indoor EWB and EDB.
SHC for other dry bulb temp. = SHC + SHC*.
SHC* = SHC correction for other dry bulb.
= 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB).
- Capacities are based on the following conditions:
Outdoor air: 85% RH.
However, the condition rated capacity in heating is 7° CDB / 6° CWB.
Corresponding refrigerant piping length: 5.0 m.
Level difference: 0 m.
- Coefficient of power input is the percentage when the rated value is defined as 1.00.
- The value contains less than 5% error according to indoor unit type.
- Heating performance include the drop of frost formation.
- Air flow rate and (BF) are given in table below:

(Pair)

	FCQH71F	FCQ71F	FBQ71C	FHQ71C	FAQ71C	FVQ71C	FHQ71CA
AFR	21.2	21.5	18	20.5	18	18	20.5
(BF)	(0.2)	(0.14)	(0.08)	(0.13)	(0.16)	(0.16)	(0.13)

(Twin)

	FCQ35Fx2	FFQ35x2	FBQ35Cx2	FHQ35BwX2	FHQ35CAx2
AFR	12.5x2	10x2	16x2	13x2	14x2
(BF)	(0.4x2)	(0.25x2)	(0.15x2)	(0.20x2)	(0.17x2)

- Rated power input of each model is given in tables below:

(Pair)

	FCQH71F	FCQ71F	FBQ71C	FHQ71C	FAQ71C	FVQ71C	FHQ71CA
Cooling	1.94	2.12	2.07	1.97	2.12	2.12	1.97

(Twin)

	FCQ35Fx2	FFQ35x2	FBQ35Cx2	FHQ35BwX2	FHQ35CAx2
Cooling	2.28	2.30	2.11	2.51	2.47

SYMBOLS

- AFR: Air flow rate (m³/min)
 BF: Bypass factor
 EWB: Entering wet bulb temp. (°CWB)
 EDB: Entering dry bulb temp. (°CDB)
 TC: Maximum Total cooling (heating) capacity (kW)
 SHC: Sensible heat capacity (kW)
 PI: Power input
 (comp.+indoor and outdoor fan motor)
 CPI: Coefficient of power input. (-)

Caution:
TC and SHC are shown by kW.


3D082368

6 Capacity tables

6 - 1 Cooling Capacity Tables

RZQSG100L8V1

Cooling

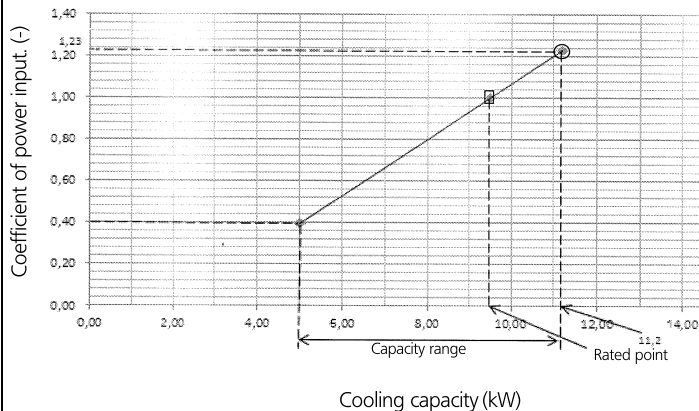

Cooling

Indoor		Outdoor temperature (°CDB)											
		25			30			35			40		
°CWB	°CDB	TC kW	SHC kW	CPI -	TC kW	SHC kW	CPI -	TC kW	SHC kW	CPI -	TC kW	SHC kW	CPI -
16.0	22	11.2	7.61	1.01	10.8	7.44	1.11	10.5	7.29	1.22	10.1	7.09	1.32
18.0	25	11.8	7.59	1.01	11.4	7.49	1.12	11.0	7.27	1.23	10.5	7.09	1.33
19.0	27	12.0	7.57	1.02	11.6	7.44	1.12	11.2	7.26	1.23	10.8	7.04	1.33
19.5	27	12.1	7.59	1.02	11.7	7.37	1.13	11.4	7.34	1.23	10.9	7.04	1.34
22.0	30	12.8	7.52	1.02	12.4	7.36	1.13	11.9	7.16	1.24	11.5	7.03	1.35
24.0	32	13.3	7.42	1.08	12.9	7.27	1.14	12.4	7.06	1.25	12.0	6.91	1.36

NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the mark with ○ show the max. at standard conditions.
On the figure the mark with □ show the rated capacity and rated coefficient of power input.
However the max. capacity is not guaranteed, except at standard condition.
- SHC is based on indoor EWB and EDB.
SHC for other dry bulb temp. = SHC + SHC*.
SHC* = SHC correction for other dry bulb.
= 0.02 x AFR (m³/min.) x (1-BF) x (DB*-EDB).
- Capacities are based on the following conditions:
Outdoor air: 85% RH.
However, the condition rated capacity in heating is 7° CDB / 6° CWB.
Corresponding refrigerant piping length: 5.0 m.
Level difference: 0 m.
- Coefficient of power input is the percentage when the rated value is defined as 1.00.
- The value contains less than 5% error according to indoor unit type.
- Heating performance include the drop of frost formation.
- Air flow rate and (BF) are given in table below:

(Pair)

	FCQHG100F	FCQG100F	FBQ100C	FHQG100C	FAQ100C	FVQ100C	FHQ100CA
AFR	32.3	32.0	32.0	20.0	26.0	28.0	28.0
(BF)	(0.17)	(0.17)	(0.13)	(0.09)	(0.10)	(0.20)	(0.09)

(Triple)

	FCQG35Fx3	FFQ35B9x3	FBQ35Cx3	FHQ35B9x3	FHQ35CAx3
AFR	12.5x3	10.0x3	16.0x3	13.0x3	14.0x3
(BF)	(0.4x3)	(0.25x3)	(0.15x3)	(0.20x3)	(0.17x3)

- Rated power input of each model is given in tables below:

(Pair)

	FCQHG100F	FCQG100F	FBQ100C	FHQG100C	FAQ100C	FVQ100C	FHQ100CA
Cooling	2.57	2.88	2.87	2.96	3.16	2.96	2.96

(Triple)

	FCQG35Fx3	FFQ35B9x3	FBQ35Cx3	FHQ35B9x3	FHQ35CAx3
Cooling	2.82	2.86	2.93	3.39	3.33

SYMBOLS

- AFR: Air flow rate (m³/min)
 BF: Bypass factor
 EWB: Entering wet bulb temp. (°CWB)
 EDB: Entering dry bulb temp. (°CDB)
 TC: Maximum Total cooling (heating) capacity (kW)
 SHC: Sensible heat capacity (kW)
 PI: Power input
 (comp.+indoor and outdoor fan motor)
 CPI: Coefficient of power input. (-)

Caution:
TC and SHC are shown by kW.

(Twin)

	FCQ50Fx2	FFQ50B9x2	FBQ50Cx2	FHQ50B9x2	FHQ50CAx2
AFR	12.6x2	12.0x2	16.0x2	13.0x2	15.0x2
(BF)	(0.22x2)	(0.16x2)	(0.16x2)	(0.10x2)	(0.18x2)

(Twin)

	FCQ50Fx2	FFQ50B9x2	FBQ50Cx2	FHQ50B9x2	FHQ50CAx2
Cooling	2.76	2.86	2.93	3.39	3.35


3D07653A

6 Capacity tables

6 - 1 Cooling Capacity Tables

RZQSG125L8V1

Cooling

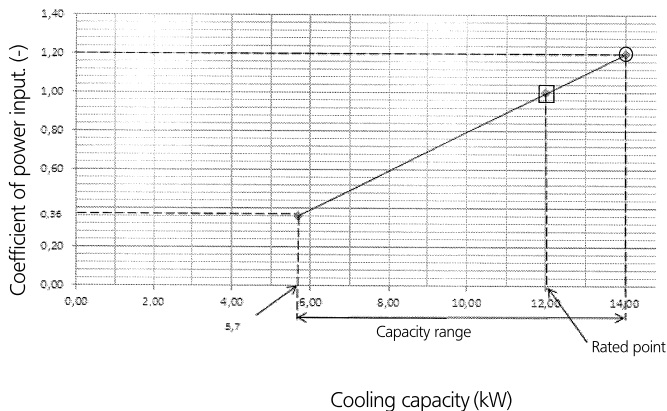

Cooling

Indoor		Outdoor temperature (°CDB)											
		25			30			35			40		
°CWB	°CDB	TC kW	SHC kW	CPI -	TC kW	SHC kW	CPI -	TC kW	SHC kW	CPI -	TC kW	SHC kW	CPI -
16.0	22	14.1	9.54	0.99	13.6	9.30	1.09	13.1	9.12	1.19	12.6	8.78	1.29
18.0	25	14.7	9.50	0.99	14.2	9.32	1.09	13.7	9.09	1.20	13.2	8.83	1.31
19.0	27	15.0	9.52	1.00	14.5	9.34	1.10	14.0	9.06	1.20	13.5	8.87	1.31
19.5	27	15.2	9.52	1.00	14.7	9.26	1.11	14.2	9.08	1.20	13.6	8.81	1.31
22.0	30	16.0	9.39	1.00	15.5	9.14	1.11	14.9	8.95	1.21	14.4	8.74	1.32
24.0	32	16.7	9.31	1.01	16.1	9.09	1.12	15.5	8.83	1.23	15.0	8.63	1.33

NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the mark with ○ show the max. at standard conditions.
On the figure the mark with □ show the rated capacity and rated coefficient of power input.
However the max. capacity is not guaranteed, except at standard condition.
- SHC is based on indoor EWB and EDB.
SHC for other dry bulb temp. = SHC + SHC*.
SHC* = SHC correction for other dry bulb.
= 0.02 x AFR (m³/min.) x (1-BF) x (DB* - EDB).
- Capacities are based on the following conditions:
Outdoor air: 85% RH.
However, the condition rated capacity in heating is 7° CDB / 6° CWB.
Corresponding refrigerant piping length: 5.0 m.
Level difference: 0 m.
- Coefficient of power input is the percentage when the rated value is defined as 1.00.
- The value contains less than 5% error according to indoor unit type.
- Heating performance include the drop of frost formation.
- Air flow rate and (BF) are given in table below:

(Pair)

	FCQH125F	FCQG125F	FBQ125C	FHQ125C	FDQ125C	FVQ125C	FHQ125CA
AFR (BF)	33.5 (0.19)	33.0 (0.21)	39.0 (0.16)	31.0 (0.134)	39.0 (0.16)	28.0 (0.16)	31.0 (0.14)

(Triple)

	FCQGS0F3	FFQ50B9x3	FBQ50C3	FHQ50Bw3	FHQ50CAx3
AFR (BF)	12.6x3 (0.22x3)	12.0x3 (0.16x3)	16.0x3 (0.16x3)	13.0x3 (0.10x3)	15.0x3 (0.18x3)

- Rated power input of each model is given in tables below:

(Pair)

	FCQH125F	FCQG125F	FBQ125C	FHQ125C	FDQ125C	FVQ125C	FHQ125CA
Cooling	3.71	3.74	3.74	4.15	3.74	4.27	4.15

(Triple)

	FCQGS0F3	FFQ50B9x3	FBQ50C3	FHQ50Bw3	FHQ50CAx3
Cooling	3.69	4.08	3.95	4.39	4.33

SYMBOLS

- AFR: Air flow rate (m³/min)
- BF: Bypass factor
- EWB: Entering wet bulb temp. (°CWB)
- EDB: Entering dry bulb temp. (°CDB)
- TC: Maximum Total cooling (heating) capacity (kW)
- SHC: Sensible heat capacity (kW)
- PI: Power input
(comp.+indoor and outdoor fan motor)
- CPI: Coefficient of power input. (-)

Caution:
TC and SHC are shown by kW.

(Twin)

	FCQG60F2	FFQ60B9x2	FBQ60C2	FHQ60Bw2	FHQ60CAx2
AFR (BF)	13.6x2 (0.2x2)	15.0x2 (0.11x2)	18.0x2 (0.15x2)	17.0x2 (0.20x2)	19.5x2 (0.20x2)

(Double twin)

	FCQG35F4	FFQ35B9x4	FBQ35C4	FHQ35Bw4	FHQ35CAx4
AFR (BF)	12.5x4 (0.4x4)	10x4 (0.25x4)	16x4 (0.15x4)	13x4 (0.20x4)	14x4 (0.17x4)

(Twin)

	FCQG60F2	FFQ60B9x2	FBQ60C2	FHQ60Bw2	FHQ60CAx2
Cooling	3.66	4.08	3.95	4.39	4.34

(Double twin)

	FCQG35F4	FFQ35B9x4	FBQ35C4	FHQ35Bw4	FHQ35CAx4
Cooling	3.75	4.08	3.95	4.39	4.31


3D076754A

6 Capacity tables

6 - 1 Cooling Capacity Tables

RZQSG140LV1

Cooling

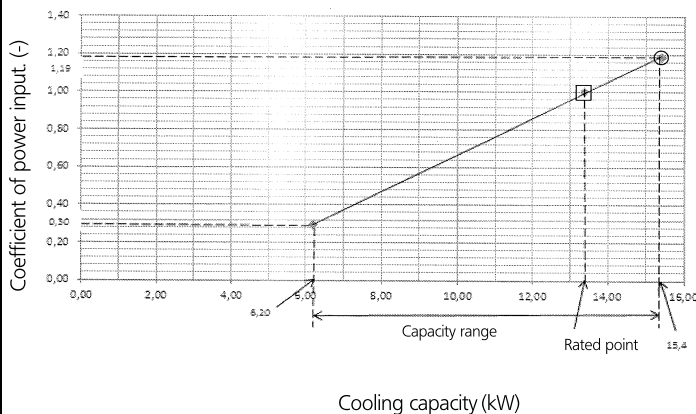

Cooling

Indoor		Outdoor temperature (°CDB)											
		25			30			35			40		
°CWB	°CDB	TC kW	SHC kW	CPI -	TC kW	SHC kW	CPI -	TC kW	SHC kW	CPI -	TC kW	SHC kW	CPI -
16.0	22	15.5	10.47	0.98	14.9	10.25	1.08	14.4	10.08	1.18	13.9	9.89	1.28
18.0	25	16.2	10.55	0.98	15.6	10.21	1.09	15.1	10.01	1.19	14.5	9.71	1.30
19.0	27	16.6	10.43	0.99	16.0	10.18	1.09	15.4	9.98	1.19	14.8	9.76	1.30
19.5	27	16.7	10.49	0.99	16.1	10.16	1.10	15.6	10.00	1.19	15.0	9.86	1.30
22.0	30	17.6	10.37	0.99	17.0	10.16	1.10	16.4	9.83	1.21	15.8	9.60	1.31
24.0	32	18.4	10.20	1.00	17.7	10.00	1.11	17.0	9.67	1.22	16.4	9.47	1.32

NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the mark with ○ show the max. at standard conditions.
On the figure the mark with □ show the rated capacity and rated coefficient of power input.
However the max. capacity is not guaranteed, except at standard condition.
- SHC is based on indoor EWB and EDB.
SHC for other dry bulb temp. = SHC + SHC*.
SHC* = SHC correction for other dry bulb.
= 0.02 x AFR (m³/min.) x (1-BF) x (DB*-EDB).
- Capacities are based on the following conditions:
Outdoor air: 85% RH.
However, the condition rated capacity in heating is 7° CDB / 6° CWB.
Corresponding refrigerant piping length: 5.0 m.
Level difference: 0 m.
- Coefficient of power input is the percentage when the rated value is defined as 1.00.
- The value contains less than 5% error according to indoor unit type.
- Heating performance include the drop of frost formation.
- Air flow rate and (BF) are given in table below:

(Pair)

	FCQH140F	FCQ140F	FBQ140C	FHQ140C	FVQ140C	FHQ140CA
AFR	33.5	33.0	39	34.0	30.0	34.0
(BF)	(0.15)	(0.23)	(0.14)	(0.17)	(0.18)	(0.17)

(Triple)

	FCQG50Fx3	FFQ50B9x3	FBQ50Cx3	FHQ50B9x3	FHQ50CAx3
AFR	12.6x3	12.0x3	16.0x3	13.0x3	15.0x3
(BF)	(0.22x3)	(0.16x3)	(0.16x3)	(0.10x3)	(0.18x3)

- Rated power input of each model is given in tables below:

(Pair)

	FCQH140F	FCQ140F	FBQ140C	FHQ140C	FVQ140C	FHQ140CA
Cooling	4.17	4.45	4.44	4.45	4.45	4.45

(Triple)

	FCQG50Fx3	FFQ50B9x3	FBQ50Cx3	FHQ50B9x3	FHQ50CAx3
Cooling	4.40	4.62	4.17	4.73	4.67

SYMBOLS

- AFR: Air flow rate (m³/min)
 BF: Bypass factor
 EWB: Entering wet bulb temp. (°CWB)
 EDB: Entering dry bulb temp. (°CDB)
 TC: Maximum Total cooling (heating) capacity (kW)
 SHC: Sensible heat capacity (kW)
 PI: Power input
 (comp.+indoor and outdoor fan motor)
 CPI: Coefficient of power input. (-)

Caution:
TC and SHC are shown by kW.

(Twin)

	FCQH71Fx2	FCQ71Fx2	FBQ71Cx2	FHQ71Cx2	FAQ71Cx2	FHQ71CAx2
AFR	21.2x2	21.5x2	18.0x2	20.5x2	18.0x2	20.5x2
(BF)	(0.2x2)	(0.14x2)	(0.08x2)	(0.13x2)	(0.16x2)	(0.13x2)

(Double twin)

	FCQG35Fx4	FFQ35B9x4	FBQ35Cx4	FHQ35B9x4	FHQ35CAx4
AFR	12.5x4	10.0x4	16.0x4	13.0x4	14.0x4
(BF)	(0.4x4)	(0.25x4)	(0.15x4)	(0.20x4)	(0.20x4)

(Twin)

	FCQH71Fx2	FCQ71Fx2	FBQ71Cx2	FHQ71Cx2	FAQ71Cx2	FHQ71CAx2
Cooling	4.11	4.39	4.17	4.01	4.23	4.01

(Double twin)

	FCQG35Fx4	FFQ35B9x4	FBQ35Cx4	FHQ35B9x4	FHQ35CAx4
Cooling	4.46	4.62	4.17	4.73	4.65


3D076755A

6 Capacity tables

6 - 2 Heating Capacity Tables

RZQSG71L3V1

Heating

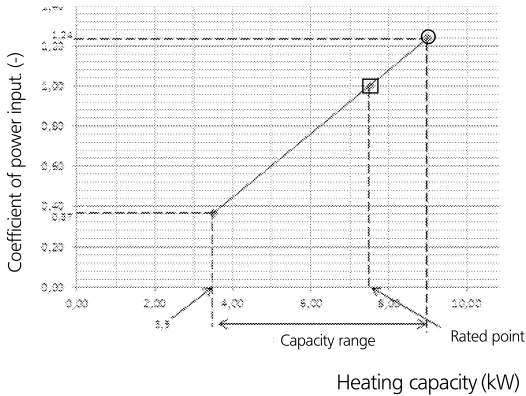

Heating

Indoor	Outdoor temperature (°CWB)											
	-15.0		-10.0		-5.0		0.0		6.0		10.0	
	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI
°CDB	kW		kW		kW		kW		kW		kW	
16	5.14	0.89	5.68	0.94	6.22	0.98	6.75	1.03	9.02	1.08	9.72	1.13
18	5.14	0.92	5.67	0.97	6.21	1.02	6.74	1.07	9.01	1.12	9.70	1.18
20	5.13	0.96	5.67	1.01	6.20	1.06	6.73	1.11	9.00	1.17	9.69	1.23
21	5.13	0.98	5.66	1.03	6.20	1.08	6.73	1.13	9.00	1.19	9.69	1.25
22	5.12	0.99	5.66	1.04	6.19	1.10	6.73	1.15	8.99	1.22	9.68	1.28
24	5.12	1.03	5.65	1.09	6.19	1.14	6.72	1.20	8.98	1.26	9.66	1.32

NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the mark with ○ show the max. at standard conditions.
On the figure the mark with □ show the rated capacity and rated coefficient of power input.
However the max. capacity is not guaranteed, except at standard condition.
- SHC is based on indoor EWB and EDB.
SHC for other dry bulb temp. = SHC + SHC*.
SHC* = SHC correction for other dry bulb.
= 0.02 x AFR (m³/min) x (1-BF) x (DB*-EDB).
- Capacities are based on the following conditions:
Outdoor air: 85% RH.
However, the condition rated capacity in heating is 7° CDB / 6° CWB.
Corresponding refrigerant piping length: 5.0 m.
Level difference: 0 m.
- Coefficient of power input is the percentage when the rated value is defined as 1.00.
- The value contains less than 5% error according to indoor unit type.
- Heating performance include the drop of frost formation.
- Air flow rate and (BF) are given in table below:

(Pair)

	FCQH71F	FCQ671F	FBQ71C	FHQ71C	FAQ71C	FVQ71C	FHQ71CA
AFR	21.2	21.5	18	20.5	18	18	20.5
(BF)	(0.2)	(0.14)	(0.08)	(0.13)	(0.16)	(0.16)	(0.13)

(Twin)

	FCQG35Fx2	FFQ35x2	FBQ35Cx2	FHQ35BwCx2	FHQ35CAx2
AFR	12.5x2	10x2	16x2	13x2	14x2
(BF)	(0.4x2)	(0.25x2)	(0.15x2)	(0.20x2)	(0.17x2)

- Rated power input of each model is given in tables below:

(Pair)

	FCQH71F	FCQ671F	FBQ71C	FHQ71C	FAQ71C	FVQ71C	FHQ71CA
Heating	1.83	2.08	2.08	1.88	2.08	2.08	1.88

(Twin)

	FCQG35Fx2	FFQ35x2	FBQ35Cx2	FHQ35BwCx2	FHQ35CAx2
Heating	2.37	2.32	2.16	2.78	2.70

SYMBOLS

- AFR: Air flow rate (m³/min)
 BF: Bypass factor
 EWB: Entering wet bulb temp. (°CWB)
 EDB: Entering dry bulb temp. (°CDB)
 TC: Maximum Total cooling (heating) capacity (kW)
 SHC: Sensible heat capacity (kW)
 PI: Power input
 (comp.+indoor and outdoor fan motor)
 CPI: Coefficient of power input. (-)

Caution:
TC and SHC are shown by kW.


3D082368

6 Capacity tables

6 - 2 Heating Capacity Tables

RZQSG100L8V1

Heating

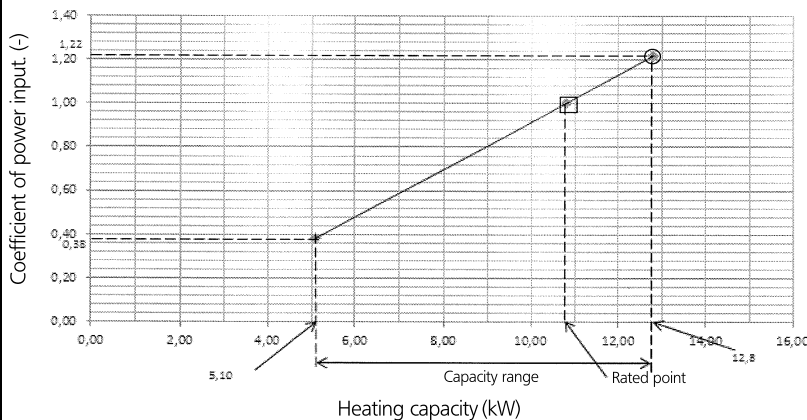

Heating

Indoor °CDB	Outdoor temperature (°CWB)											
	-15.0		-10.0		-5.0		0.0		6.0		10.0	
	TC kW	CPI	TC kW	CPI	TC kW	CPI	TC kW	CPI	TC kW	CPI	TC kW	CPI
16	8.58	0.93	9.45	0.99	10.1	1.02	10.4	1.05	12.8	1.12	13.8	1.18
18	8.57	0.97	9.44	1.02	10.0	1.07	10.3	1.10	12.8	1.17	13.8	1.23
20	8.56	1.01	9.43	1.07	10.0	1.11	10.3	1.14	12.8	1.22	13.8	1.28
21	8.56	1.03	9.42	1.09	10.0	1.13	10.3	1.16	12.8	1.24	13.8	1.30
22	8.55	1.04	9.42	1.10	10.0	1.14	10.3	1.18	12.8	1.26	13.8	1.33
24	8.54	1.09	9.41	1.15	10.0	1.19	10.3	1.23	12.8	1.31	13.8	1.38

NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the mark with ○ show the max. at standard conditions. On the figure the mark with □ show the rated capacity and rated coefficient of power input. However the max. capacity is not guaranteed, except at standard condition.
- SHC is based on indoor EWB and EDB.
SHC for other dry bulb temp. = SHC + SHC*.
SHC* = SHC correction for other dry bulb.
= 0.02 x AFR (m³/min.) x (1-BF) x (DB*-EDB).
- Capacities are based on the following conditions:
Outdoor air: 85% RH.
However, the condition rated capacity in heating is 7° CDB / 6° CWB.
Corresponding refrigerant piping length: 5.0 m.
Level difference: 0 m.
- Coefficient of power input is the percentage when the rated value is defined as 1.00.
- The value contains less than 5% error according to indoor unit type.
- Heating performance include the drop of frost formation.
- Air flow rate and (BF) are given in table below:

(Pair)

	FCQH100F	FCQG100F	FBQ100C	FHQ100C	FAQ100C	FVQ100C	FHQ100CA
AFR	32.3	32.0	32.0	20.0	26.0	28.0	28.0
(BF)	(0.17)	(0.17)	(0.13)	(0.09)	(0.10)	(0.20)	(0.09)

(Triple)

	FCQG35Fx3	FFQ35B9x3	FBQ35Cx3	FHQ35Bw3	FHQ35CAx3
AFR	12.5x3	10.0x3	16.0x3	13.0x3	14.0x3
(BF)	(0.4x3)	(0.25x3)	(0.15x3)	(0.20x3)	(0.17x3)

- Rated power input of each model is given in tables below:

(Pair)

	FCQH100F	FCQG100F	FBQ100C	FHQ100C	FAQ100C	FVQ100C	FHQ100CA
Heating	2.51	3.05	2.96	2.99	3.17	2.99	2.99

(Triple)

	FCQG35Fx3	FFQ35B9x3	FBQ35Cx3	FHQ35Bw3	FHQ35CAx3
Heating	2.66	2.79	2.86	3.32	3.26

SYMBOLS

- AFR: Air flow rate (m³/min)
 BF: Bypass factor
 EWB: Entering wet bulb temp.(°CWB)
 EDB: Entering dry bulb temp. (°CDB)
 TC: Maximum Total cooling (heating) capacity (kW)
 SHC: Sensible heat capacity (kW)
 PI: Power input
 (comp.+indoor and outdoor fan motor)
 CPI: Coefficient of power input. (-)

Caution:
 TC and SHC are shown by kW.

(Twin)

	FCQ50Fx2	FFQ50B9x2	FBQ50Cx2	FHQ50Bw2	FHQ50CAx2
AFR	12.6x2	12.0x2	16.0x2	13.0x2	15.0x2
(BF)	(0.22x2)	(0.16x2)	(0.16x2)	(0.10x2)	(0.18x2)

(Twin)

	FCQ50Fx2	FFQ50B9x2	FBQ50Cx2	FHQ50Bw2	FHQ50CAx2
Heating	2.61	2.79	2.86	3.32	3.28


3D076753A

6 Capacity tables

6 - 2 Heating Capacity Tables

RZQSG125L8V1

Heating

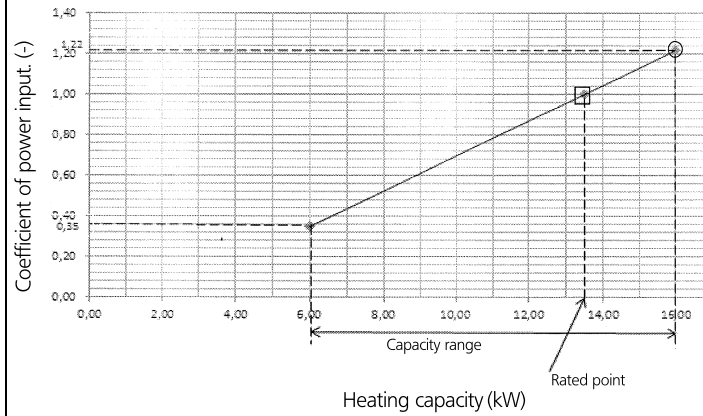

Heating

Indoor	Outdoor temperature (°CWB)											
	-15.0		-10.0		-5.0		0.0		6.0		10.0	
	TC kW	CPI	TC kW	CPI	TC kW	CPI	TC kW	CPI	TC kW	CPI	TC kW	CPI
7° CDB	10.7	0.93	11.8	0.99	12.6	1.02	13.0	1.05	16.0	1.12	17.3	1.18
8° CDB	10.7	0.97	11.8	1.02	12.5	1.07	12.9	1.10	16.0	1.17	17.3	1.23
9° CDB	10.7	1.01	11.8	1.07	12.5	1.11	12.9	1.14	16.0	1.22	17.3	1.28
10° CDB	10.7	1.03	11.8	1.09	12.5	1.13	12.9	1.16	16.0	1.24	17.3	1.31
11° CDB	10.7	1.04	11.8	1.10	12.5	1.14	12.9	1.18	16.0	1.27	17.3	1.33
12° CDB	10.7	1.09	11.8	1.15	12.5	1.19	12.9	1.23	16.0	1.31	17.3	1.38

NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the mark with ○ show the max. at standard conditions.
On the figure the mark with □ show the rated capacity and rated coefficient of power input.
However the max. capacity is not guaranteed, except at standard condition.
- SHC is based on indoor EWB and EDB.
SHC for other dry bulb temp. = SHC + SHC*
SHC* = SHC correction for other dry bulb.
= 0.02 x AFR (m³/min.) x (1-BF) x (DB*-EDB).
- Capacities are based on the following conditions:
Outdoor air: 85% RH.
However, the condition rated capacity in heating is 7° CDB / 6° CWB.
Corresponding refrigerant piping length: 5.0 m.
Level difference: 0 m.
- Coefficient of power input is the percentage when the rated value is defined as 1.00.
- The value contains less than 5% error according to indoor unit type.
- Heating performance include the drop of frost formation.
- Air flow rate and (BF) are given in table below:

SYMBOLS

- AFR: Air flow rate (m³/min)
- BF: Bypass factor
- EWB: Entering wet bulb temp. (°CWB)
- EDB: Entering dry bulb temp. (°CDB)
- TC: Maximum Total cooling (heating) capacity (kW)
- SHC: Sensible heat capacity (kW)
- PI: Power input
- (comp.+indoor and outdoor fan motor)
- CPI: Coefficient of power input. (-)

Caution:
TC and SHC are shown by kW.

(Pair)

	FCQH125F	FCQ125F	FBQ125C	FHQ125C	FDQ125C	FVQ125C	FHQ125CA
AFR	33.5	33.0	39.0	31.0	39.0	28.0	31.0
(BF)	(0.19)	(0.21)	(0.16)	(0.134)	(0.16)	(0.16)	(0.14)

(Triple)

	FCQG50F3	FFQ50B93	FBQ50C3	FHQ50BW3	FHQ50CA3
AFR	12.63	12.03	16.03	13.03	15.03
(BF)	(0.22x3)	(0.16x3)	(0.16x3)	(0.10x3)	(0.18x3)

- Rated power input of each model is given in tables below:

(Pair)

	FCQH125F	FCQ125F	FBQ125C	FHQ125C	FDQ125C	FVQ125C	FHQ125CA
Heating	3.60	3.96	3.85	3.73	3.85	3.96	3.73

(Triple)

	FCQG50F3	FFQ50B93	FBQ50C3	FHQ50BW3	FHQ50CA3
Heating	3.90	4.15	4.06	4.48	4.42

(Twin)

	FCQG60F2	FFQ60B92	FBQ60C2	FHQ60BW2	FHQ60CA2
AFR	13.6x2	15.0x2	18.0x2	17.0x2	19.5x2
(BF)	(0.2x2)	(0.11x2)	(0.15x2)	(0.20x2)	(0.20x2)

(Double twin)

	FCQG35F4	FFQ35B94	FBQ35C4	FHQ35BW4	FHQ35CA4
AFR	12.5x4	10x4	16x4	13x4	14x4
(BF)	(0.4x4)	(0.25x4)	(0.15x4)	(0.20x4)	(0.17x4)

(Twin)

	FCQG60F2	FFQ60B92	FBQ60C2	FHQ60BW2	FHQ60CA2
Heating	3.88	4.15	4.06	4.48	4.43

(Double twin)

	FCQG35F4	FFQ35B94	FBQ35C4	FHQ35BW4	FHQ35CA4
Heating	3.96	4.15	4.06	4.48	4.32


3D076754A

6 Capacity tables

6 - 2 Heating Capacity Tables

RZQSG140LV1

Heating

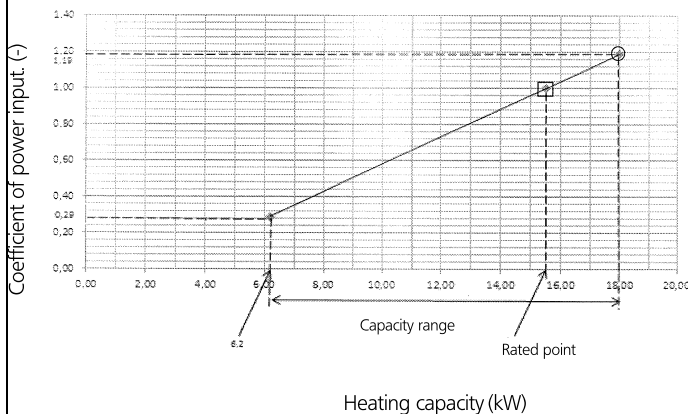

Heating

Indoor °CDB	Outdoor temperature (°CWB)											
	-15.0		-10.0		-5.0		0.0		6.0		10.0	
	TC kW	CPI	TC kW	CPI	TC kW	CPI	TC kW	CPI	TC kW	CPI	TC kW	CPI
16	11.6	0.91	12.7	0.97	13.6	1.00	13.9	1.03	18.0	1.09	19.4	1.16
18	11.6	0.95	12.7	1.00	13.6	1.04	13.9	1.07	18.0	1.14	19.4	1.21
20	11.6	0.99	12.7	1.05	13.5	1.09	13.9	1.11	18.0	1.19	19.4	1.25
21	11.5	1.00	12.7	1.06	13.5	1.11	13.9	1.13	18.0	1.21	19.4	1.28
22	11.5	1.02	12.7	1.08	13.5	1.12	13.9	1.16	18.0	1.24	19.4	1.30
24	11.5	1.07	12.6	1.12	13.5	1.17	13.9	1.20	18.0	1.29	19.4	1.35

NOTES

- Ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the mark with ○ show the max. at standard conditions.
On the figure the mark with □ show the rated capacity and rated coefficient of power input.
However the max. capacity is not guaranteed, except at standard condition.
- SHC is based on indoor EWB and EDB.
SHC for other dry bulb temp. = SHC + SHC*.
SHC* = SHC correction for other dry bulb.
= 0.02 x AFR (m³/min.) x (1-BF) x (DB*-EDB).
- Capacities are based on the following conditions:
Outdoor air: 85% RH.
However, the condition rated capacity in heating is 7° CDB / 6° CWB.
Corresponding refrigerant piping length: 5.0 m.
Level difference: 0 m.
- Coefficient of power input is the percentage when the rated value is defined as 1.00.
- The value contains less than 5% error according to indoor unit type.
- Heating performance include the drop of frost formation.
- Air flow rate and (BF) are given in table below:

SYMBOLS

- AFR: Air flow rate (m³/min)
 BF: Bypass factor
 EWB: Entering wet bulb temp. (°CWB)
 EDB: Entering dry bulb temp. (°CDB)
 TC: Maximum Total cooling (heating) capacity (kW)
 SHC: Sensible heat capacity (kW)
 PI: Power input
 (comp.+indoor and outdoor fan motor)
 CPI: Coefficient of power input. (-)

Caution:
TC and SHC are shown by kW.

(Pair)

	FCQH140F	FCQ140F	FBQ140C	FHQ140C	FVQ140C	FHQ140CA
AFR	335	33.0	41	34.0	30.0	34.0
(BF)	(0.15)	(0.23)	(0.14)	(0.17)	(0.18)	(0.17)

(Twin)

	FCQH71F2	FCQ71F2	FBQ71C2	FHQ71C2	FAQ71C2	FHQ71CA2
AFR	212x2	21.5x2	18.0x2	20.5x2	18.0x2	20.5x2
(BF)	(0.2x2)	(0.14x2)	(0.08x2)	(0.13x2)	(0.16x2)	(0.13x2)

(Triple)

	FCQ50F3	FFQ50B9x3	FBQ50C3	FHQ50B9x3	FHQ50CA3
AFR	12.6x3	12.0x3	16.0x3	13.0x3	15.0x3
(BF)	(0.22x3)	(0.16x3)	(0.16x3)	(0.10x3)	(0.18x3)

(Double twin)

	FCQ35F4	FFQ35B9x4	FBQ35C4	FHQ35B9x4	FHQ35CA4
AFR	12.5x4	10.0x4	16.0x4	13.0x4	14.0x4
(BF)	(0.4x4)	(0.25x4)	(0.15x4)	(0.20x4)	(0.20x4)

- Rated power input of each model is given in tables below:

(Pair)

	FCQH140F	FCQ140F	FBQ140C	FHQ140C	FVQ140C	FHQ140CA
Heating	4.29	4.54	4.54	4.54	4.54	4.54

(Twin)

	FCQH71F2	FCQ71F2	FBQ71C2	FHQ71C2	FAQ71C2	FHQ71CA2
Heating	4.23	4.48	4.94	4.71	4.92	4.71

(Triple)

	FCQ50F3	FFQ50B9x3	FBQ50C3	FHQ50B9x3	FHQ50CA3
Heating	4.48	5.16	4.94	5.73	5.67


(Double twin)

	FCQ35F4	FFQ35B9x4	FBQ35C4	FHQ35B9x4	FHQ35CA4
Heating	4.54	5.16	4.94	5.73	5.57

3D076755A

6 Capacity tables

6 - 3 Capacity Correction Factor

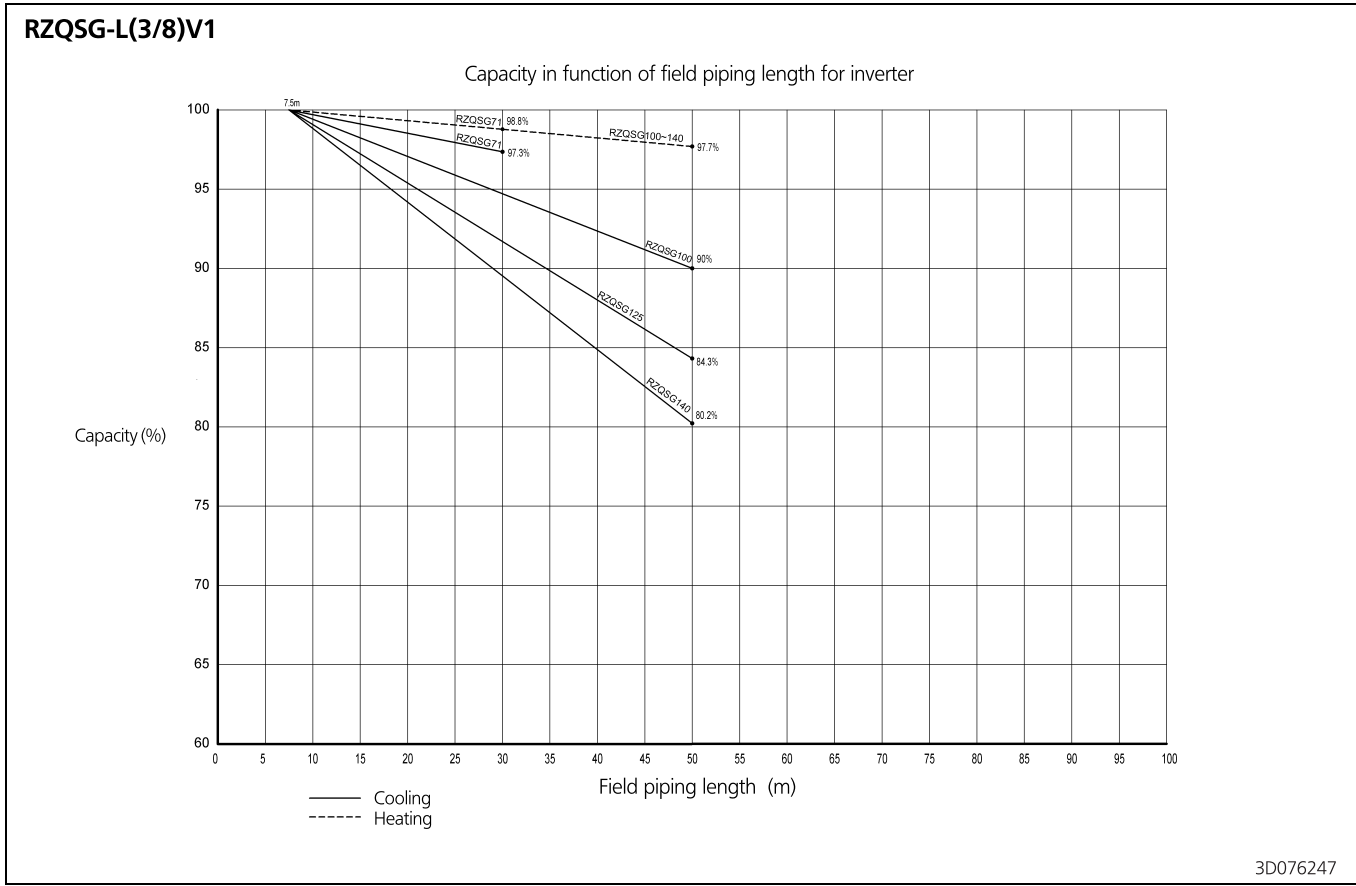


7 Dimensional drawings


7 - 1 Dimensional Drawings

7

RZQSG71L3V1

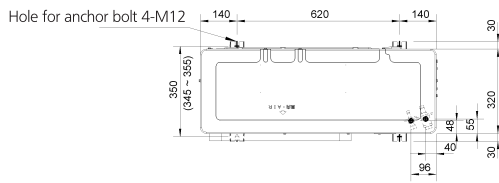


- 1 Gas pipe connection ϕ 15.9 flare
- 2 Liquid pipe connection - ϕ 9.5 flare
- 3 Service port (in the unit)
- 4 Grounding terminal M5 (in switch box)
- 5 Refrigerant piping intake
- 6 Power supply wiring intake (knock hole ϕ 34)
- 7 Control wiring intake (knock hole ϕ 27)
- 8 Drain outlet

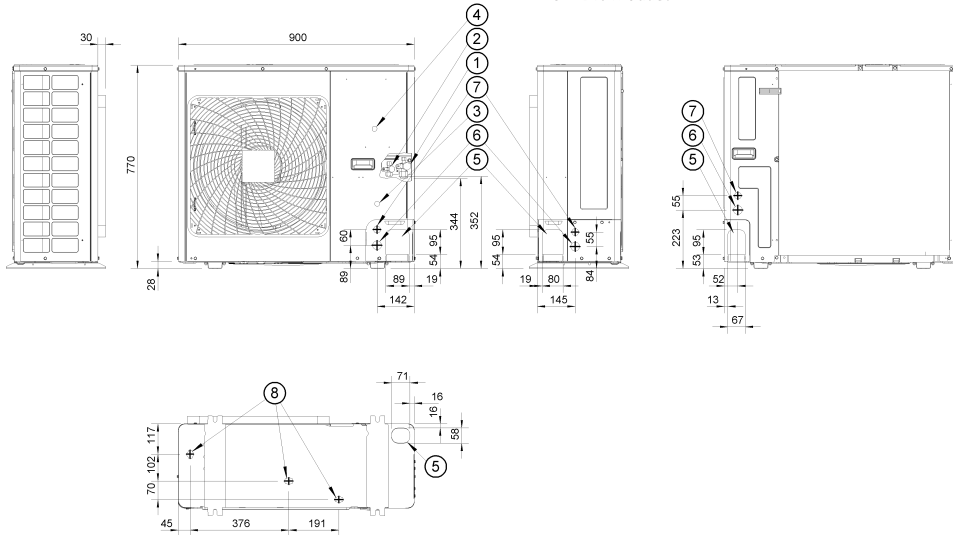


3D082346

RZQSG100-125L8V1

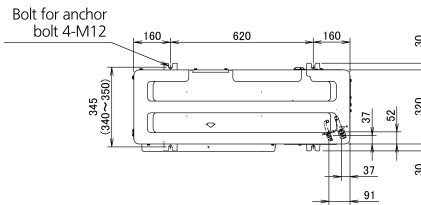

- 1 Gas pipe connection ϕ 15.9 flare
- 2 Liquid pipe connection - ϕ 9.5 flare
- 3 Service port (in the unit)
- 4 Grounding terminal M5 (in switch box)
- 5 Refrigerant piping intake
- 6 Power supply wiring intake (knock out hole ϕ 34)
- 7 Control wiring intake (Knock out hole ϕ 27)
- 8 Drain outlet

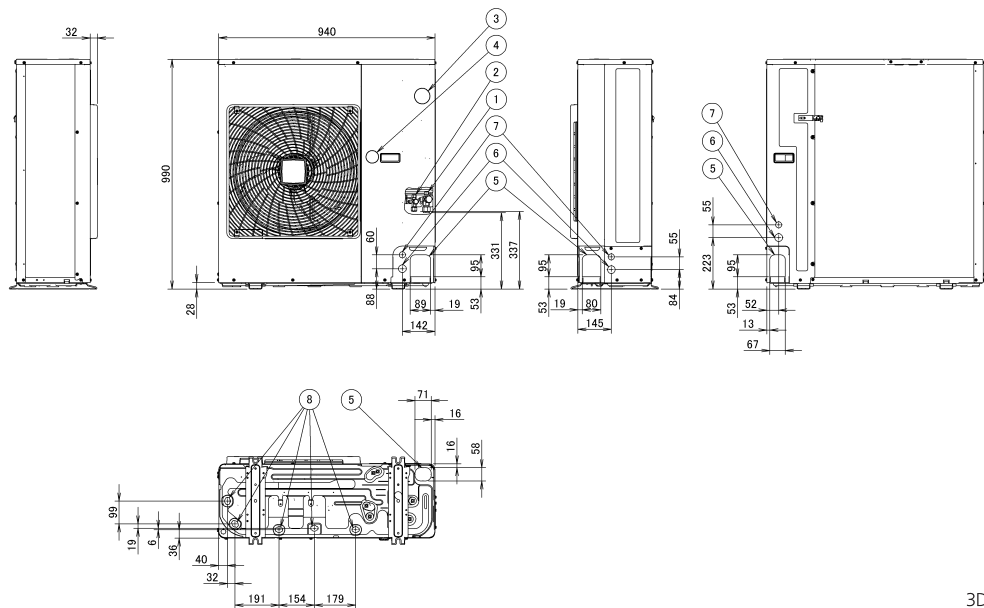


3D076345

7 Dimensional drawings

7 - 1 Dimensional Drawings

RZQSG140LV1

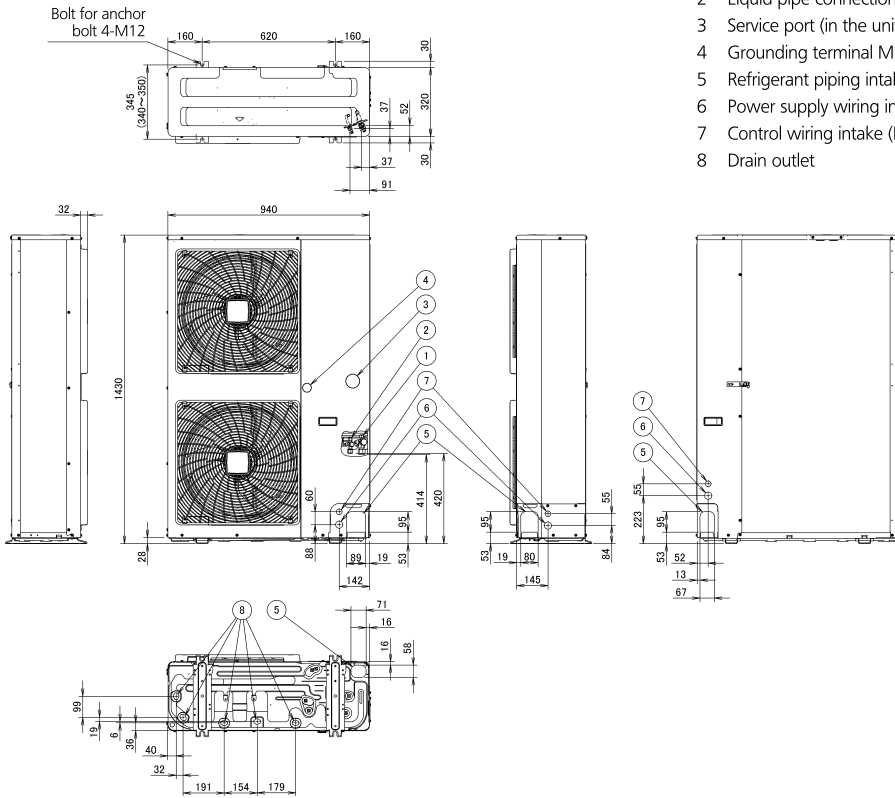

- 1 Gas pipe connection ϕ 15.9 flare
- 2 Liquid pipe connection - ϕ 9.5 flare
- 3 Service port (in the unit)
- 4 Grounding terminal M5 (in switch box)
- 5 Refrigerant piping intake
- 6 Power supply wiring intake (knock out hole ϕ 34)
- 7 Control wiring intake (Knock out hole ϕ 27)
- 8 Drain outlet


3D076346

8 Centre of gravity

8 - 1 Centre of Gravity


8

RZQSG71L3V1

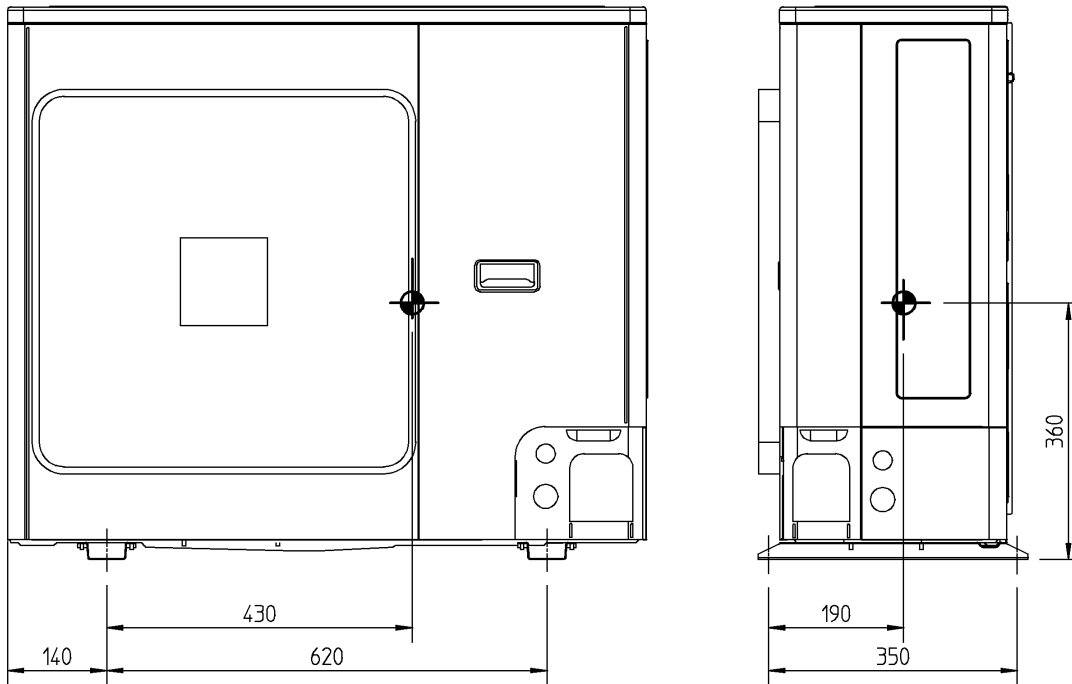

4TW30469-3

RZQSG100-125L8V1

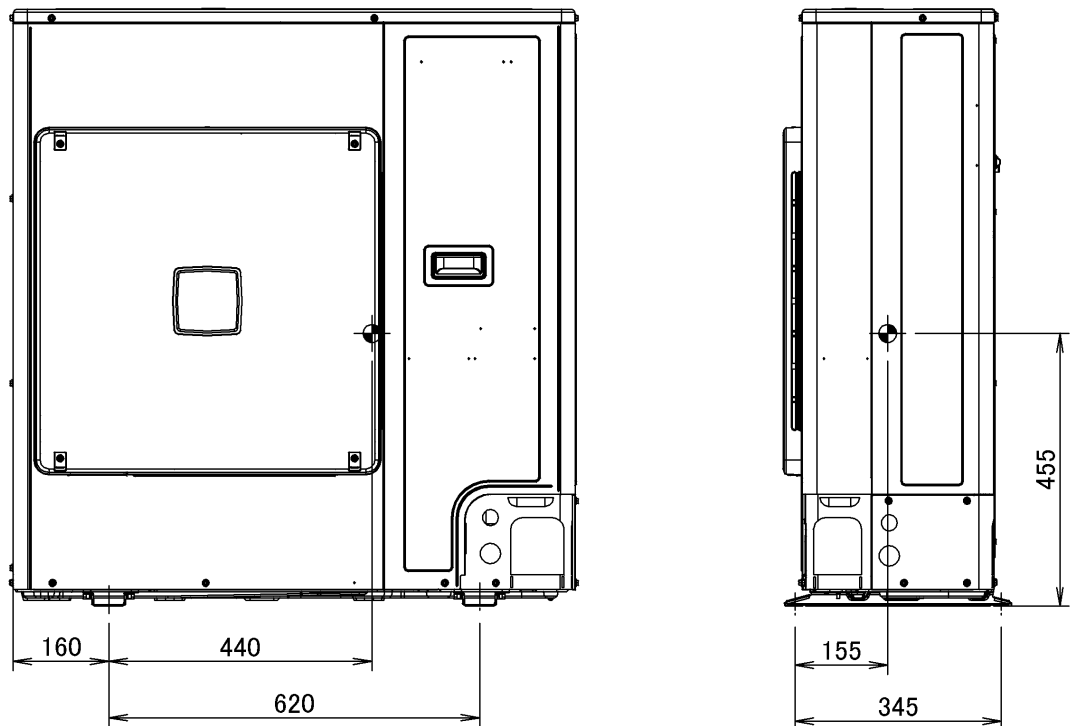


4D076239

8 Centre of gravity

8 - 1 Centre of Gravity

RZQSG140LV1

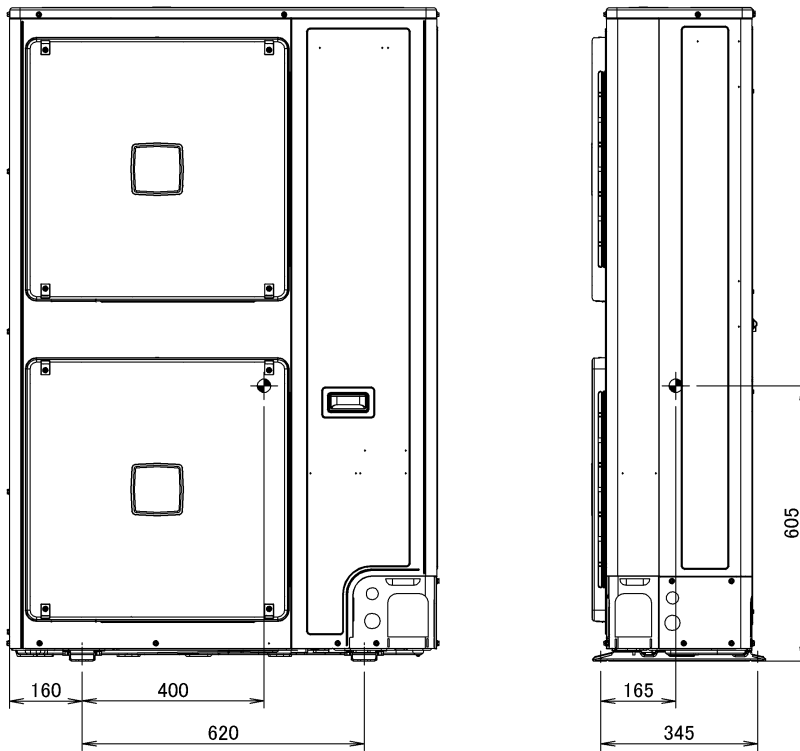


4D076248

9 Piping diagrams

9 - 1 Piping Diagrams


9

RZQSG71L3V1

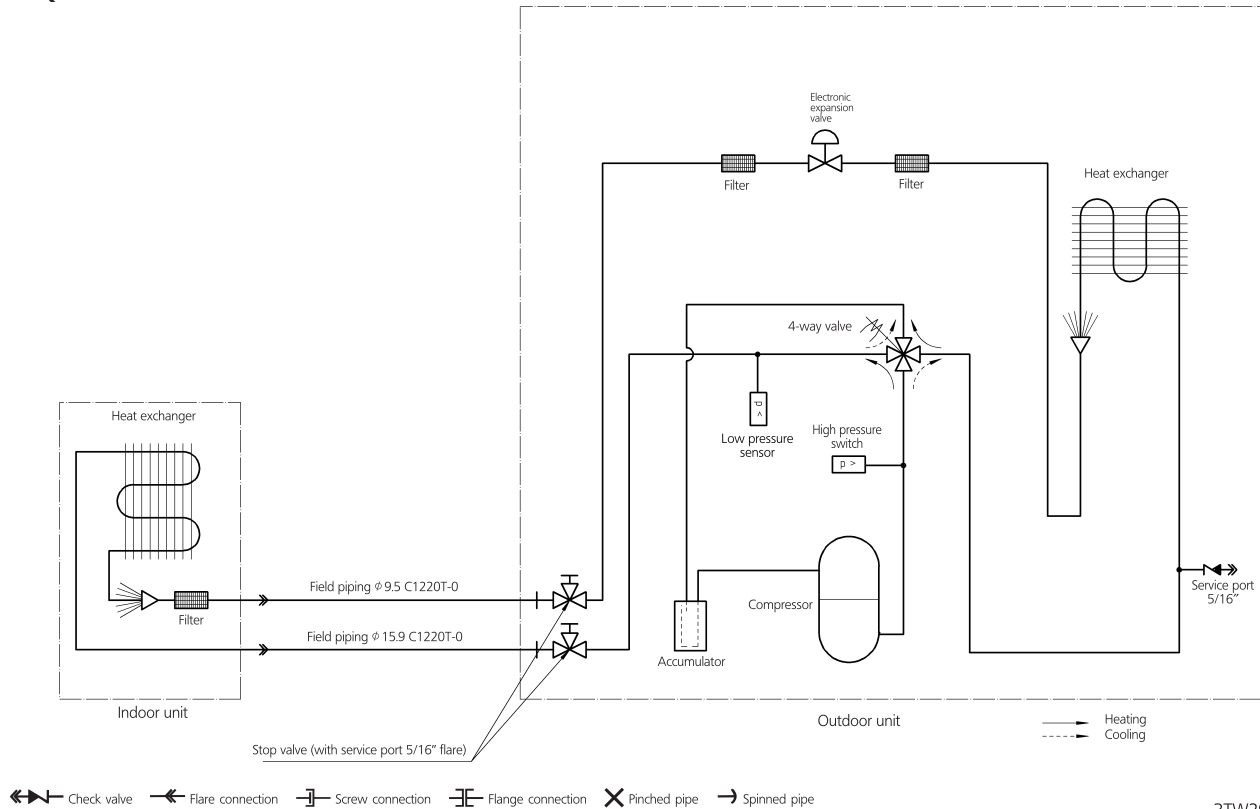

3TW29165-1

RZQSG100-140L(8)V1

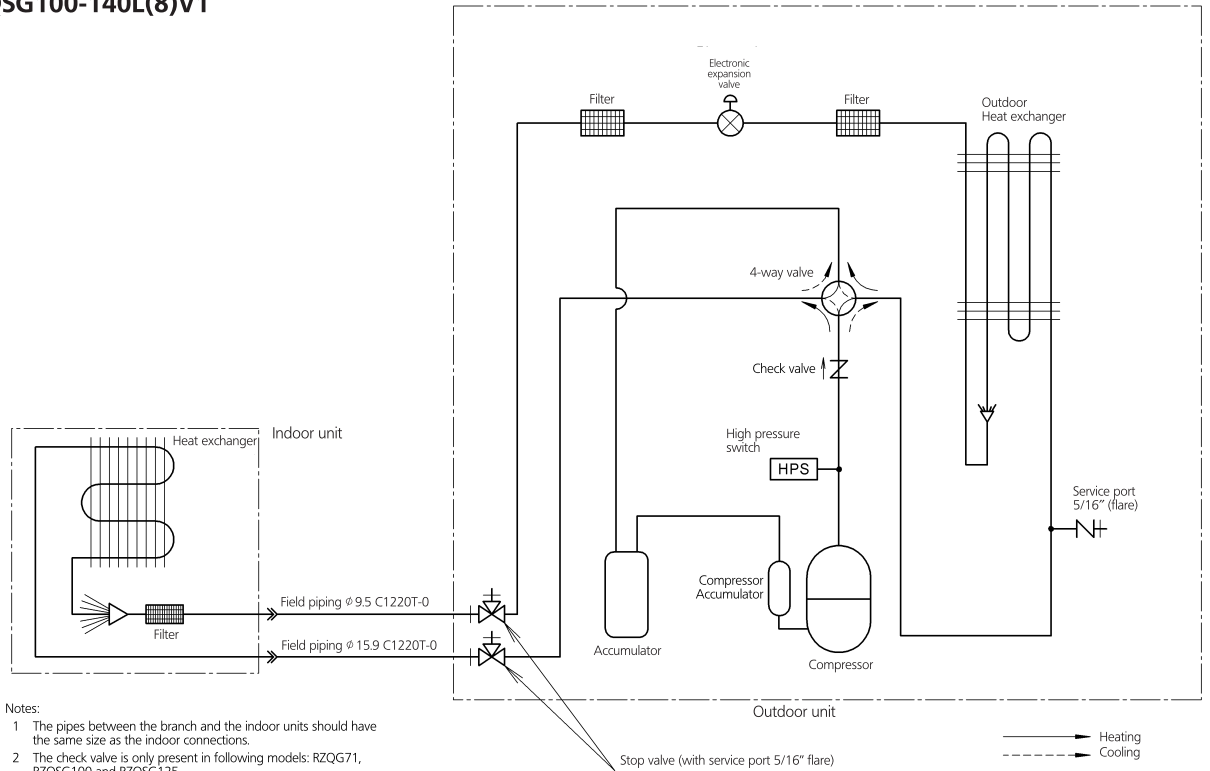



Notes:

- 1 The pipes between the branch and the indoor units should have the same size as the indoor connections.
- 2 The check valve is only present in following models: RZQSG71, RZQSG100 and RZQSG125.

3D076176

9 Piping diagrams


9 - 2 Piping Diagram Twin Application

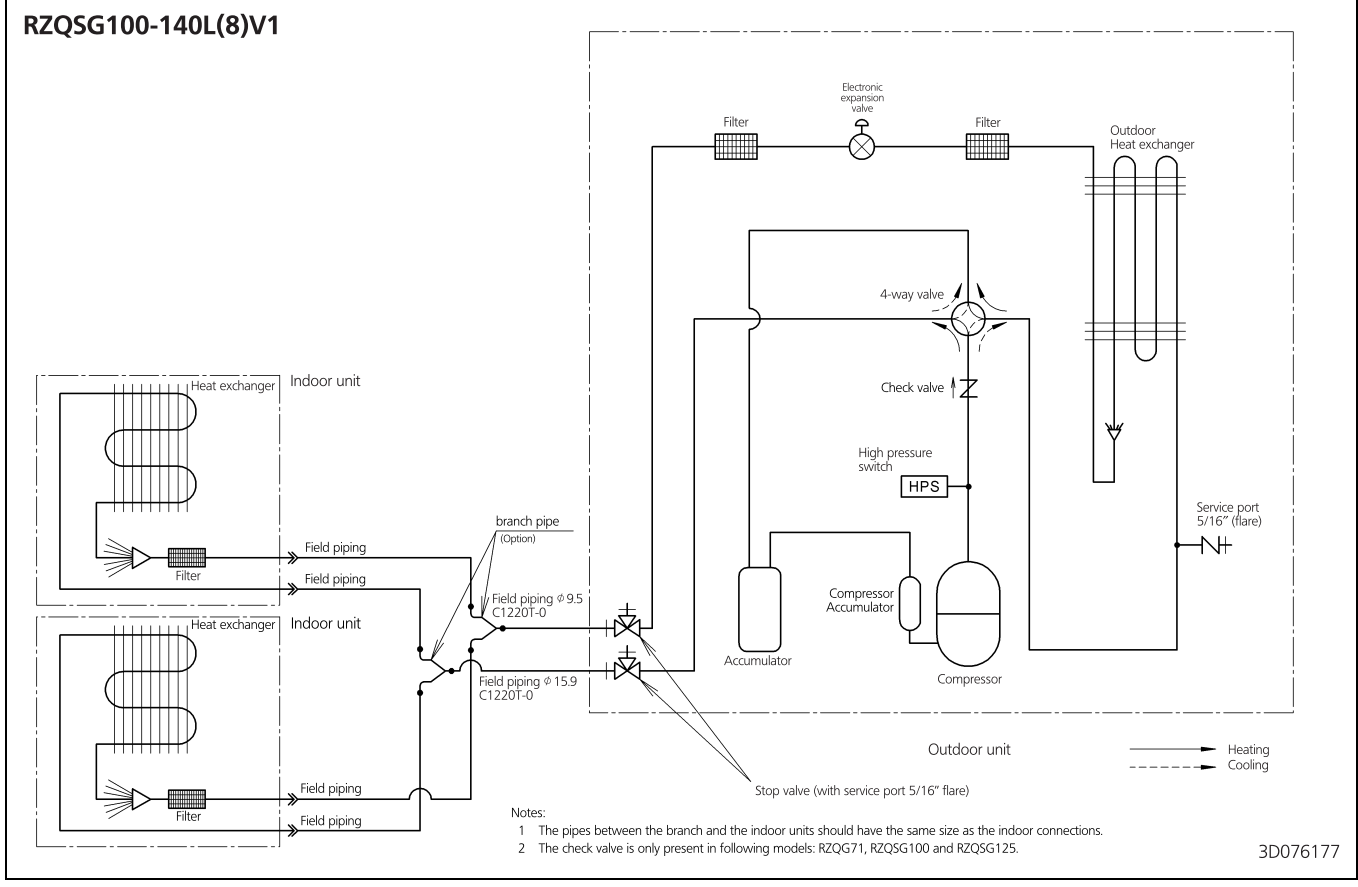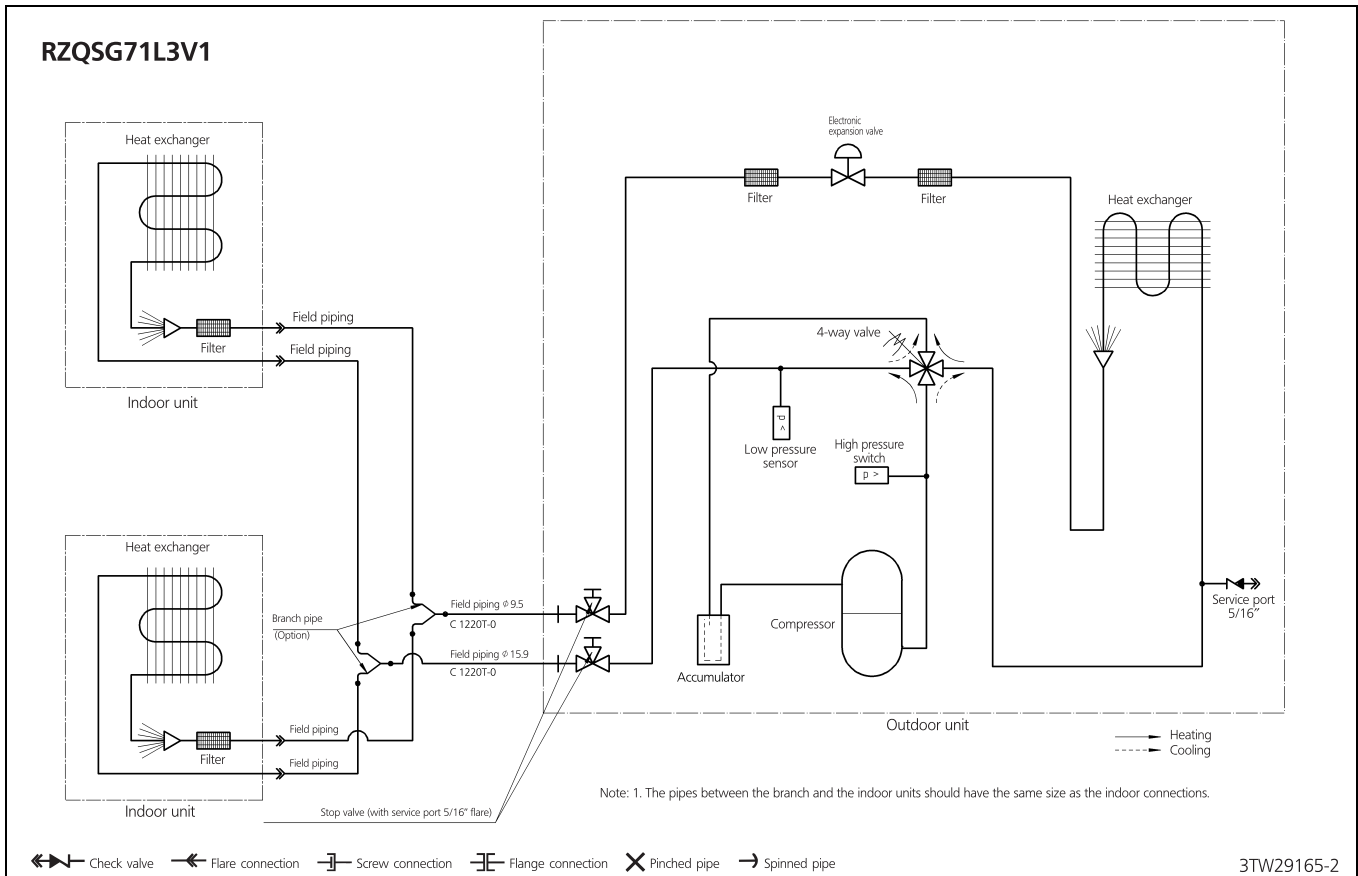

9 Piping diagrams


9 - 3 Piping Diagram Triple Application

9

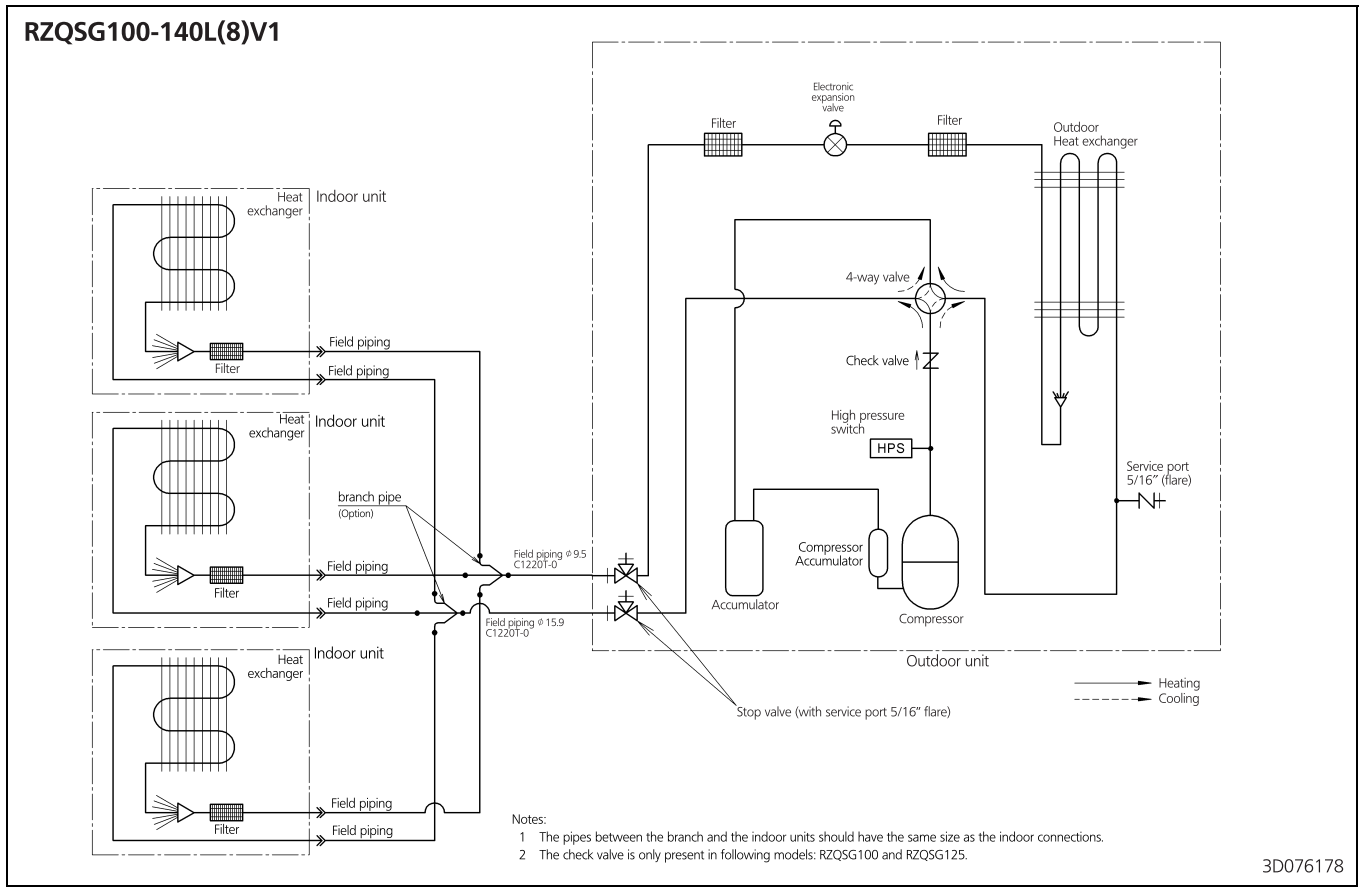

9 Piping diagrams

9 - 4 Piping Diagram Double Twin Application

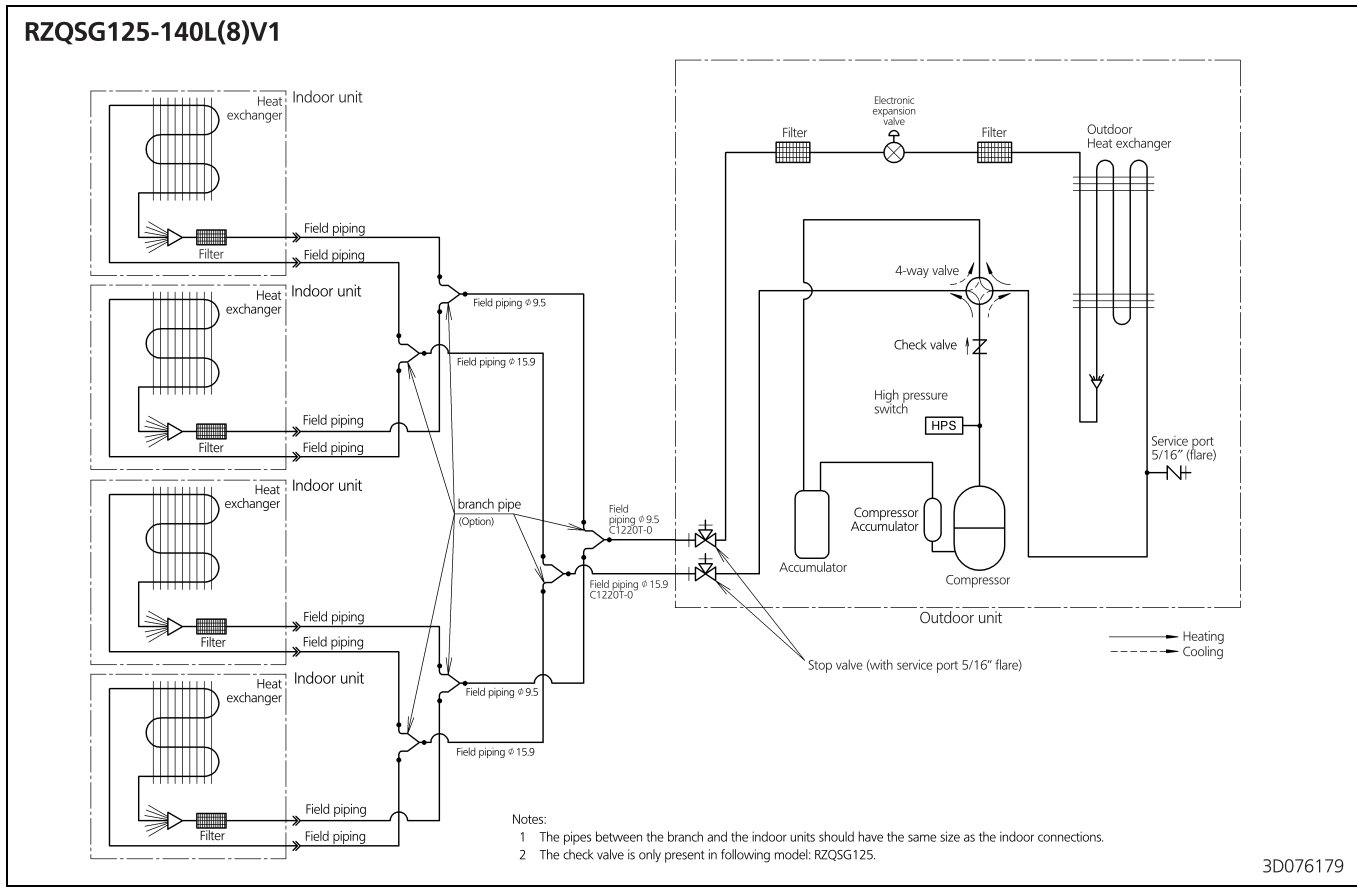


10 Wiring diagrams

10 - 1 Wiring Diagrams - Single Phase


10

RZQSG71L3V1

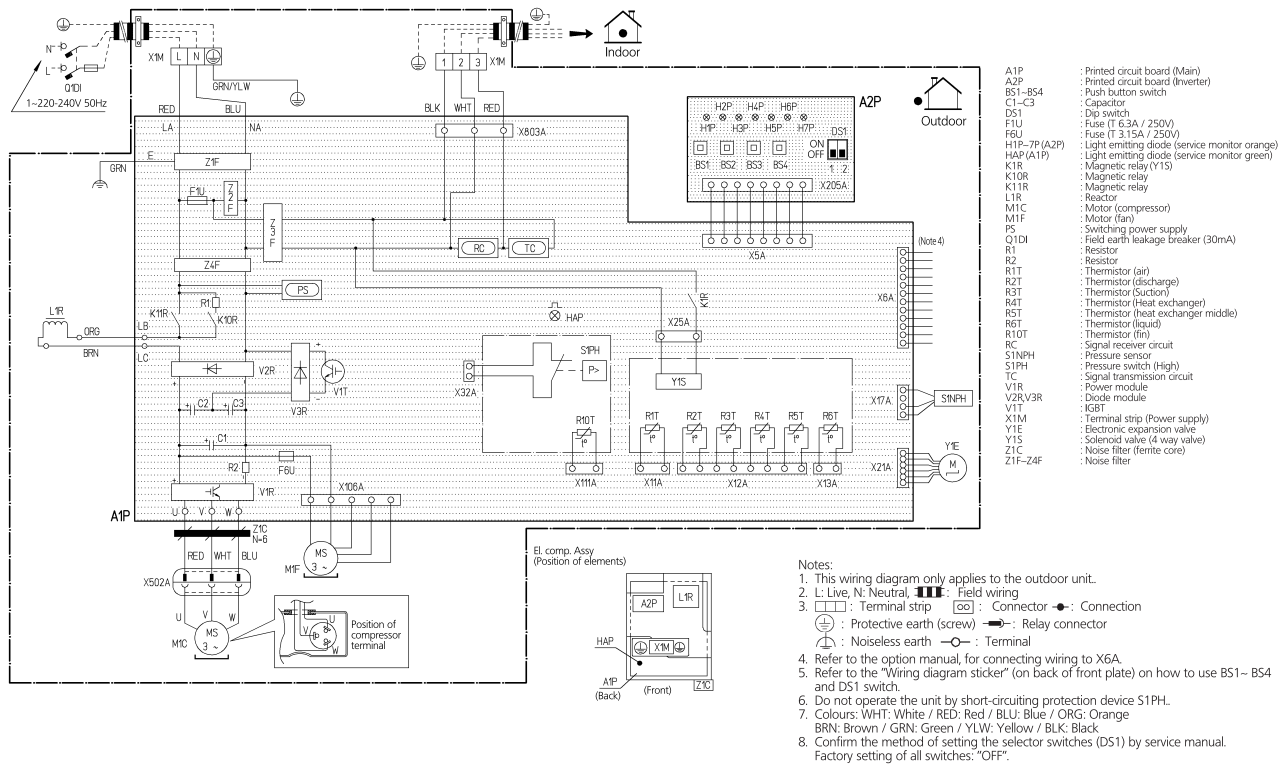

2TW30466-1B


RZQSG100-125L8V1

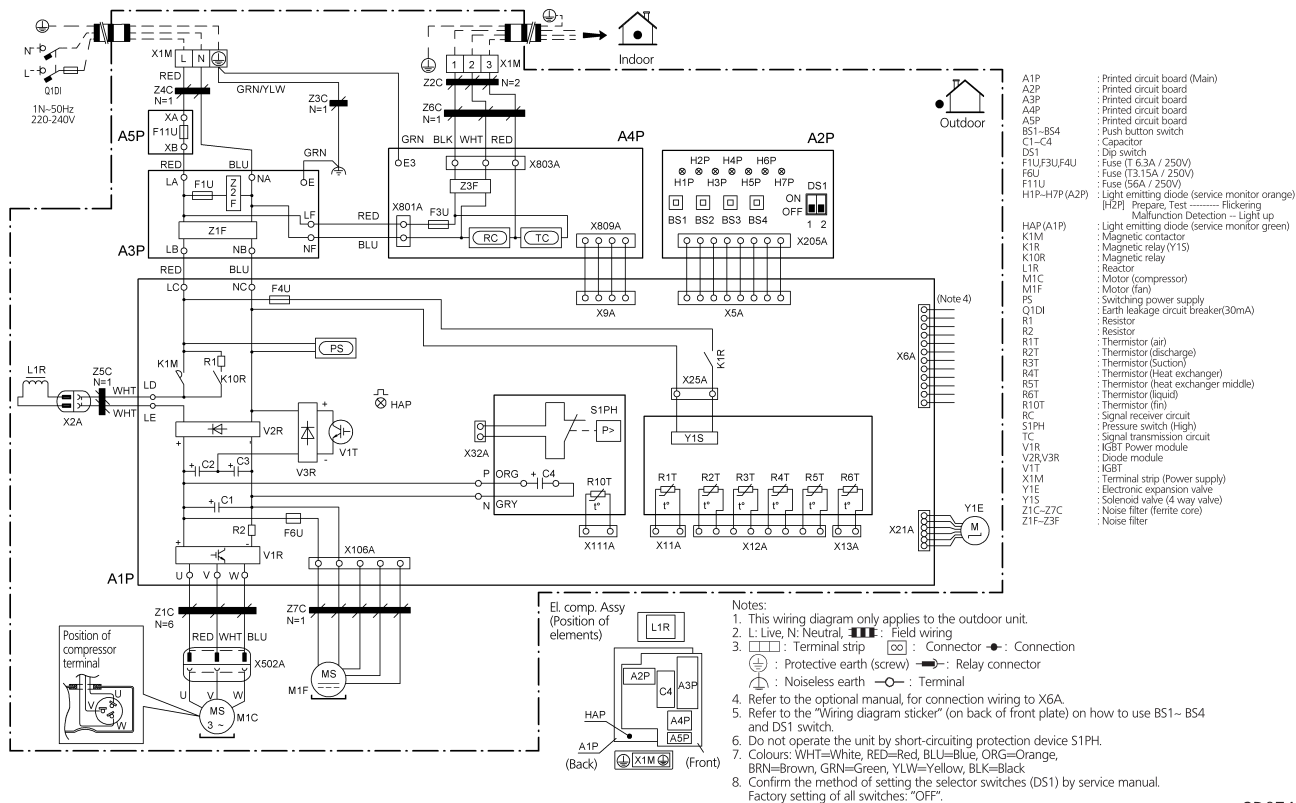

2D074930A

10 Wiring diagrams

10 - 1 Wiring Diagrams - Single Phase

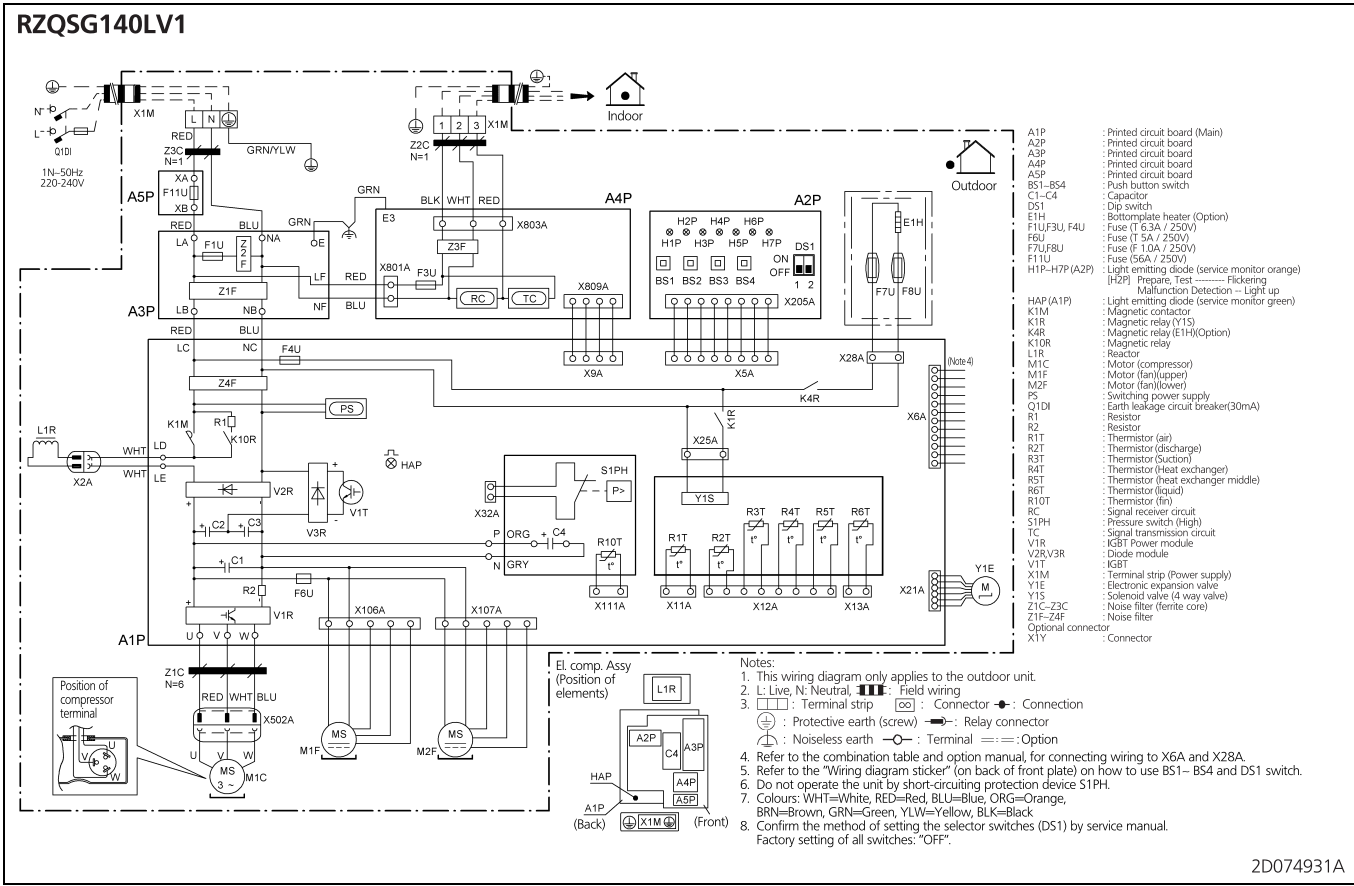


2D074931A

11 Sound data

11 - 1 Sound Power Spectrum

RZQSG71L3V1

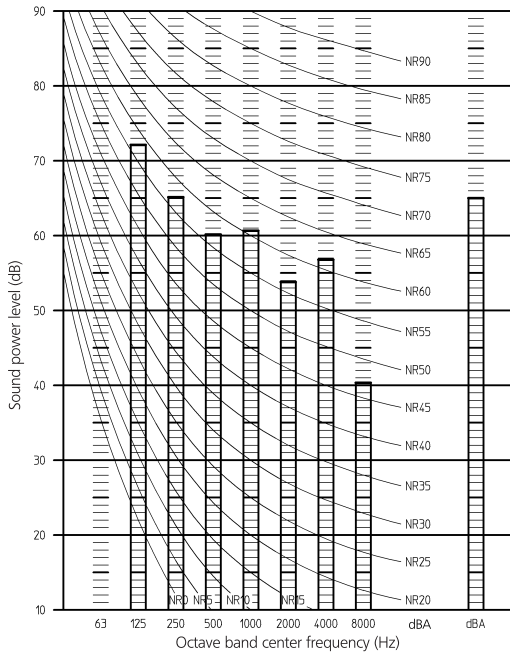


NOTES

- 1 dBA = A-weighted sound power level (A-scale according to IEC)
- 2 Reference acoustic intensity 0dB = 10E-6μW/m²
- 3 Measured according ISO3744

3TW30467-3

RZQSG100L8V1

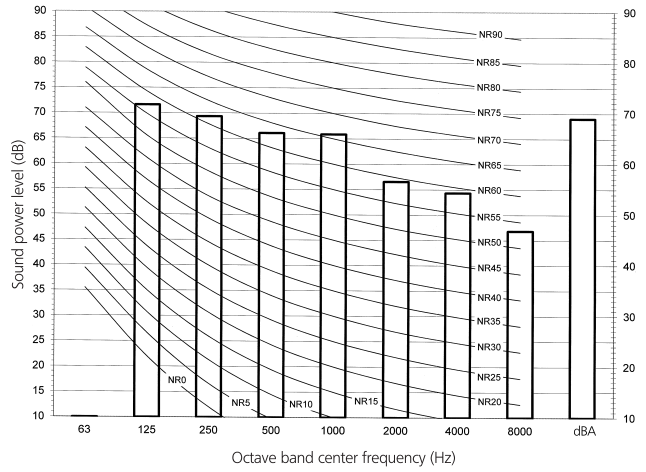


NOTES

- 1 dBA = A-weighted sound power level (A-scale according to IEC)
- 2 Reference acoustic intensity 0 dB = 10E-6μW/m²
- 3 Measured according to ISO 3744

3D076086

RZQSG125L8V1

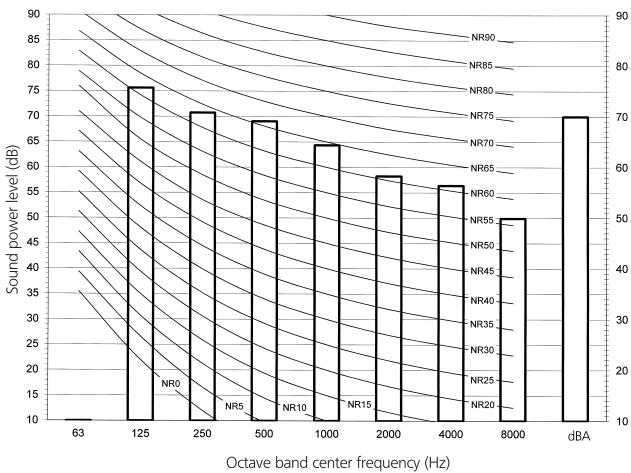


NOTES

- 1 dBA = A-weighted sound power level (A-scale according to IEC)
- 2 Reference acoustic intensity 0 dB = 10E-6μW/m²
- 3 Measured according to ISO 3744

3D076087

RZQSG140LV1

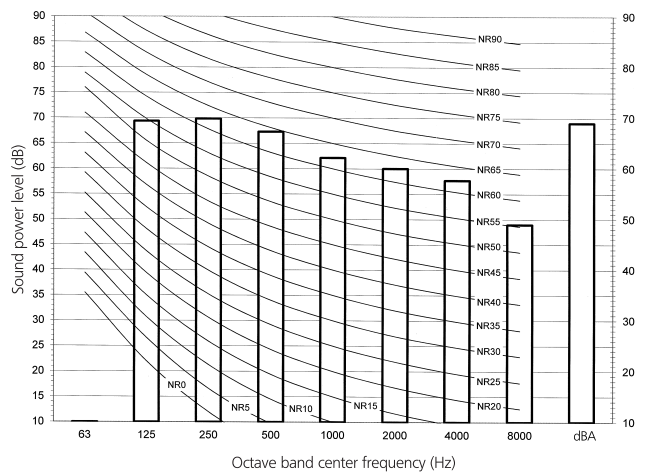





NOTES

- 1 dBA = A-weighted sound power level (A-scale according to IEC)
- 2 Reference acoustic intensity 0 dB = 10E-6μW/m²
- 3 Measured according to ISO 3744

3D076088

11 Sound data

11 - 2 Sound Pressure Spectrum - Cooling

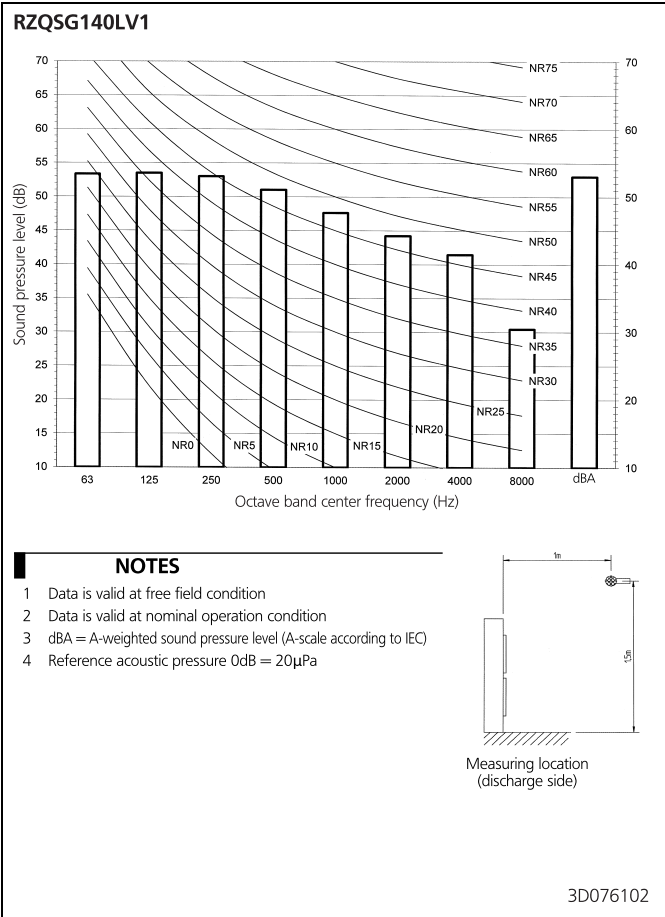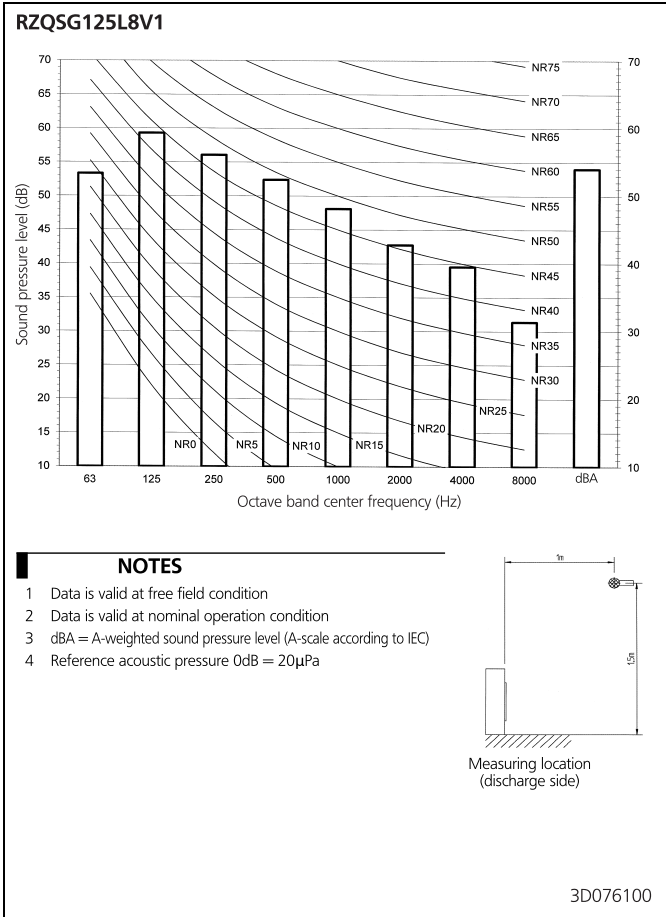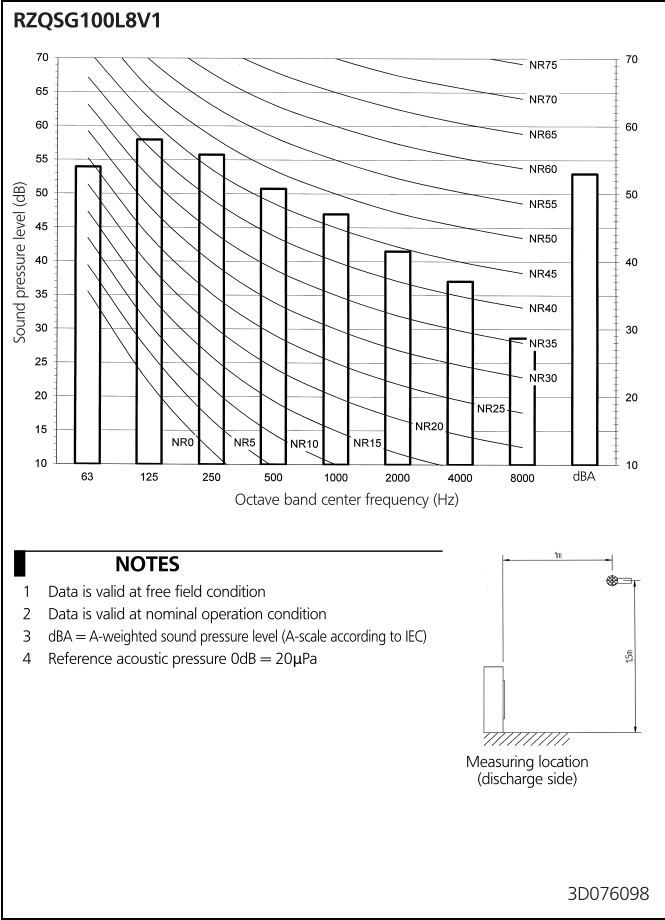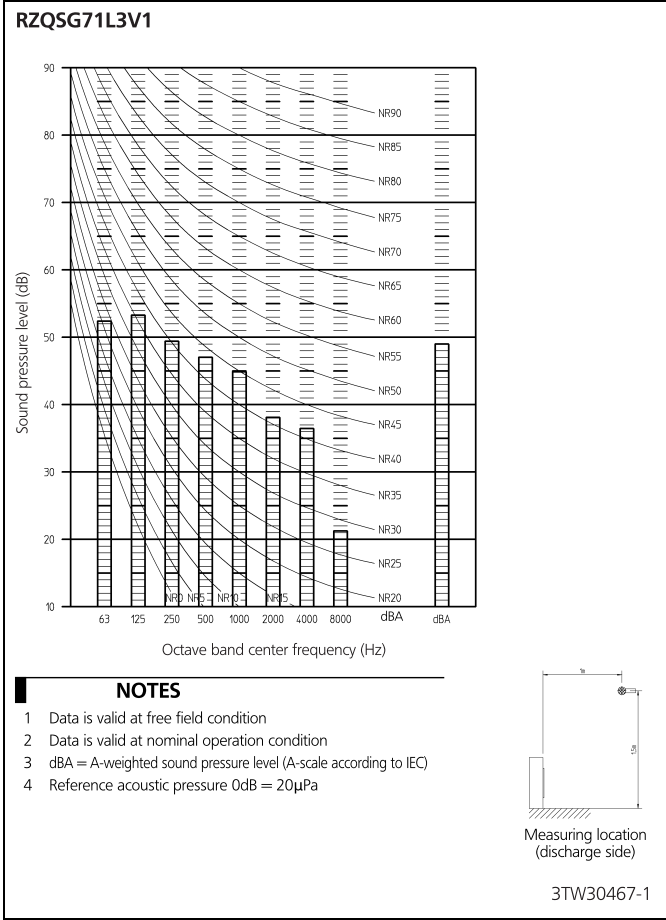


11 Sound data

11 - 3 Sound Pressure Spectrum - Heating


11

RZQSG71L3V1

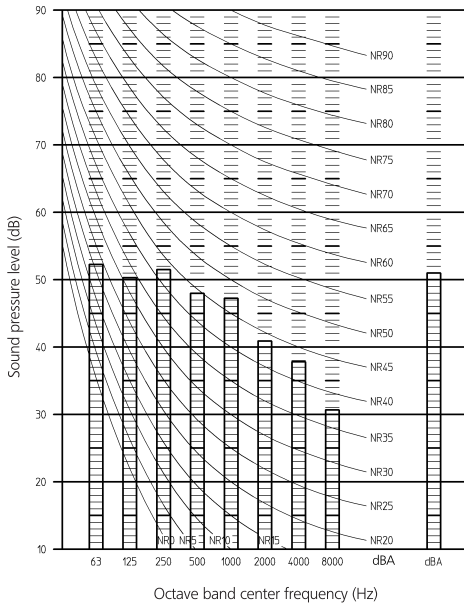


NOTES

- 1 Data is valid at free field condition
- 2 Data is valid at nominal operation condition
- 3 dBA = A-weighted sound pressure level (A-scale according to IEC)
- 4 Reference acoustic pressure 0dB = 20μPa




3TW30467-2

RZQSG100L8V1

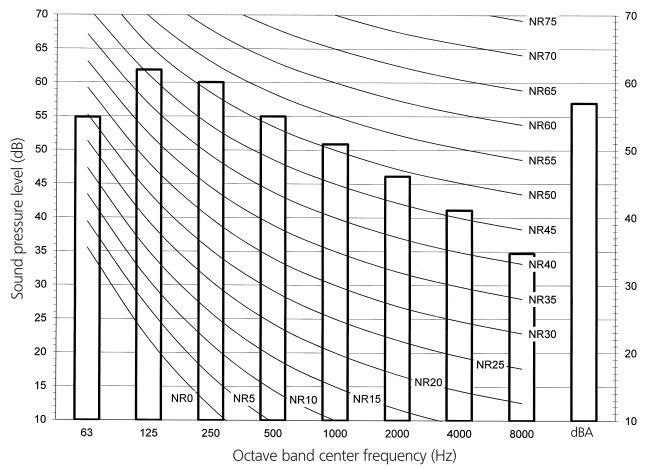


NOTES

- 1 Data is valid at free field condition
- 2 Data is valid at nominal operation condition
- 3 dBA = A-weighted sound pressure level (A-scale according to IEC)
- 4 Reference acoustic pressure 0dB = 20μPa




3D076107

RZQSG125L8V1

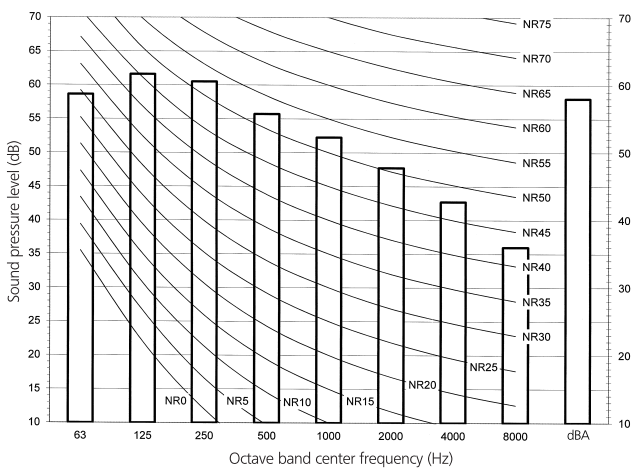


NOTES

- 1 Data is valid at free field condition
- 2 Data is valid at nominal operation condition
- 3 dBA = A-weighted sound pressure level (A-scale according to IEC)
- 4 Reference acoustic pressure 0dB = 20μPa




3D076108

RZQSG140LV1

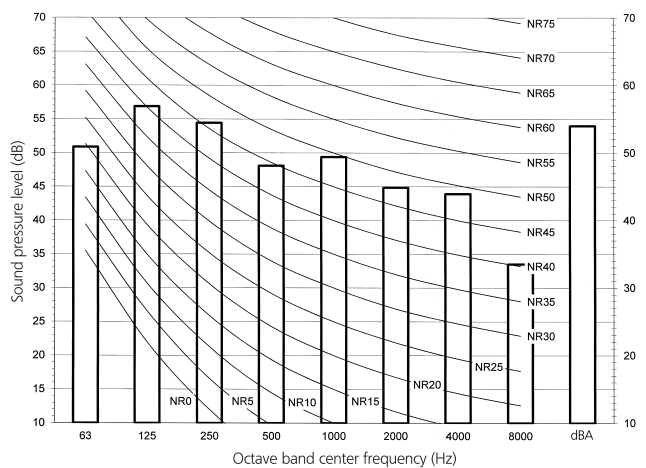

NOTES




- 1 Data is valid at free field condition
- 2 Data is valid at nominal operation condition
- 3 dBA = A-weighted sound pressure level (A-scale according to IEC)
- 4 Reference acoustic pressure 0dB = 20μPa



3D076109

11 Sound data

11 - 4 Sound Pressure Spectrum Quiet Mode

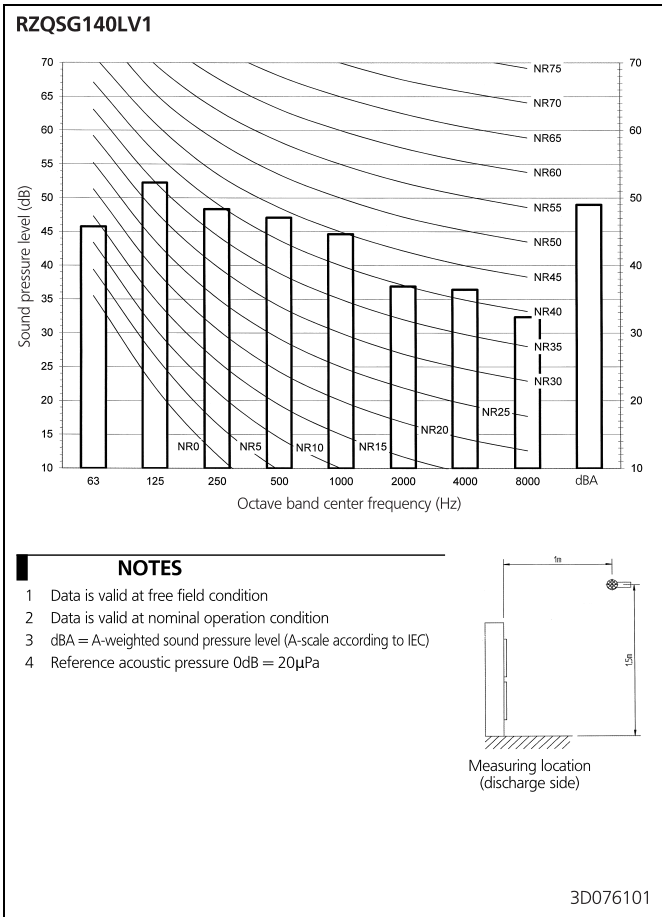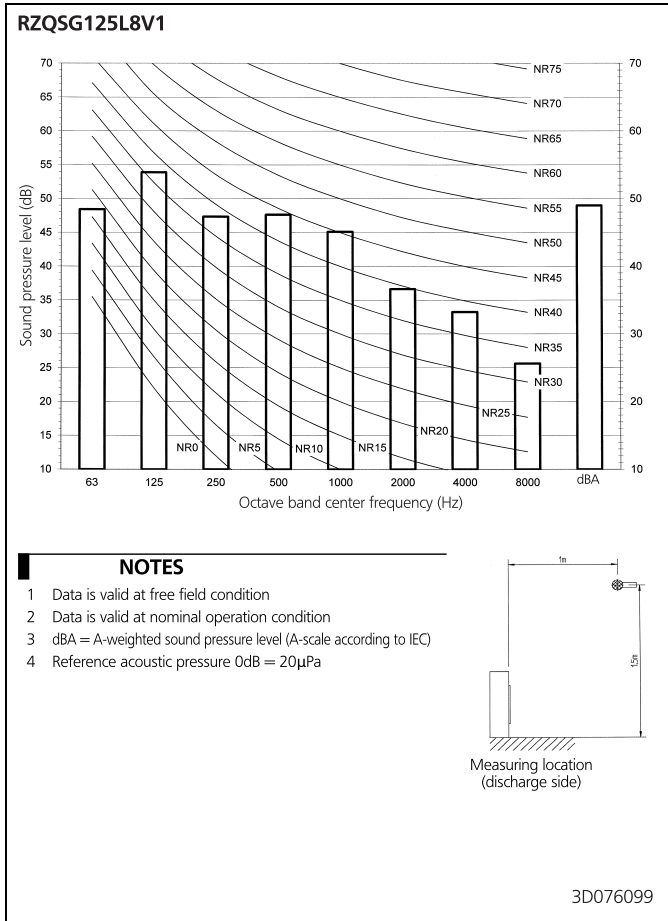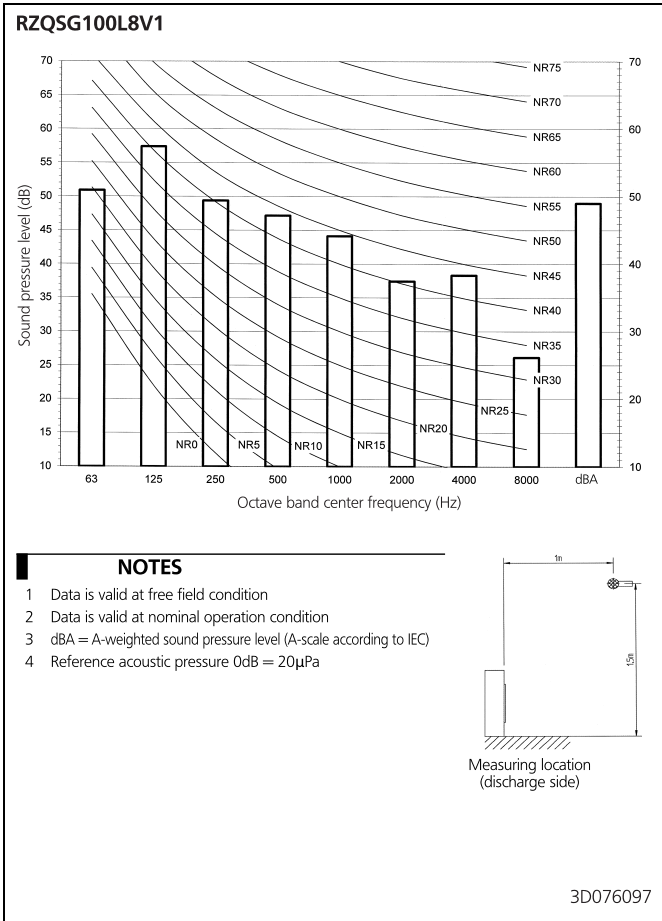

12 Installation

12 - 1 Installation Method

RZQSG71L3V1

A. Non stacked installation

12

Legend Unit: mm


	←	→	↖	↗	A	B1	B2	C	D1	D2	E	L1/L2	
[Diagram 1]	✓				≥50(100)								
	✓	✓	✓		≥100	≥100		≥100					
	✓			✓	≥100				≤500	≥1000			
	✓	✓	✓	✓	≥150	≥150		≥150	≤500	≥1000			
	✓			✓					≤500	≥500		≥1000	
	✓	✓			L1<L2	≥50(100)			≥500				
	✓			✓	L2<L1	≥50(100)			≥500				
	✓			✓	L1<L2	L1≤H	≥150(250)	≤500	≥750	≥1000		≥1000	0.4L1≤1/2H 0.4L1≤1/2H
	✓			✓	L1<L2	H<L1	L1≤H						1
	✓			✓	L2<L1	L2≤H	≥50(100)		≥500(1000)	≥500	≥1000		0.4L2≤1/2H 1/2H<L2≤H
[Diagram 2]	✓	✓	✓	✓	≥200	≥200(300)		≥1000					
	✓	✓	✓	✓	≥200	≥200(300)		≥1000		≤500	≥1000		
	✓			✓					≤500		≥1000		
	✓			✓	L1<L2	≥200(300)		≥1000					
	✓			✓	L2<L1	≥150(250)		≥1000(1500)				0.4L2≤1/2H 1/2H<L2≤H	
	✓			✓	L1<L2	L1≤H	≥200(300)	≤500	≥1000	≥1000		≥1000	0.4L1≤1/2H 1/2H<L1≤H
	✓			✓	L1<L2	H<L1	L1≤H						1
	✓			✓	L2<L1	L2≤H	≥150(250)		≥1000(1500)	≤500	≥1000		0.4L2≤1/2H 1/2H<L2≤H
	✓			✓	L2<L1	H<L2	≥200(300)		≥1000(1500)	≤500	≥1000		2
	✓			✓	L2<L1	L2≤H	≥200(300)		≥1000(1500)	≤500	≥1000		2

- ← Suction side obstacle
 - ↗ Discharge side obstacle
 - ↖ Left side obstacle
 - ↗ Right side obstacle
 - ↖ Top side obstacle
 - ✓ Obstacle is present
- 1 In these cases, close the bottom of the installation frame to prevent discharged air from being bypassed.
- 2 In these cases, only 2 units can be installed.
- ⊗ This situation is not allowed.


Figures between () indicate the dimensions only for the 100-125-140 class models.

B. Stacked installation

1. Obstacles exist in front of the outlet side




2. Obstacles exist in front of the air inlet




Do not stack more than one unit.
About 100mm is required as the dimension for laying the upper outdoor unit's drain pipe.
Get the portion A sealed so that air from the outlet does not bypass.

C. Multiple-row installation

1. Installation of one unit per row



2. Installing multiple units (2 units or more) in lateral connection per row



Relation of dimensions of H, A, and L are shown in the table below.

	L	A
L ≤ H	0 < L ≤ 1/2 H	150 (250)
	1/2 H < L	200 (300)
H < L	Installation impossible	

12 Installation

12 - 1 Installation Method

RZQSG100-140L(8)V1


Installation service space

The measure of these values is "mm".


(A) When there are obstacles on suction sides.

• No obstacle above


- ① Stand-alone installation
 - Obstacle on the suction side only



- Obstacle on both sides and suction side, too




- ② Series installation (2 or more) (Note 1)
 - Obstacle on the suction side and both sides

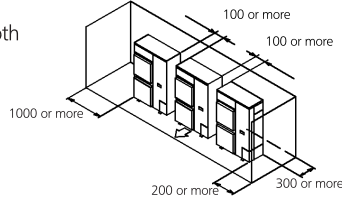


• Obstacle above, too.


- ① Stand-alone installation
 - Obstacle on the suction side, too



- Obstacle on both sides and suction side, too




- ② Series installation (2 or more) (Note 1)
 - Obstacle on the suction side and both sides

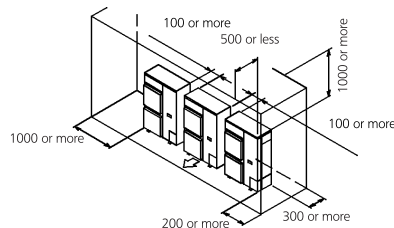


(B) When there are obstacles on discharge sides.

• No obstacle above

- ① Stand-alone installation
 - Obstacle on the discharge side only




- ② Series installation (2 or more) (Note 1)
 - Obstacle on the discharge side only

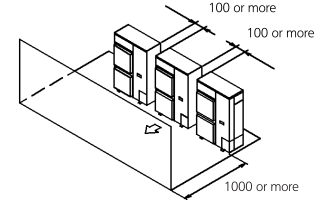


• Obstacle above, too

- ① Stand-alone installation
 - Obstacle on the discharge side only, too



- ② Series installation (2 or more) (Note 1)
 - Obstacle on the discharge side

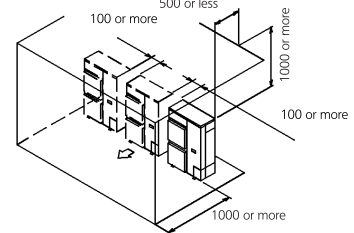


(C) When there are obstacles on both suction and discharge sides.

Pattern 1


When the obstacles on the discharge side is higher than the unit. (L>H)
(There is no limit for the height of obstructions on the suction side.)

• No obstacle above

- ① Stand-alone installation
 - No obstacle above

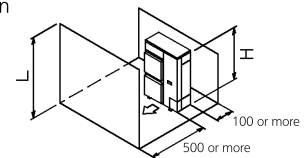

- ② Series installation (2 or more) (Note 1)
 - No obstacle above

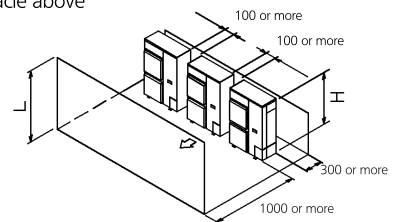

3D069554

12 Installation

12 - 1 Installation Method

12


RZQSG100-140L(8)V1

● **Obstacle above, too**

- ① Stand-alone installation (Note 2)
 - When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$	750 or more
	$1/2 H < L \leq H$	1000 or more
$L > H$	Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A	



- ② Series installation (2 or more) (Note 1, 2)
 - When there are obstacles on suction, discharge and top sides.


The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$	1000 or more
	$1/2 H < L \leq H$	1250 or more
$L > H$	Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A	

Limit of series installation is 2 units.


Pattern 2

When the obstacle on the discharge side is lower than the unit ($L \leq H$) (There is no limit for the height of obstructions on the suction side.)



● **No obstacle above**


- ① Stand-alone installation
 - No obstacle above



- ② Series installation (2 or more) (Note 1, 2)
 - When there are obstacles on both suction and discharge sides.

The relations between H, A and L are as follows.

	L	A
$L \leq 1/2 H$		250 or more
$1/2 H < L \leq H$		300 or more

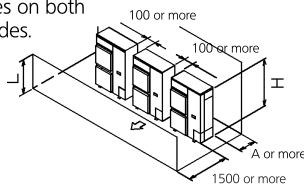


● **Obstacle above, too**

- ① Stand-alone installation (Note 2)
 - When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$	100 or more
	$1/2 H < L \leq H$	200 or more
$L > H$	Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A	




- ② Series installation (2 or more) (Note 1, 2)

- When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$	250 or more
	$1/2 H < L \leq H$	300 or more
$L > H$	Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A	


Limit of series installation is 2 units.



(D) Double-decker installation


- ① Obstacle on the discharge side. (Note 1)

- Do not exceed two levels for stacked installation.
- Install a roof cover similar to A (field supply), as outdoor units with downward drainage are prone to dripping and freezing.
- Install the upper-level outdoor unit so that its bottom plate is a sufficient height above the roof cover. This is to prevent the buildup of ice on the underside of the bottom plate.




- ② Obstacle on the suction side. (Note 1)

- Do not exceed two levels for stacked installation.
- Install a roof cover similar to A (field supply), as outdoor units with downward drainage are prone to dripping and freezing.
- Install the upper-level outdoor unit so that its bottom plate is a sufficient height above the roof cover. This is to prevent the buildup of ice on the underside of the bottom plate.



(E) Multiple rows of series installation (on the rooftop, etc.)


- ① One row of stand-alone installation

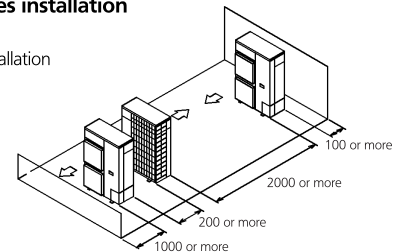

- ② Rows of series installation (2 or more)

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$	250 or more
	$1/2 H < L \leq H$	300 or more
$L > H$	Can not be installed	

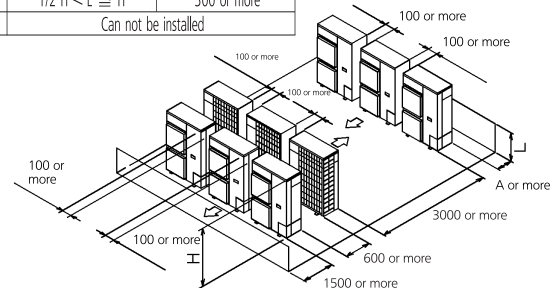

NOTES



- In case of the sideways piping, make a 100mm gap between the unit above.
- Close the bottom of the installation frame to prevent the discharged air from being bypassed.
- It is not necessary to install a roof cover if there is no danger of drainage dripping and freezing. In this case, the space between the upper and lower outdoor units should be at least 100mm. Close off the gap between the upper and lower units so there is no re-intake of discharged air.

3D069554

13 Operation range

13 - 1 Operation Range

RZQSG-L(3/8)V1

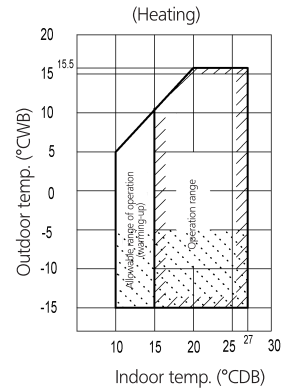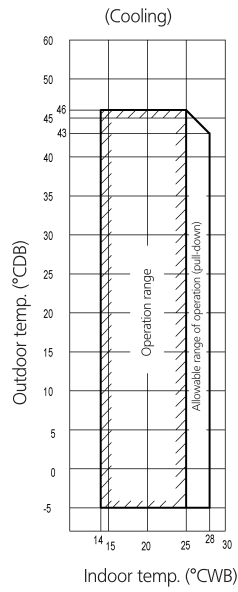

Notes:

- 1 Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
- 2 To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.
- 3 In case of high humidity conditions (>92%) in this operation area, an RZQG model should be used instead of an RZQSG model. This to avoid freeze-up of the outdoor unit.

3D076504



Daikin Europe N.V. participates in the Eurovent Certification programme for Air conditioners (AC), Liquid Chilling Packages (LCP), Air handling units (AHU) and Fan coil units (FCU). Check ongoing validity of certificate online: www.eurovent-certification.com or using: www.certiflash.com

The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.

BARCODE

Daikin products are distributed by: