

technical data

Concealed Floor Standing Unit
FXNQ-MAVE

air conditioning systems

R-410A

TABLE OF CONTENTS

FXNQ-MAVE

1	Specifications	2
	Technical Specifications	2
	Electrical Specifications (50Hz)	2
	Electrical Specifications (60Hz)	3
2	Safety device settings	4
3	Options	4
4	Control systems	5
5	Capacity tables	6
	Cooling capacity tables	6
	Heating capacity tables	8
6	Dimensional drawing & centre of gravity	10
	Dimensional drawing	10
	Centre of gravity	12
7	Piping diagram	13
8	Wiring diagram	14
	Wiring diagram	14
9	Sound data	15
	Sound pressure spectrum	15
10	Installation	17
	Suspension bolt pitch position	17
	Service space	18

1 Specifications

1-1 Technical Specifications				FXNQ20MAVE	FXNQ25MAVE	FXNQ32MAVE	FXNQ40MAVE	FXNQ50MAVE	FXNQ63MAVE
Capacity	Cooling		kW	2.20	2.80	3.60	4.50	5.60	7.10
	Heating		kW	2.50	3.20	4.00	5.00	6.30	8.00
Power Input (50Hz)	Cooling		kW	0.049	0.049	0.090	0.090	0.110	0.110
	Heating		kW	0.049	0.049	0.090	0.090	0.110	0.110
Power Input (60Hz)	Cooling		kW	0.047	0.047	0.079	0.084	0.105	0.108
	Heating		kW	0.047	0.047	0.079	0.084	0.105	0.108
Casing	Material			Galvanised steel					
Dimensions	Unit	Height	mm	610	610	610	610	610	610
		Width	mm	930	930	1070	1070	1350	1350
		Depth	mm	220	220	220	220	220	220
Weight	Unit		kg	19	19	23	23	27	27
Heat Exchanger	Dimensions	Nr of Rows		3	3	3	3	3	3
		Fin Pitch	mm	1.50	1.50	1.50	1.50	1.50	1.50
		Face Area	m²	0.159	0.159	0.200	0.200	0.282	0.282
		Nr of Stages		14	14	14	14	14	14
Fan	Type			Sirocco fan					
	Quantity			1	1	1	1	1	1
Air Flow Rate	Cooling	High	m³/min	7.00	7.00	8.00	11.00	14.00	16.00
		Low	m³/min	6.00	6.00	6.00	8.50	11.00	12.00
Fan	Motor	Quantity		1	1	1	1	1	1
		Model		D14B20	D14B20	2D14B13	2D14B13	2D14B20	2D14B20
		Output (high)	W	15	15	25	25	35	35
		Drive		Direct drive					
Refrigerant	Name			R-410A					
Cooling	Sound Pressure	High	dBA	35.0	35.0	35.0	38.0	39.0	40.0
		Low	dBA	32.0	32.0	32.0	33.0	34.0	35.0
Piping connections	Liquid (OD)	Type		Flare connection					
		Diameter	mm	6.35	6.35	6.35	6.35	6.35	9.52
	Gas	Type		Flare connection					
		Diameter	mm	12.7	12.7	12.7	12.7	12.7	15.9
	Drain	Diameter	mm	21	21	21	21	21	21
Heat Insulation				Glass Fiber/Urethane Foam					
Air Filter				Resin net with mold resistance					
Refrigerant control				Electronic expansion valve					
Temperature control				Microprocessor thermostat for cooling and heating					
Safety devices				PC board fuse					
				Fan motor thermal protector					
				Installation and operation manual					
Standard Accessories	Standard Accessories			Insulation for fitting					
				Drain hose					
				Clamps					
				Screws					
				Washer					
				Level adjustment screw					
Notes				Nominal cooling capacities are based on : indoor temperature : 27°CDB, 19°CWB, outdoor temperature : 35°CDB, equivalent refrigerant piping : 7.5m (horizontal)					
				Nominal heating capacities are based on : indoor temperature : 20°CDB, outdoor temperature : 7°CDB, 6°CWB, equivalent refrigerant piping : 7.5m (horizontal)					
				Capacities are net, including a deduction for cooling (an addition for heating) for indoor fan motor heat.					
				Sound pressure levels are measured at 220V					

1-2 Electrical Specifications (50Hz)				FXNQ20MAVE	FXNQ25MAVE	FXNQ32MAVE	FXNQ40MAVE	FXNQ50MAVE	FXNQ63MAVE
Power Supply	Name			VE					
	Phase			1~					
	Frequency		Hz	50					
	Voltage		V	220-240					

1 Specifications

1-2 Electrical Specifications (50Hz)			FXNQ20MAVE	FXNQ25MAVE	FXNQ32MAVE	FXNQ40MAVE	FXNQ50MAVE	FXNQ63MAVE
Current	Minimum circuit amps (MCA)	A	0.3	0.3	0.6	0.6	0.6	0.6
	Maximum fuse amps (MFA)	A	15	15	15	15	15	15
	Full load amps (FLA)	A	0.2	0.2	0.5	0.5	0.5	0.5
Voltage range	Minimum	V	-10%					
	Maximum	V	+10%					
Notes			Voltage range : units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed range limits.					
			Maximum allowable voltage range variation between phases is 2%.					
			MCA/MFA : MCA = 1.25 x FLA					
			MFA is smaller than or equal to 4 x FLA					
			Next lower standard fuse rating minimum 15A					
			Select wire size based on the MCA					
			Instead of a fuse, use a circuit breaker					

1-3 Electrical Specifications (60Hz)			FXNQ20MAVE	FXNQ25MAVE	FXNQ32MAVE	FXNQ40MAVE	FXNQ50MAVE	FXNQ63MAVE
Power Supply	Name		VE					
	Phase		1~					
	Frequency	Hz	60					
	Voltage	V	220					
Current	Minimum circuit amps (MCA)	A	0.3	0.3	0.5	0.5	0.6	0.6
	Maximum fuse amps (MFA)	A	15	15	15	15	15	15
	Full load amps (FLA)	A	0.2	0.2	0.4	0.4	0.5	0.5
Voltage range	Minimum	V	-10%					
	Maximum	V	+10%					
Notes			Voltage range : units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed range limits.					
			Maximum allowable voltage range variation between phases is 2%.					
			MCA/MFA : MCA = 1.25 x FLA					
			MFA is smaller than or equal to 4 x FLA					
			Next lower standard fuse rating minimum 15A					
			Select wire size based on the MCA					
			Instead of a fuse, use a circuit breaker					

2 Safety device settings


		FXNQ20MA	FXNQ25MA	FXNQ32MA	FXNQ40MA	FXNQ50MA	FXNQ63MA
PC BOARD FUSE		250V 10A					
FAN MOTOR THERMAL PROTECTOR	°C	OFF: 135 ^{±10} / ON: 120 or less					

3D034529C

2 3 Options

	FXNQ20MA	FXNQ25MA	FXNQ32MA	FXNQ40MA	FXNQ50MA	FXNQ63MA
LONG LIFE REPLACEMENT FILTER	KAFJ361K28		KAFJ361K45		KAFJ361K71	

4D034574B

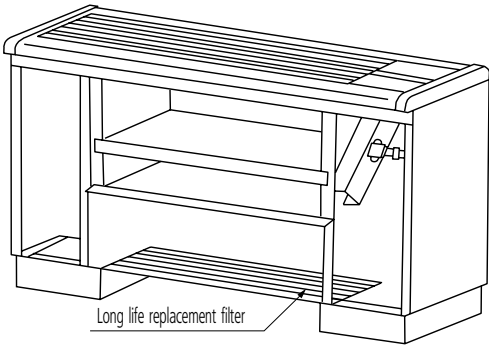

4 Control systems

Individual control systems

		FXNQ20MA	FXNQ25MA	FXNQ32MA	FXNQ40MA	FXNQ50MA	FXNQ63MA
WIRED REMOTE CONTROL							BRC1D52
INFRARED REMOTE CONTROL	Heat pump						BRC4C62
	Cooling only						BRC4C64
SIMPLIFIED REMOTE CONTROL							BRC2A51
REMOTE CONTROL FOR HOTEL USE							BRC3A61

Centralised control systems

		FXNQ20MA	FXNQ25MA	FXNQ32MA	FXNQ40MA	FXNQ50MA	FXNQ63MA
CENTRALISED REMOTE CONTROL							DCS302C51
UNIFIED ON/OFF CONTROL							DCS301C51
SCHEDULE TIMER							DST301C51

Others

		FXNQ20MA	FXNQ25MA	FXNQ32MA	FXNQ40MA	FXNQ50MA	FXNQ63MA
WIRING ADAPTER							KRP1B61
WIRING ADAPTER FOR ELECTRICAL APPENDICES (1)							KRP2A51
WIRING ADAPTER FOR ELECTRICAL APPENDICES (2)							KRP4A51
REMOTE SENSOR							KRCS01-1
ELECTRICAL BOX WITH EARTH TERMINAL (3 BLOCKS)							KJB311A
ELECTRICAL BOX WITH EARTH TERMINAL (2 BLOCKS)							KJB212A
NOISE FILTER (FOR ELECTROMAGNETIC INTERFACE USE ONLY)							KEK26-1A
EXTERNAL CONTROL ADAPTER FOR OUTDOOR UNITS (INSTALLATION ON INDOOR UNIT)							DTA104A61

4D034581A

5 Capacity tables

5 - 1 Cooling capacity tables

FXNQ-MA

TC: Total capacity; kW - SHC: Sensible capacity; kW

Unit size	Nominal capacity	Outdoor air temp.	Indoor air temperature													
			14.0WB		16.0WB		18.0WB		19.0WB		20.0WB		22.0WB		24.0WB	
			20.0DB		23.0DB		26.0DB		27.0DB		28.0DB		30.0DB		32.0DB	
		°CDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
20	2.2	10.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.8	2.6	1.8	2.9	1.8
		12.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.8	2.6	1.8	2.9	1.7
		14.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.8	2.6	1.8	2.8	1.7
		16.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.8	2.6	1.8	2.8	1.7
		18.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.8	2.6	1.8	2.7	1.7
		20.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.8	2.6	1.8	2.7	1.6
		21.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.8	2.6	1.8	2.7	1.6
		23.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.8	2.6	1.8	2.6	1.6
		25.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.8	2.6	1.7	2.6	1.6
		27.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.8	2.5	1.7	2.6	1.6
		29.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.8	2.5	1.7	2.5	1.6
		31.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.8	2.4	1.7	2.5	1.6
		33.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.8	2.4	1.7	2.5	1.6
		35.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.6	2.4	1.5
		37.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.3	1.7	2.3	1.6	2.4	1.6
		39.0	1.5	1.3	1.8	1.5	2.1	1.7	2.2	1.7	2.2	1.7	2.3	1.6	2.3	1.5
25	2.8	10.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	3.0	2.1	3.4	2.1	3.7	2.1
		12.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	3.0	2.1	3.4	2.1	3.6	2.1
		14.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	3.0	2.1	3.4	2.1	3.6	2.1
		16.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	3.0	2.1	3.4	2.1	3.5	2.1
		18.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	3.0	2.1	3.4	2.1	3.5	2.0
		20.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	3.0	2.1	3.4	2.1	3.4	2.0
		21.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	3.0	2.1	3.4	2.1	3.4	2.0
		23.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	3.0	2.1	3.3	2.1	3.4	2.0
		25.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	3.0	2.1	3.3	2.1	3.3	2.0
		27.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	3.0	2.1	3.2	2.1	3.3	1.9
		29.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	3.0	2.1	3.2	2.0	3.2	1.9
		31.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	3.0	2.1	3.1	2.0	3.2	1.9
		33.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	3.0	2.1	3.1	2.0	3.1	1.9
		35.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	3.0	2.1	3.0	2.0	3.1	1.9
		37.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	2.9	2.0	3.0	2.0	3.0	1.9
		39.0	1.9	1.6	2.3	1.8	2.6	2.0	2.8	2.1	2.9	2.0	2.9	2.0	3.0	1.9
32	3.6	10.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.8	2.6	4.3	2.6	4.7	2.6
		12.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.8	2.6	4.3	2.6	4.7	2.6
		14.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.8	2.6	4.3	2.6	4.6	2.6
		16.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.8	2.6	4.3	2.6	4.6	2.5
		18.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.8	2.6	4.3	2.6	4.5	2.5
		20.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.8	2.6	4.3	2.6	4.4	2.5
		21.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.8	2.6	4.3	2.6	4.4	2.5
		23.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.8	2.6	4.2	2.6	4.3	2.4
		25.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.8	2.6	4.2	2.6	4.3	2.4
		27.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.8	2.6	4.1	2.5	4.2	2.4
		29.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.8	2.6	4.1	2.5	4.2	2.4
		31.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.8	2.6	4.0	2.5	4.1	2.4
		33.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.8	2.6	3.9	2.4	4.0	2.3
		35.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.8	2.5	3.9	2.4	4.0	2.3
		37.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.5	3.7	2.5	3.8	2.4	3.9	2.3
		39.0	2.4	2.1	2.9	2.2	3.4	2.5	3.6	2.6	3.7	2.5	3.8	2.4	3.8	2.3
40	4.5	10.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.8	3.2	5.4	3.3	5.9	3.3
		12.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.8	3.2	5.4	3.3	5.8	3.3
		14.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.8	3.2	5.4	3.3	5.8	3.2
		16.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.8	3.2	5.4	3.3	5.7	3.2
		18.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.8	3.2	5.4	3.3	5.6	3.1
		20.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.8	3.2	5.4	3.3	5.5	3.1
		21.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.8	3.2	5.4	3.3	5.5	3.1
		23.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.8	3.2	5.3	3.2	5.4	3.0
		25.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.8	3.2	5.2	3.2	5.3	3.0
		27.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.8	3.2	5.2	3.1	5.3	3.0
		29.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.8	3.2	5.1	3.1	5.2	3.0
		31.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.8	3.2	5.0	3.1	5.1	2.9
		33.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.8	3.2	4.9	3.0	5.0	2.9
		35.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.7	3.2	4.9	3.1	5.0	2.9
		37.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.1	4.7	3.2	4.8	3.0	4.9	2.8
		39.0	3.0	2.5	3.6	2.7	4.2	3.1	4.5	3.2	4.6	3.1	4.7	3.0	4.8	2.8

CA03A095

5 Capacity tables

5 - 1 Cooling capacity tables

FXNQ-MA																
TC: Total capacity;kW - SHC: Sensible capacity;kW																
Unit size	Nominal capacity	Outdoor air temp.	Indoor air temperature													
			14.0WB		16.0WB		18.0WB		19.0WB		20.0WB		22.0WB		24.0WB	
			20.0DB		23.0DB		26.0DB		27.0DB		28.0DB		30.0DB		32.0DB	
		°CDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	5.6	10.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	6.0	4.0	6.7	4.1	7.4	4.1
		12.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	6.0	4.0	6.7	4.1	7.3	4.1
		14.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	6.0	4.0	6.7	4.1	7.2	4.0
		16.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	6.0	4.0	6.7	4.1	7.1	4.0
		18.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	6.0	4.0	6.7	4.1	7.0	3.9
		20.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	6.0	4.0	6.7	4.1	6.9	3.9
		21.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	6.0	4.0	6.7	4.1	6.8	3.8
		23.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	6.0	4.0	6.6	4.0	6.7	3.8
		25.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	6.0	4.0	6.5	4.0	6.6	3.7
		27.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	6.0	4.0	6.4	3.9	6.6	3.7
		29.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	6.0	4.0	6.3	3.9	6.5	3.7
		31.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	6.0	4.0	6.2	3.8	6.4	3.7
		33.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	6.0	4.0	6.1	3.8	6.3	3.6
		35.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	5.9	4.0	6.0	3.8	6.2	3.6
		37.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	5.8	3.9	5.9	3.7	6.1	3.6
		39.0	3.8	3.0	4.5	3.4	5.2	3.8	5.6	3.9	5.7	3.9	5.8	3.7	6.0	3.5
63	7.1	10.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.6	5.0	8.5	5.1	9.3	5.0
		12.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.6	5.0	8.5	5.1	9.2	5.0
		14.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.6	5.0	8.5	5.1	9.1	4.9
		16.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.6	5.0	8.5	5.1	9.0	4.8
		18.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.6	5.0	8.5	5.1	8.8	4.8
		20.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.6	5.0	8.5	5.1	8.7	4.7
		21.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.6	5.0	8.5	5.1	8.7	4.7
		23.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.6	5.0	8.4	5.0	8.5	4.6
		25.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.6	5.0	8.3	5.0	8.4	4.5
		27.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.6	5.0	8.1	4.9	8.3	4.5
		29.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.6	5.0	8.0	4.8	8.2	4.5
		31.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.6	5.0	7.9	4.7	8.1	4.4
		33.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.6	5.0	7.8	4.7	7.9	4.4
		35.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.5	4.9	7.7	4.7	7.8	4.3
		37.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.4	4.9	7.5	4.6	7.7	4.2
		39.0	4.8	3.7	5.7	4.2	6.6	4.8	7.1	4.9	7.2	4.8	7.4	4.6	7.6	4.2

CA03A095

5 Capacity tables

5 - 2 Heating capacity tables

FXNQ-MA

Unit Size	Nominal capacity	Outdoor air temperature		Indoor air temperature °CDB					
				16.0	18.0	20.0	21.0	22.0	24.0
		°CDB	°CWB	kW	kW	kW	kW	kW	kW
20	2.5	-19.8	-20.0	1.5	1.5	1.5	1.5	1.5	1.5
		-18.8	-19.0	1.5	1.5	1.5	1.5	1.5	1.5
		-16.7	-17.0	1.6	1.6	1.6	1.6	1.6	1.6
		-14.7	-15.0	1.7	1.7	1.7	1.7	1.7	1.7
		-12.6	-13.0	1.8	1.8	1.8	1.8	1.8	1.8
		-10.5	-11.0	1.9	1.9	1.9	1.9	1.9	1.9
		-9.5	-10.0	1.9	1.9	1.9	1.9	1.9	1.9
		-8.5	-9.1	2.0	2.0	1.9	1.9	1.9	1.9
		-7.0	-7.6	2.0	2.0	2.0	2.0	2.0	2.0
		-5.0	-5.6	2.1	2.1	2.1	2.1	2.1	2.1
		-3.0	-3.7	2.2	2.2	2.2	2.2	2.2	2.2
		0.0	-0.7	2.3	2.3	2.3	2.3	2.3	2.2
		3.0	2.2	2.5	2.5	2.4	2.4	2.3	2.2
		5.0	4.1	2.5	2.5	2.5	2.4	2.3	2.2
		7.0	6.0	2.6	2.6	2.5	2.4	2.3	2.2
		9.0	7.9	2.7	2.7	2.5	2.4	2.3	2.2
		11.0	9.8	2.8	2.7	2.5	2.4	2.3	2.2
		13.0	11.8	2.8	2.7	2.5	2.4	2.3	2.2
		15.0	13.7	2.8	2.7	2.5	2.4	2.3	2.2
25	3.2	-19.8	-20.0	1.9	1.9	1.9	1.9	1.9	1.9
		-18.8	-19.0	1.9	1.9	1.9	1.9	1.9	1.9
		-16.7	-17.0	2.1	2.1	2.0	2.0	2.0	2.0
		-14.7	-15.0	2.2	2.2	2.2	2.2	2.2	2.1
		-12.6	-13.0	2.3	2.3	2.3	2.3	2.3	2.3
		-10.5	-11.0	2.4	2.4	2.4	2.4	2.4	2.4
		-9.5	-10.0	2.5	2.4	2.4	2.4	2.4	2.4
		-8.5	-9.1	2.5	2.5	2.5	2.5	2.5	2.5
		-7.0	-7.6	2.6	2.6	2.6	2.6	2.6	2.6
		-5.0	-5.6	2.7	2.7	2.7	2.7	2.7	2.7
		-3.0	-3.7	2.8	2.8	2.8	2.8	2.8	2.8
		0.0	-0.7	3.0	3.0	3.0	3.0	3.0	2.8
		3.0	2.2	3.1	3.1	3.1	3.1	3.0	2.8
		5.0	4.1	3.3	3.2	3.2	3.1	3.0	2.8
		7.0	6.0	3.4	3.4	3.2	3.1	3.0	2.8
		9.0	7.9	3.5	3.4	3.2	3.1	3.0	2.8
		11.0	9.8	3.6	3.4	3.2	3.1	3.0	2.8
		13.0	11.8	3.6	3.4	3.2	3.1	3.0	2.8
		15.0	13.7	3.6	3.4	3.2	3.1	3.0	2.8
32	4.0	-19.8	-20.0	2.4	2.4	2.3	2.3	2.3	2.3
		-18.8	-19.0	2.4	2.4	2.4	2.4	2.4	2.4
		-16.7	-17.0	2.6	2.6	2.6	2.6	2.6	2.5
		-14.7	-15.0	2.7	2.7	2.7	2.7	2.7	2.7
		-12.6	-13.0	2.9	2.8	2.8	2.8	2.8	2.8
		-10.5	-11.0	3.0	3.0	3.0	3.0	3.0	3.0
		-9.5	-10.0	3.1	3.1	3.1	3.1	3.0	3.0
		-8.5	-9.1	3.1	3.1	3.1	3.1	3.1	3.1
		-7.0	-7.6	3.2	3.2	3.2	3.2	3.2	3.2
		-5.0	-5.6	3.4	3.4	3.4	3.4	3.4	3.4
		-3.0	-3.7	3.5	3.5	3.5	3.5	3.5	3.5
		0.0	-0.7	3.7	3.7	3.7	3.7	3.7	3.5
		3.0	2.2	3.9	3.9	3.9	3.9	3.7	3.5
		5.0	4.1	4.1	4.1	4.0	3.9	3.7	3.5
		7.0	6.0	4.2	4.2	4.0	3.9	3.7	3.5
		9.0	7.9	4.3	4.3	4.0	3.9	3.7	3.5
		11.0	9.8	4.5	4.3	4.0	3.9	3.7	3.5
		13.0	11.8	4.5	4.3	4.0	3.9	3.7	3.5
		15.0	13.7	4.5	4.3	4.0	3.9	3.7	3.5
40	5.0	-19.8	-20.0	3.0	2.9	2.9	2.9	2.9	2.9
		-18.8	-19.0	3.0	3.0	3.0	3.0	3.0	3.0
		-16.7	-17.0	3.2	3.2	3.2	3.2	3.2	3.2
		-14.7	-15.0	3.4	3.4	3.4	3.4	3.4	3.4
		-12.6	-13.0	3.6	3.6	3.6	3.5	3.5	3.5
		-10.5	-11.0	3.7	3.7	3.7	3.7	3.7	3.7
		-9.5	-10.0	3.8	3.8	3.8	3.8	3.8	3.8
		-8.5	-9.1	3.9	3.9	3.9	3.9	3.9	3.9
		-7.0	-7.6	4.0	4.0	4.0	4.0	4.0	4.0
		-5.0	-5.6	4.2	4.2	4.2	4.2	4.2	4.2
		-3.0	-3.7	4.4	4.4	4.4	4.4	4.4	4.4
		0.0	-0.7	4.7	4.6	4.6	4.6	4.6	4.4
		3.0	2.2	4.9	4.9	4.9	4.8	4.7	4.4
		5.0	4.1	5.1	5.1	5.0	4.8	4.7	4.4
		7.0	6.0	5.2	5.2	5.0	4.8	4.7	4.4
		9.0	7.9	5.4	5.3	5.0	4.8	4.7	4.4
		11.0	9.8	5.6	5.3	5.0	4.8	4.7	4.4
		13.0	11.8	5.6	5.3	5.0	4.8	4.7	4.4
		15.0	13.7	5.6	5.3	5.0	4.8	4.7	4.4

CA03A095

5 Capacity tables

5 - 2 Heating capacity tables



FXNQ-MA									
Unit Size	Nominal capacity	Outdoor air temperature		Indoor air temperature °CDB					
				16.0	18.0	20.0	21.0	22.0	24.0
		°CDB	°CWB	kW	kW	kW	kW	kW	kW
50	6.3	-19.8	-20.0	3.7	3.7	3.7	3.7	3.7	3.7
		-18.8	-19.0	3.8	3.8	3.8	3.8	3.8	3.8
		-16.7	-17.0	4.1	4.0	4.0	4.0	4.0	4.0
		-14.7	-15.0	4.3	4.3	4.3	4.2	4.2	4.2
		-12.6	-13.0	4.5	4.5	4.5	4.5	4.5	4.5
		-10.5	-11.0	4.7	4.7	4.7	4.7	4.7	4.7
		-9.5	-10.0	4.8	4.8	4.8	4.8	4.8	4.8
		-8.5	-9.1	4.9	4.9	4.9	4.9	4.9	4.9
		-7.0	-7.6	5.1	5.1	5.1	5.1	5.1	5.1
		-5.0	-5.6	5.3	5.3	5.3	5.3	5.3	5.3
		-3.0	-3.7	5.5	5.5	5.5	5.5	5.5	5.5
		0.0	-0.7	5.9	5.9	5.8	5.8	5.8	5.5
		3.0	2.2	6.2	6.2	6.2	6.1	5.9	5.5
		5.0	4.1	6.4	6.4	6.3	6.1	5.9	5.5
		7.0	6.0	6.6	6.6	6.3	6.1	5.9	5.5
		9.0	7.9	6.8	6.7	6.3	6.1	5.9	5.5
		11.0	9.8	7.0	6.7	6.3	6.1	5.9	5.5
		13.0	11.8	7.1	6.7	6.3	6.1	5.9	5.5
		15.0	13.7	7.1	6.7	6.3	6.1	5.9	5.5
63	8.0	-19.8	-20.0	4.7	4.7	4.7	4.7	4.7	4.7
		-18.8	-19.0	4.9	4.9	4.8	4.8	4.8	4.8
		-16.7	-17.0	5.1	5.1	5.1	5.1	5.1	5.1
		-14.7	-15.0	5.4	5.4	5.4	5.4	5.4	5.4
		-12.6	-13.0	5.7	5.7	5.7	5.7	5.7	5.7
		-10.5	-11.0	6.0	6.0	6.0	6.0	6.0	5.9
		-9.5	-10.0	6.1	6.1	6.1	6.1	6.1	6.1
		-8.5	-9.1	6.3	6.3	6.2	6.2	6.2	6.2
		-7.0	-7.6	6.5	6.5	6.4	6.4	6.4	6.4
		-5.0	-5.6	6.8	6.7	6.7	6.7	6.7	6.7
		-3.0	-3.7	7.0	7.0	7.0	7.0	7.0	7.0
		0.0	-0.7	7.5	7.4	7.4	7.4	7.4	7.0
		3.0	2.2	7.9	7.8	7.8	7.7	7.5	7.0
		5.0	4.1	8.1	8.1	8.0	7.7	7.5	7.0
		7.0	6.0	8.4	8.4	8.0	7.7	7.5	7.0
		9.0	7.9	8.7	8.5	8.0	7.7	7.5	7.0
		11.0	9.8	8.9	8.5	8.0	7.7	7.5	7.0
		13.0	11.8	9.0	8.5	8.0	7.7	7.5	7.0
		15.0	13.7	9.0	8.5	8.0	7.7	7.5	7.0

CA03A095

6 Dimensional drawing & centre of gravity

6 - 1 Dimensional drawing

FXNQ20,25MA

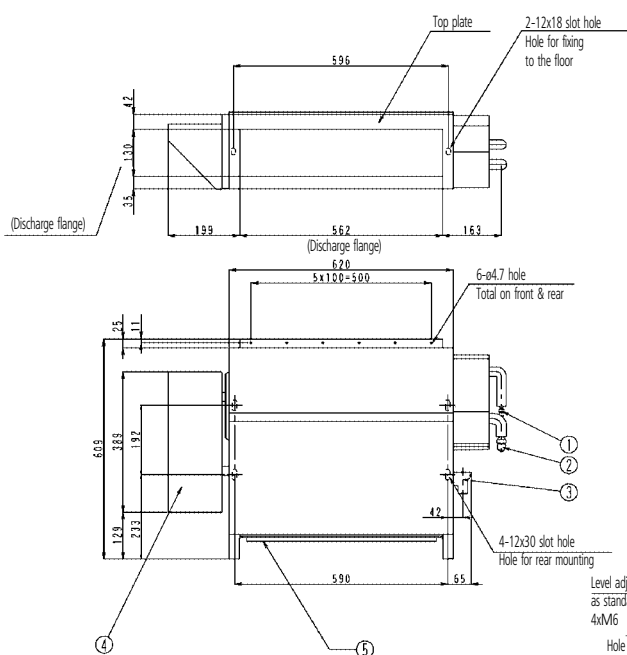



Nr	Part name	Description
1	Liquid pipe connection port	ø6.4 flare connection
2	Gas pipe connection port	ø12.7 flare connection
3	Drain pipe connection port	O.D. 21
4	Switch box	
5	Air filter	

NOTES

- Location of unit's name plate: right lower corner of front plate.

3D038863A

FXNQ32,40MA

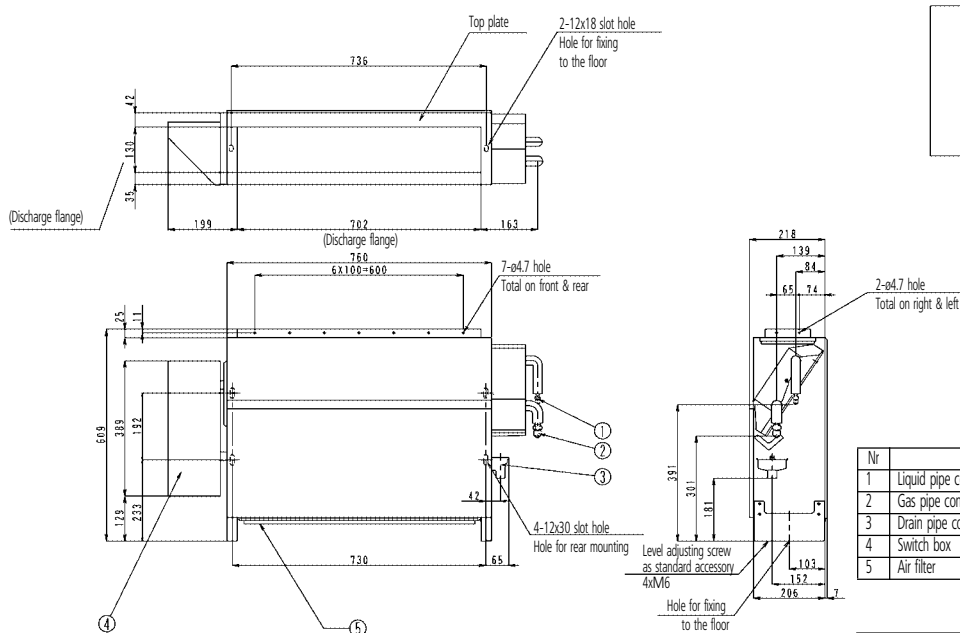

Nr	Part name	Description
1	Liquid pipe connection port	ø6.4 flare connection
2	Gas pipe connection port	ø12.7 flare connection
3	Drain pipe connection port	O.D. 21
4	Switch box	
5	Air filter	

NOTES


- Location of unit's name plate: right lower corner of front plate.

3D038864B

6 Dimensional drawing & centre of gravity

6 - 1 Dimensional drawing

FXNQ50,63MA

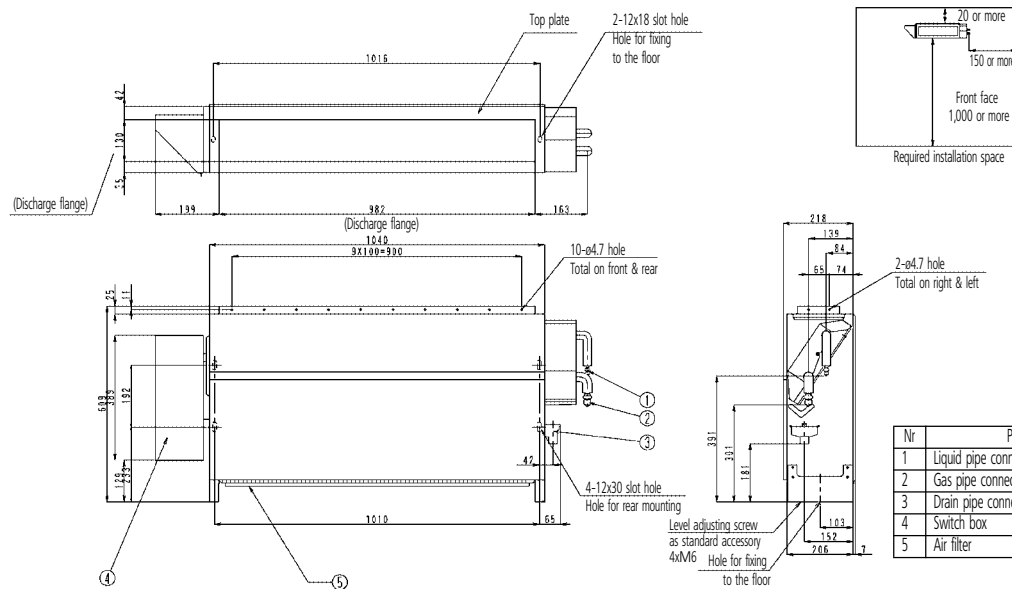

Piping size (Field supply)

Indoor unit	Gas side	Liquid side
FXNQ50MA	ø 12.7	ø 6.4
FXNQ63MA	ø 15.9	ø 9.5

Nr	Part name	Description
1	Liquid pipe connection port	flare connection
2	Gas pipe connection port	flare connection
3	Drain pipe connection port	O.D. 21
4	Switch box	
5	Air filter	

NOTES


- Location of unit's name plate: right lower corner of front plate.

3D038865B

6 Dimensional drawing & centre of gravity

6 - 2 Centre of gravity


FXNQ-MA

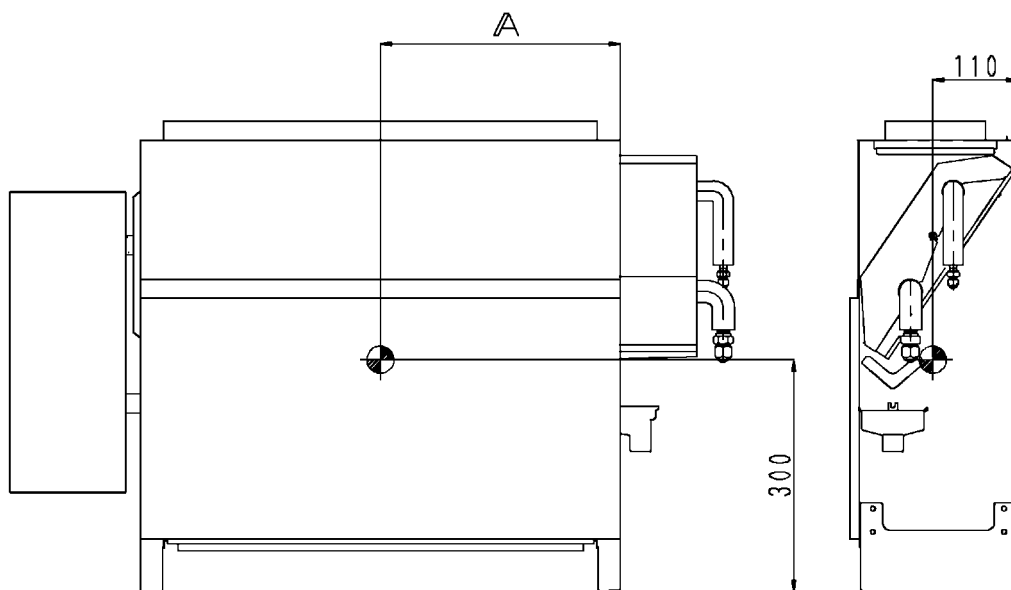

Model	A
FXNQ20MA	395
FXNQ25MA	395
FXNQ32MA	465
FXNQ40MA	465
FXNQ50MA	505
FXNQ63MA	505

4D034533B


7 Piping diagram

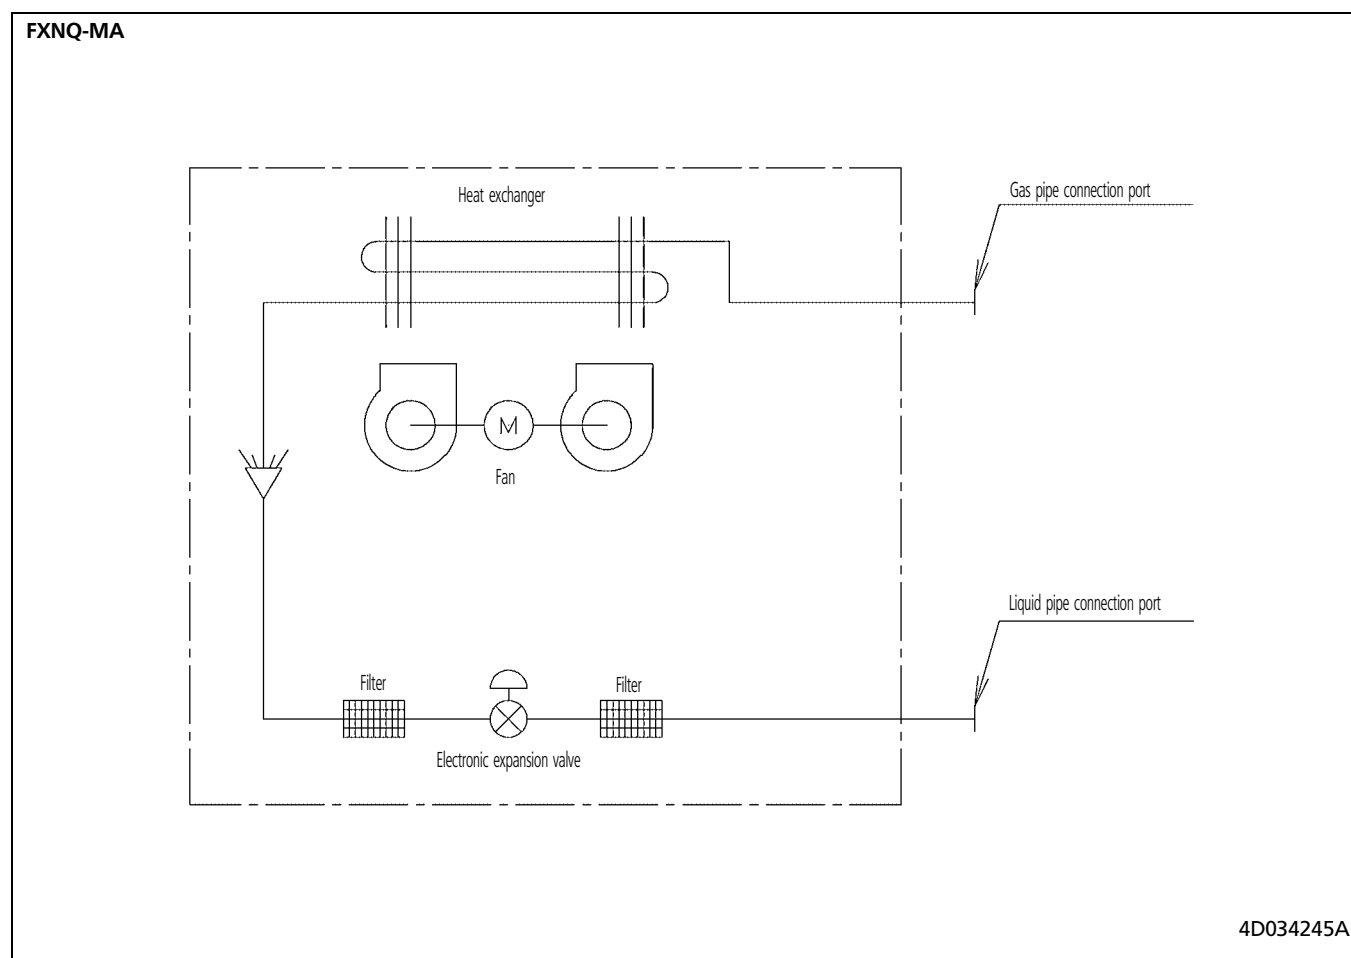

8 Wiring diagram

8 - 1 Wiring diagram

FXNQ-MA

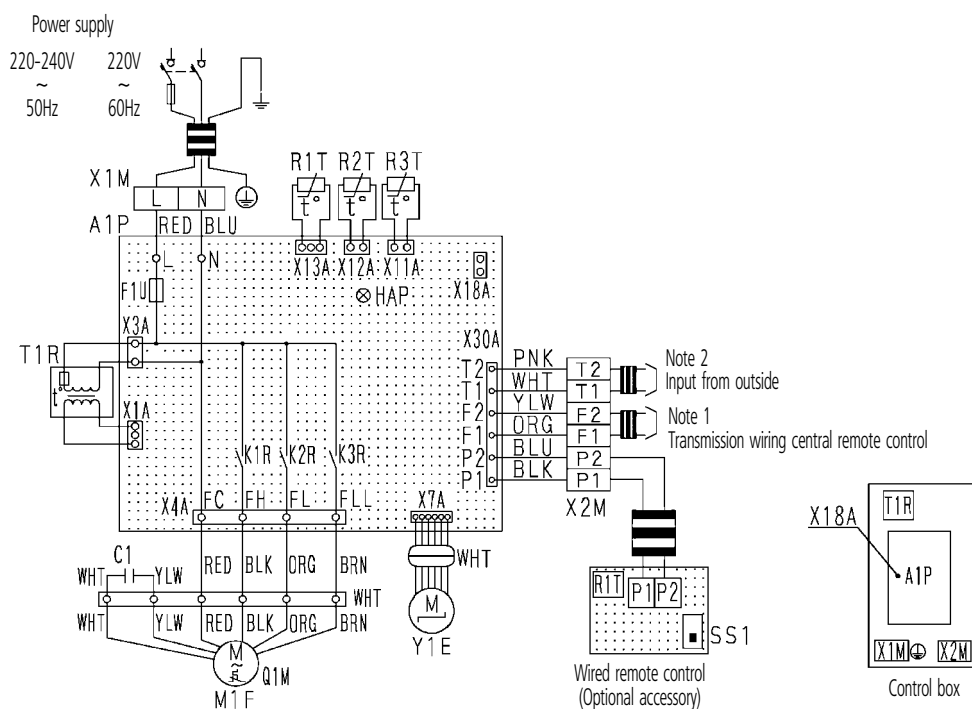

Indoor unit		R2T • R3T	Thermistor (Coil)
A1P	Printed circuit board	T1R	Transformer (220-240V/22V)
C1	Capacitor (M1F)	X1M	Terminal block (Power)
F1U	Fuse (Ⓑ) 5A, 250V)	X2M	Terminal block (Control)
HAP	Light emitting diode (Service monitor-green)	Y1E	Electronic expansion valve
K1R-K3R	Magnetic relay (M1F)	Wired remote control	
M1F	Motor (Indoor fan)	R1T	Thermistor (Air)
Q1M	Thermo switch (M1F embedded)	SS1	Selector switch (Main/sub)
R1T	Thermistor (Air)	Connector for optional parts	
		X18A	Connector (Wiring adapter for electrical appendices)

 : Terminal block
 : Connector
 : Terminal
 : Field wiring

COLORS : BLK : Black PNK : Pink
 BLU : Blue RED : Red
 BRN : Brown WHT : White
 ORG : Orange YLW : Yellow

NOTES

- 1 In case using central remote control, connect it to the unit in accordance with the attached instruction manual.
- 2 When connecting the input wires from the outside, forced off or on/off control operation can be selected by remote control. In details, refer to the installation manual attached to the unit.
- 3 Use copper conductors only.


3D039826D

9 Sound data

9 - 1 Sound pressure spectrum

FXNQ20,25MA

4D034534A

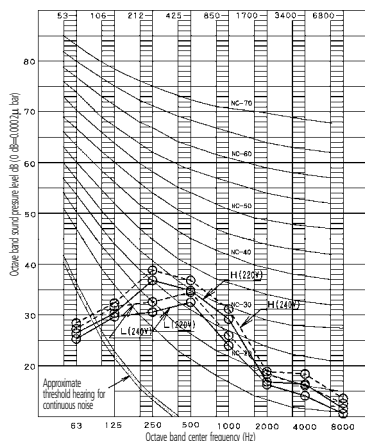


NOTES

- Over all (dB):
(B, G, N is already rectified)

Scale	220V		240V	
	H	L	H	L
A	35	32	37	34
C	40	36.5	42	38.5

- Measuring place: Anechoic chamber
- Operating conditions:
 - Power source: 220•240V/220V 50/60Hz
 - JIS standard


- Location of microphone



- Operating noise differs with operation and ambient conditions.

FXNQ32MA

4D034535A

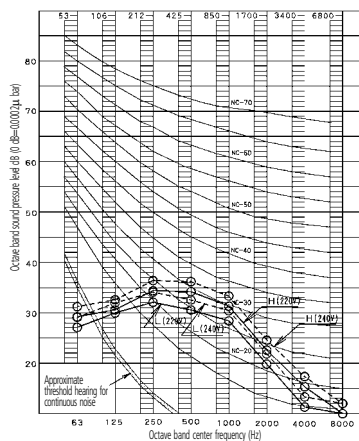


NOTES

- Over all (dB):
(B, G, N is already rectified)

Scale	220V		240V	
	H	L	H	L
A	35	32	37	34
C	39	37	41	39

- Measuring place: Anechoic chamber
- Operating conditions:
 - Power source: 220•240V/220V 50/60Hz
 - JIS standard


- Location of microphone



- Operating noise differs with operation and ambient conditions.

FXNQ40MA

4D034536A

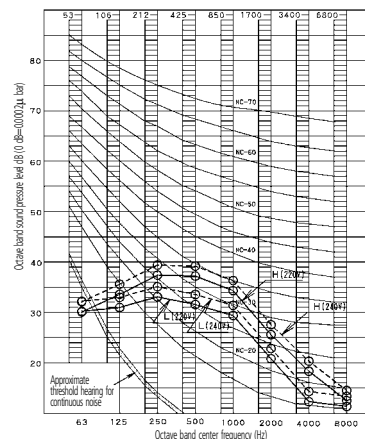


NOTES

- Over all (dB):
(B, G, N is already rectified)

Scale	220V		240V	
	H	L	H	L
A	38	33	40	35
C	42	38	44	40

- Measuring place: Anechoic chamber
- Operating conditions:
 - Power source: 220•240V/220V 50/60Hz
 - JIS standard


- Location of microphone



- Operating noise differs with operation and ambient conditions.

FXNQ50MA

4D034537A

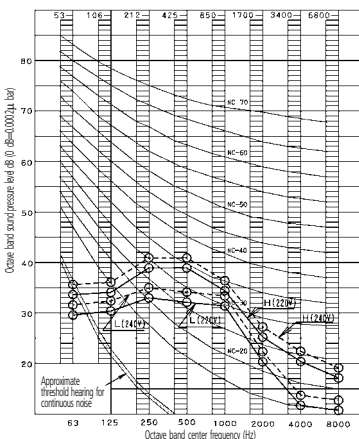


NOTES

- Over all (dB):
(B, G, N is already rectified)

Scale	220V		240V	
	H	L	H	L
A	39	34	41	36
C	44	38.5	46	40.5

- Measuring place: Anechoic chamber
- Operating conditions:
 - Power source: 220•240V/220V 50/60Hz
 - JIS standard

- Location of microphone




- Operating noise differs with operation and ambient conditions.

9 Sound data

9 - 1 Sound pressure spectrum

FXNQ63MA

4D034538A

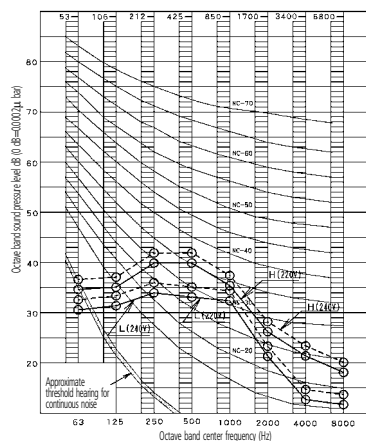

NOTES

- Over all (dB):
(B, G, N is already rectified)

Scale	220V		240V	
	H	L	H	L
A	40	35	42	37
C	45	39.5	47	41.5


- Measuring place: Anechoic chamber

- Operating conditions:

- Power source: 220•240V/220V 50/60Hz
- JIS standard

○ — ○ 220V
○ - - - ○ 240V

- Location of microphone




- Operating noise differs with operation and ambient conditions.

10 Installation

10 - 1 Suspension bolt pitch position


FXNQ-MA

- Positioning of holes for fastening to the wall

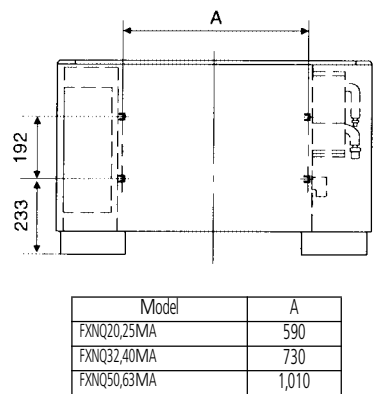

Model	A
FXNQ20.25MA	590
FXNQ32.40MA	730
FXNQ50.63MA	1,010

- How to open/close the front panel

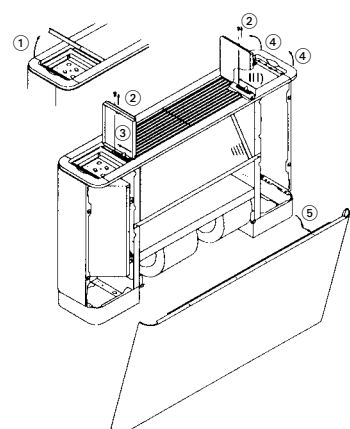


- Open the lid of control panel (both left and right).
- Remove screws (both left and right).
- Push the knobs (both left and right) to the rear.
- Lift the front of the top plate.
- Lower the front panel towards the front of the unit.
- To close, perform the procedure in opposite order. Pull towards the front until the knob snaps in place.

3PN86154-1-5

10 Installation

10 - 2 Service space

FXNQ-MA

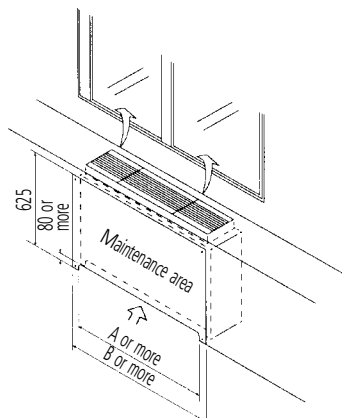

Model	A	B
FXNQ20,25MA	570	1,030
FXNQ32,40MA	710	1,170
FXNQ50,63MA	990	1,450

NOTE

- 1 Leave sufficient clearance for air inlet and maintenance.

3P086154-1-4



Daikin's unique position as a manufacturer of air conditioning equipment, compressors and refrigerants has led to its close involvement in environmental issues. For several years Daikin has had the intention to become a leader in the provision of products that have limited impact on the environment. This challenge demands the eco design and development of a wide range of products and an energy management system, resulting in energy conservation and a reduction of waste.



Daikin Europe N.V. is approved by LRQA for its Quality Management System in accordance with the ISO9001 standard. ISO9001 pertains to quality assurance regarding design, development, manufacturing as well as to services related to the product.




ISO14001 assures an effective environmental management system in order to help protect human health and the environment from the potential impact of our activities, products and services and to assist in maintaining and improving the quality of the environment.



Daikin units comply with the European regulations that guarantee the safety of the product.

VRV® products are not within the scope of the Eurovent certification programme.

The present publication is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this publication to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Daikin Europe N.V..



DAIKIN EUROPE N.V.

Naamloze Vennootschap
Zandvoordestraat 300
B-8400 Oostende, Belgium
www.daikin.eu
BTW: BE 0412 120 336
RPR Oostende